



# PowerLogic™ P3

Catalog 2023  
Network Protection Relays



[se.com/PowerLogic P3](https://se.com/PowerLogic%20P3)

Life Is On

**Schneider**  
Electric

Note: Electrical power systems are dangerous, protection relays are defined and governed by international standards such as IEC 60255 “Measuring relays and protective equipment” and IEEE C37.97 “Protective relay applications to power systems buses”. Never attempt to install or operate protection relays or associated equipment without the necessary qualifications, training, and tools. Exposure to electrical arc-flash incidents can be life threatening, no situation can ever be deemed fully safe. Standards such as NFPA 70E define important risk categorization and such standards identify both distance from, and energy of the arc incident to be important factors. In order to reduce the risk category and improve safety during arc-flash incidents, functionality is available in PowerLogic™ P3 protection relays to: i) to operate electrical panel from a safer distance via wireless communication, and ii) arc-flash protection functionality to detect and limit the arc energy by tripping the connected circuit breaker faster than in a conventional protection scheme.

Notice: This Catalog is for illustration purpose only. All connections mentioned in this document must be made as instructed in the User Manuals.

# General Contents



---

PowerLogic™ P3 Range Description	6
PowerLogic™ P3 Standard	32
PowerLogic™ P3 Advanced	52
PowerLogic™ Digital Experience	82
Additional Modules and Accessories	92
Schneider Electric Service	106
Ordering	112

---

# Take the PowerLogic™ P3 Further with EcoStruxure

EcoStruxure, Schneider Electric's IoT-enabled, open and interoperable architecture and platform, brings together Connected Products, Edge Control, and Apps, Analytics & Services. EcoStruxure connected products deliver enhanced value around safety, reliability, efficiency, sustainability, and connectivity.

# 450000

EcoStruxure systems deployed since 2007 with the support of our 9000 system integrators

## EcoStruxure Ready



**Efficient asset management**  
Boost your efficiency and reduce downtime using predictive maintenance tools




**24/7 connectivity**  
Make better informed decisions with real-time data that's available everywhere, anytime



**Enhanced safety**  
Advanced features designed-in based on well-known designs, experience and technology

## EcoStruxure™ Innovation At Every Level

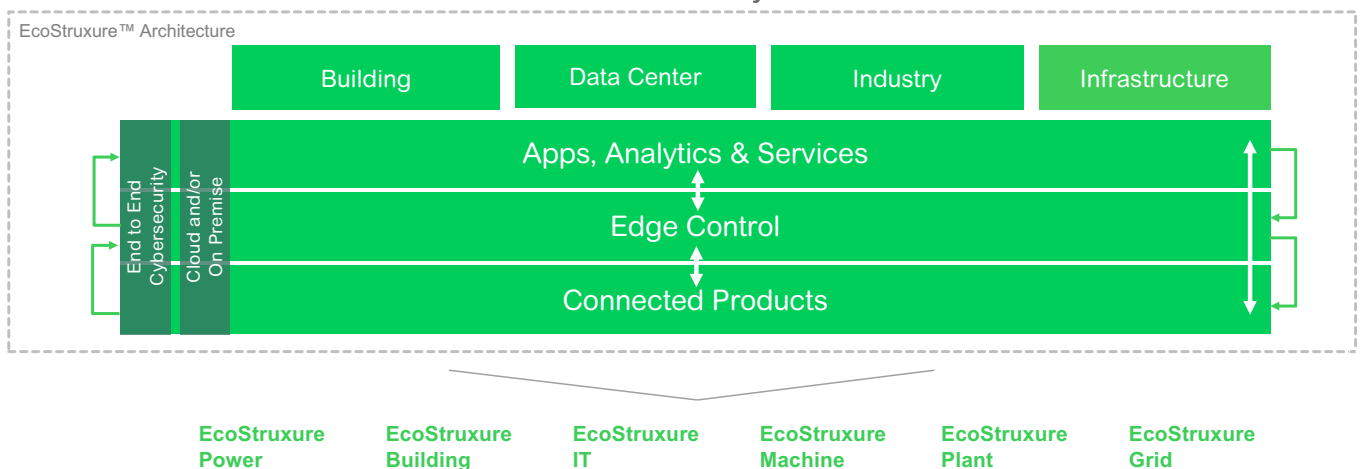



# PowerLogic™ P3 at a Glance

PM106574



PM106572



## What is PowerLogic P3?

PowerLogic P3 is a complete range of protection relays for medium voltage applications, including feeder, motor, transformer, and generator protection. It embeds all the latest communication protocols on serial or Ethernet links.

Based on more than 100 years of experience in network protection relays, PowerLogic P3 benefits from the reliability of Sepam, MiCOM and Vamp.



Unparalleled Efficiency



Better Connectivity



Enhanced Safety

- Simple selection and ordering with EcoReal MV
- Simplified configuration with the new eSetup Easergy Pro setting tool
- Faster delivery with on-the-shelf availability of standard configurations

- Simpler operation and maintenance with the EcoStruxure™ Power Device app
- 9 communication protocols in one box, including IEC 61850
- Increased number of inputs and outputs for more possibilities

- Embedded arc protection
- Built-in virtual injection testing
- Compliant with international standards (i.e., IEC 60255-1)

## Range overview

DM105528



**P3G30/P3G32**

Generator differential



**P3U30**

Universal



**P3T32**

Transformer differential



**P3U30**

Universal



**P3F30/P3L30**

Directional & Line diff.




**P3U30**

Universal



**P3M30/P3M32**

Motor differential

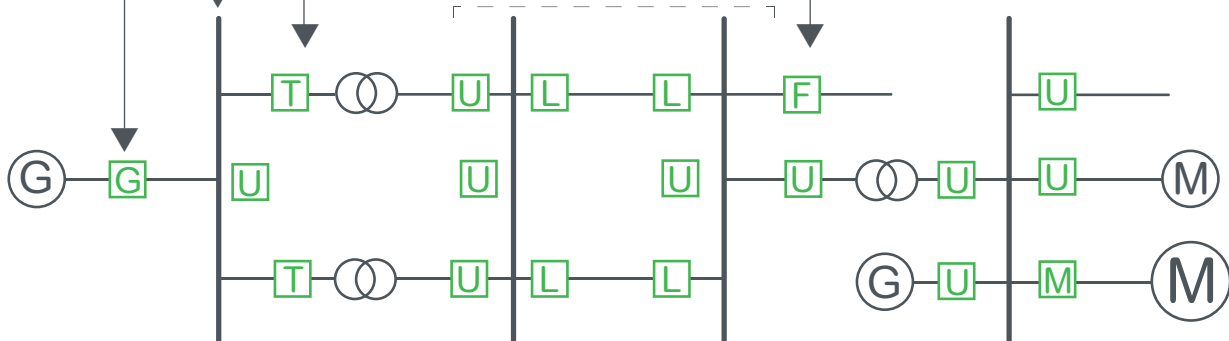

# PowerLogic™ P3 Range Description

# PowerLogic™ P3 Range Description

---

<b>Overview</b>	<b>8</b>
<b>Selection Guide</b>	<b>9</b>
<b>Selection Guide by Application</b>	<b>12</b>
Arc Flash Application	12
Feeder/Incomer Application	13
Motor Application	15
Transformer Application	16
Generator Application	18
Capacitor Application	20
<b>Communication - Examples of Network Architectures</b>	<b>21</b>
<b>Application</b>	<b>28</b>

---



PowerLogic™ P3 Standard



PowerLogic™ P3 Advanced

PowerLogic P3 is a family of digital protection relays for distribution networks dedicated to:

- **Buildings and Industry:**
  - Retail
  - Hotels
  - Healthcare
  - Education and research
  - Transportation
  - Industrial buildings
  - Data Center
- **Utilities - Energy distribution**
- **Large sites:**
  - Oil and Gas
  - Mining
  - Mineral and Metals
  - Water



PowerLogic P3 protection relay is based on proven technology concepts and developed in close cooperation with customers, so it's built to meet your toughest demands. It's available in two sizes to best fit your needs:

- The PowerLogic™ P3 Standard combines protection functions such as directional earth fault for feeder and motor protection in a one-box solution.
- The PowerLogic™ P3 Advanced features a modular design that allows user-defined conventional protection and arc flash protection solutions in both new and existing power distribution systems.

PowerLogic products are designed to be user friendly, a feature that is proven in our customer reports day after day. You'll benefit from features that include:

- A complete set of protection functions, related to the application
- Arc detection (PowerLogic™ P3 Advanced)
- Dedicated circuit breaker control with single-line diagram, push buttons, programmable function key and LEDs, and a customizable alarm
- Multilingual HMI for customized messaging
- Settings tool relay management software for setting parameters, configuring, and network fault simulation
- Both serial and Ethernet communication, including redundancy
- IEC 61850 standard Ed.1 & Ed.2

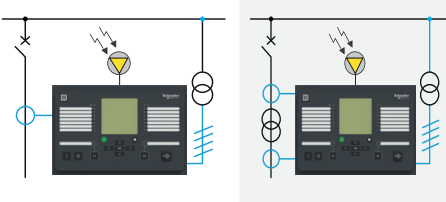

PowerLogic™ P3 contains		PowerLogic™ P3 Standard		PowerLogic™ P3 Advanced	
Two main devices, each with specific functions to address your needs in a one-box design, regardless of application.					
<b>Feeder</b>					
<b>Transformer</b>					
<b>Motor</b>					
<b>Generator</b>					
<b>Characteristics</b>					
Measuring inputs	Phase current	1/5A CT or LPCT (x3) <sup>(5)</sup>		1/5A CT or LPCT (x3) <sup>(5)</sup>	1/5A CT (x6)
	Residual current	1/5A CT or 0.2/1A CT or CSH 2A/20A		(1/5A+0.2/1A) CT (1/5A + CSH 2/20A)	2 x (1/5A+0.2/1A) CT, 1 x (1/5A) CT
	Voltage	VT (x1)	VT (x4) or LPVT (x4) <sup>(5)</sup>	VT (x4) or LPVT (x4) <sup>(5)</sup>	VT (x4)
Arc-flash sensor input		-		Loop sensor: 1 Point sensor: 2, 4 or 6 <sup>(1)(2)</sup>	Loop sensor: 1 Point sensor: 2, 4 or 6 <sup>(1)</sup>
Digital	Input	10/8	14/16	6 to 36	6 to 16
	Output	5/8 + SF	11/8 + SF	10 to 21 + SF	10 to 13 + SF
Analogue	Input	0 or 4 <sup>(1)</sup>		0 or 4 <sup>(1)</sup>	
	Output	0 or 4 <sup>(1)</sup>		0 or 4 <sup>(1)</sup>	
Temperature sensor input		0 or 8 or 12 <sup>(1)</sup>		0 or 8 or 12 <sup>(1)</sup>	
Front port		USB type B		USB type B	
Nominal power supply		24 Vdc or 24...48 Vdc or 38.4...265 Vdc or 48...230 Vac <sup>(4)</sup>		24...48 Vdc or 38.4...265 Vdc or 110-240 Vac	
Ambient temperature, in service		-40...60 °C (-40...140 °F)		-40...60 °C (-40...140 °F)	
<b>Communication</b>					
Rear ports		●	●	●	●
RS232, IRIG/B, RS485, Ethernet		●	●	●	●
IEC61850 ed1 & ed2		●	●	●	●
IEC 60870-5-101 & 103		●	●	●	●
DNP3 over Ethernet		●	●	●	●
DNP3 serial		●	●	●	●
Protocols	Modbus serial	●	●	●	●
	Modbus over Ethernet	●	●	●	●
	Ethernet IP <sup>(6)</sup>	●	●	●	●
	Profibus DP	●	●	●	●
	SPAbus	●	●	●	●
Redundancy protocols (RSTP/PRP)		●	●	●	●
<b>Others</b>					
Control		4 objects 4 displays	4 objects 8 displays	8 objects 3-8 display	
Logic (Matrix + Logic equation)		●		●	
Withdrawable CT connector with shorting		●		-	
Remote HMI		-		●	
Hardware dimensions (W/H/D)		171 x 176 x 214 <sup>(3)</sup> mm/6.73 x 6.93 x 8.43 in		264 x 177 x 208 mm/10.39 x 6.97 x 8.19 in	

(1) Depends on optional module  
 (2) P3L30 can have 1 loop or 2-point sensors only  
 (3) 226 mm (8.90 in) with ring-lug connectors  
 (4) Check the available power supply range from the device's serial number label  
 (5) P3U30, P3F30, P3M30 relays only. Consult us for other models  
 (6) Consult us for availability

Protection functions	ANSI code	Feeder (P3U)		Motor (P3U)		Advanced (P3x)						
		P3U20	P3U30	P3U20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Under-impedance	21G	-	-	-	-	-	-	-	-	2	2	-
Fault locator	21FL	-	1	-	1	1	1	-	-	-	-	-
Overfluxing	24	-	-	-	-	-	-	-	-	1	1	1
Synchro-check	25	-	2	-	2	2	2	2	2	2	2	2
Undervoltage	27	-	3	-	3	3	3	3	3	3	3	3
Positive sequence undervoltage	27P	-	-	-	-	-	-	-	-	2	2	-
Directional active under/reverse power	32R/32L	-	2	-	2	2	2	2	2	2	2	-
Phase undercurrent	37	1	1	1	1	-	-	1	1	-	-	-
Temperature monitoring	38/49T	12 <sup>(1)(2)</sup>	12 <sup>(2)</sup>	12 <sup>(1)(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>	12 <sup>(2)</sup>
Loss of field	40	-	-	-	-	-	-	-	-	1	1	-
Under-reactance	21/40	-	-	-	-	-	-	-	-	2	2	-
Negative sequence overcurrent (motor, generator)	46	-	-	2	2	-	-	2	2	2	2	2
Incorrect phase sequence	46	-	-	1	1	-	-	1	1	-	-	-
Cur. unbalance, broken conductor	46BC	1	1	-	-	1	1	-	-	-	-	-
Negative sequence overvoltage protection	47	-	3	-	3	3	3	3	3	3	3	3
Excessive start time, locked rotor	48/51LR	-	-	1	1	-	-	1	1	-	-	-
Thermal overload	49	1	1	1	1	1	1	1	1	1	1	1
Phase overcurrent	50/51	3	3	3	3	3	3	3	3	3	3	3
Earth fault overcurrent	50N/51N	5	5	5	5	5	5	5	5	5	5	5
Breaker failure	50BF	1	1	1	1	1	1	1	1	1	1	1
Switch On To Fault (SOTF)	50HS	1	1	1	1	1	1	1	1	1	1	1
Capacitor bank unbalance	51C	2	2	2	2	2	2	2	2	2	2	2
Voltage dependent overcurrent	51V	-	1	-	1	1	1	-	-	1	1	-
Overvoltage	59	-	3	-	3	3	3	3	3	3	3	3
Capacitor overvoltage	59C	1	1	-	-	1	1	-	-	-	-	-
Neutral voltage displacement	59N	3	3	3	3	2	2	2	2	2	2	2
CT supervision	60	1	1	1	1	1	1	1	1	1	2	2
VT supervision	60FL	-	1	-	1	1	1	1	1	1	1	1
Restricted earth fault (high imped.)	64REF/64BEF	1	1	1	1	1	1	1	1	1	1	1
Restricted earth fault (low imped.)	64REF	-	-	-	-	-	-	-	1	-	1	1
Stator earth fault	64S	-	-	-	-	-	-	-	-	1	1	-
Frequent start inhibition	66	-	-	1	1	-	-	1	1	-	-	-
Directional phase overcurrent	67	-	4	-	4	4	4	4	4	4	4	4
Directional earth-fault o/c	67N	3	3	3	3	3	3	3	3	3	3	3
Transient intermittent	67NI	1	1	-	-	1	1	-	-	-	-	-
Magnetizing inrush detection	68F2	1	1	1	1	1	1	1	1	1	1	1
Fifth harmonic detection	68H5	1	1	1	1	1	1	1	1	1	1	1
Pole slip	78PS	-	-	-	-	-	-	-	-	1	1	-
Vector Shift	78 VS	-	1	-	-	-	-	-	-	-	-	-
Auto-recloser	79	5	5	-	-	5	5	-	-	-	-	-
Over or under frequency	81	-	2/2	-	2/2	2/2	2/2	2/2	2/2	2/2	2/2	2/2
Rate of change of frequency	81R	-	1	-	1	1	1	1	1	1	1	1
Under frequency	81U	-	3	-	3	3	3	3	3	3	3	3
Lockout	86	1	1	1	1	1	1	1	1	1	1	1
Line differential	87L	-	-	-	-	-	2	-	-	-	-	-
Motor/Generator differential	87M/87G	-	-	-	-	-	-	-	2	-	2	-
Transformer differential	87T	-	-	-	-	-	-	-	-	-	-	2
Programmable stages	99	8	8	8	8	8	8	8	8	8	8	8
Arc-flash detection (AFD)		-	-	-	-	8	8	8	8	8	8	8
Cold load pick-up (CLPU)		1	1	1	1	1	1	1	1	1	1	1
Programmable curves		3	3	3	3	3	3	3	3	3	3	3
Setting groups <sup>(3)</sup>		4	4	4	4	4	4	4	4	4	4	4

(1) Temperature sensors optional for P3U20  
 (2) Using external RTD module

(3) Not all protection functions have 4 setting groups. See details in the manual.


Control functions	Feeder & Motor (P3U)		Advanced (P3x)						
	P3U20	P3U30	P3F30	P3L30	P3M30	P3M32	P3G30	P3G32	P3T32
Switchgear control and monitoring	1/6	6	8	8	8	8	8	8	8
Switchgear monitoring only	2	2	2	2	2	2	2	2	2
Programmable switchgear interlocking	●	●	●	●	●	●	●	●	●
Local control on single-line diagram	●	●	●	●	●	●	●	●	●
Local control with O/I keys	●	●	●	●	●	●	●	●	●
Local/remote function	●	●	●	●	●	●	●	●	●
Function keys	2	2	2	2	2	2	2	2	2
Custom logic (logic equations)	●	●	●	●	●	●	●	●	●
Control with Mobile application	●	●	●	●	●	●	●	●	●
<b>Measurement</b>									
RMS current values	●	●	●	●	●	● <sup>(1)</sup>	●	● <sup>(1)</sup>	● <sup>(1)</sup>
RMS voltage values	●	●	●	●	●	●	●	●	●
RMS active, reactive, and apparent power	-	●	●	●	●	●	●	●	●
Frequency	●	●	●	●	●	●	●	●	●
Fundamental frequency current values	●	●	●	●	●	● <sup>(1)</sup>	●	● <sup>(1)</sup>	● <sup>(1)</sup>
Fundamental frequency voltage values	-	●	●	●	●	●	●	●	●
Fundamental frequency active, reactive, and apparent power values	-	●	●	●	●	●	●	●	●
Power factor	-	●	●	●	●	●	●	●	●
Energy values active and reactive	-	●	●	●	●	●	●	●	●
Energy transmitted with pulse outputs	-	●	●	●	●	●	●	●	●
Demand values: phase currents	●	●	●	●	●	●	●	●	●
Demand values: active, reactive, apparent power and power factor	-	●	●	●	●	●	●	●	●
Min and max demand values: phase currents	●	●	●	●	●	●	●	●	●
Min and max demand values: RMS phase currents	●	●	●	●	●	●	●	●	●
Min and max demand values: active, reactive, apparent power and power factor	-	●	●	●	●	●	●	●	●
Maximum demand values over the last 31 days and 12 months: active, reactive, apparent power	-	●	●	●	●	●	●	●	●
Minimum demand values over the last 31 days and 12 months: active, reactive power	-	●	●	●	●	●	●	●	●
Max and min values: currents	●	●	●	●	●	●	●	●	●
Max and min values: voltages	●	●	●	●	●	●	●	●	●
Max and min values: frequency	●	●	●	●	●	●	●	●	●
Max and min values: active, reactive, apparent power and power factor	-	●	●	●	●	●	●	●	●
Harmonic values of phase current and THD	●	●	●	●	●	● <sup>(1)</sup>	●	● <sup>(1)</sup>	● <sup>(1)</sup>
Harmonic values of voltage and THD	-	●	●	●	●	●	●	●	●
Voltage sags and swells	-	●	●	●	●	●	●	●	●
<b>Logs and Records</b>									
Sequence of event record	●	●	●	●	●	●	●	●	●
Disturbance record	●	●	●	●	●	●	●	●	●
Tripping context record	●	●	●	●	●	●	●	●	●
<b>Monitoring functions</b>									
Trip circuit supervision (ANSI 74)	1	1	1	1	1	1	1	1	1
Circuit breaker monitoring	1	1	1	1	1	1	1	1	1
Relay monitoring	●	●	●	●	●	●	●	●	●

(1) Function available on both sets of CT inputs

### Busbar arc protection


- Arc protection, activated by overcurrent and light signals, or light signals alone

#### Centralized busbar arc protection

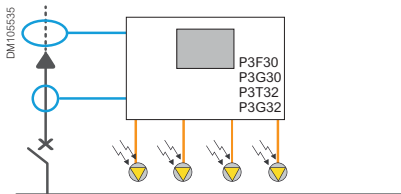

- Up to 4 light point sensors to monitor the busbar


#### De-centralized busbar arc protection

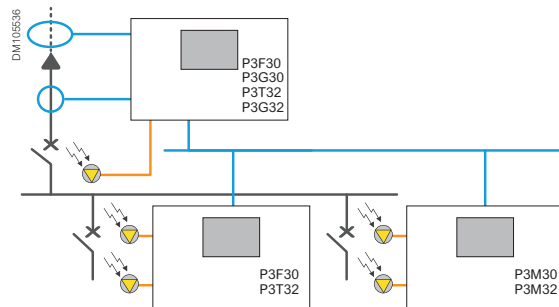

- Up to 4 light point sensors in each relay
- Transmission of light detection signals via digital I/O or IEC 61850 GOOSE messages

### Zone arc protection

- Up to 8 arc protection stages in each relay

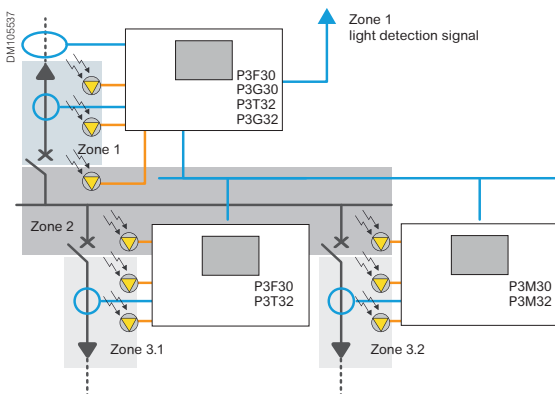


- Light detection in zone 1: signal sent to upstream relay for tripping
- Light detection in zone 2: incomer PowerLogic™ P3 trips, if fault confirmed by overcurrent
- Light detection in zone 3: corresponding outgoing PowerLogic™ P3 trips, if fault confirmed by overcurrent



### Outgoing protection


- Feeder overcurrent protection
- Feeder overload protection

**Protection of low-capacitance feeders in impedance-earthed or solidly-earthed neutral systems**

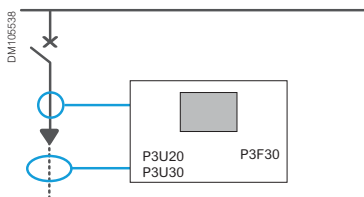


- Feeder earth-fault overcurrent

**Protection of high-capacitance feeders in impedance-earthed or compensated or isolated neutral systems**

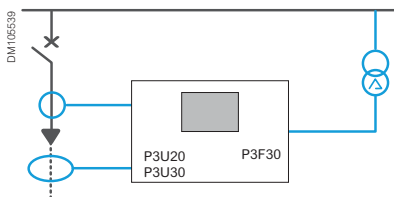

- Directional earth-fault overcurrent
- Transient intermittent earth-fault

**Protection of feeders with metering**

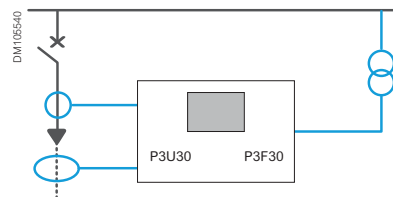


- Power and energy measurement
- Min and max demand values over the last 31 days and 12 months

### Incomer protection


- Busbar overcurrent protection

**Incomer protection without voltage monitoring**

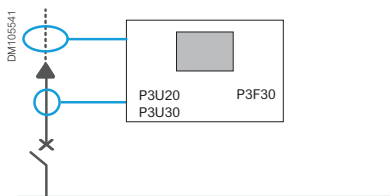


- Earth-fault overcurrent

**Incomer protection with voltage and frequency monitoring**

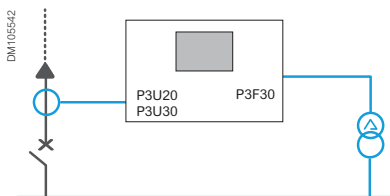


- Neutral voltage displacement protection for isolated system

**Incomer protection with voltage and frequency monitoring**

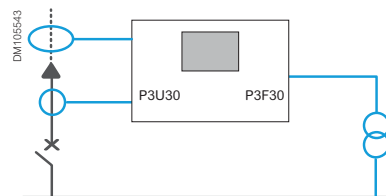


- Under/over voltage
- Frequency, rate of change of frequency

**Incomer protection with power quality monitoring**

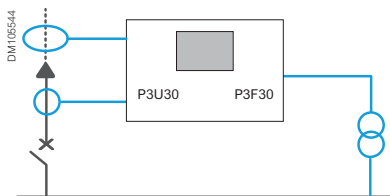

- Voltage and frequency min and max values
- Voltage harmonic values and THD
- Voltage sags and swells

**Parallel incomer protection**

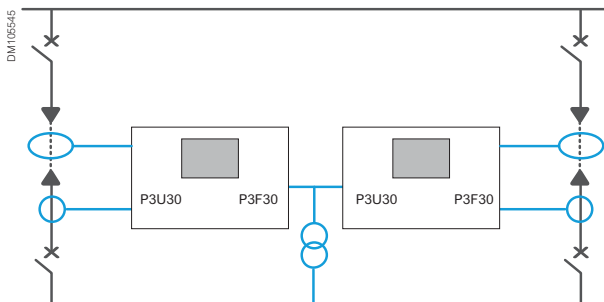


- Directional phase overcurrent
- Directional earth-fault overcurrent

### Line protection


- Overcurrent and earth-fault protection (directional and non-directional)
- Feeder overload protection

#### Overhead line protection

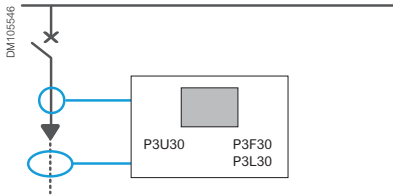


- Recloser
- Feeder fault locator

#### Incomer protection with fault locator

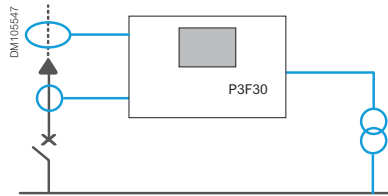

- Incomer fault locator

#### Line protection with line differential

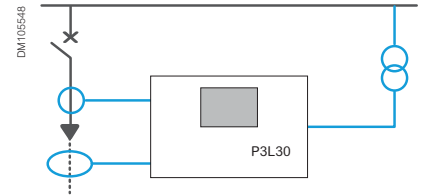


- Line differential protection

### Motor protection


- Motor overcurrent and earth-fault overcurrent
- Thermal overload
- Motor start-up supervision
- Motor restart inhibition

#### Motor protection without voltage monitoring

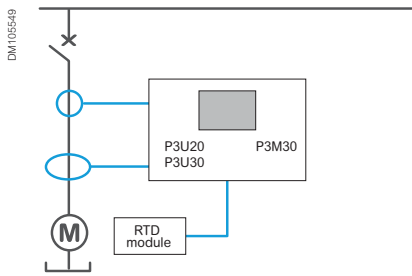


- Temperature measurement (Stator, bearings)

#### Motor protection with voltage monitoring

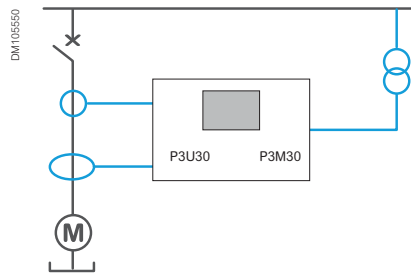

- Undervoltage protection

#### Motor protection with differential function

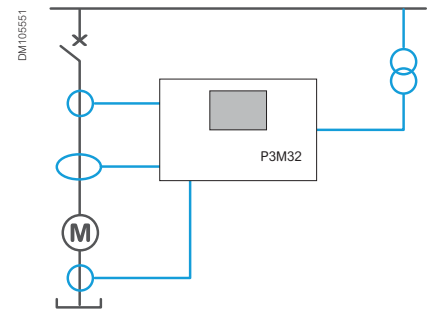


- Differential protection

**Transformer feeder protection**


- Transformer overcurrent and earth-fault overcurrent protection
- Thermal overload protection
- External trip from thermostat/Buchholz

**Transformer feeder protection**

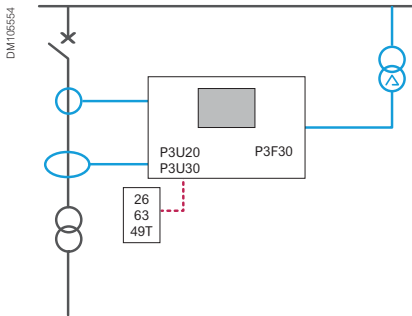


- Directional earth-fault overcurrent for impedance earthed or compensated neutral systems

**Transformer feeder protection without voltage monitoring**

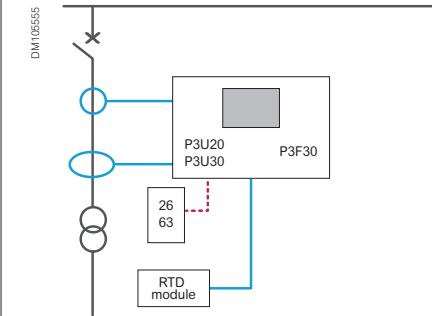


- Temperature measurement (ambient, oil)

**Transformer feeder protection with voltage monitoring**

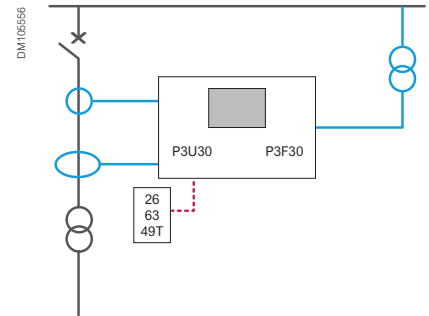


- Over and undervoltage protection

**Transformer feeder protection with additional current measurement**

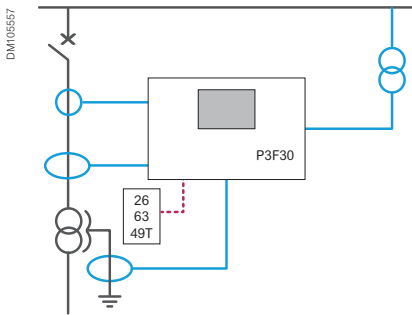


- Tank earth-leakage protection

**Transformer feeder protection with differential function**

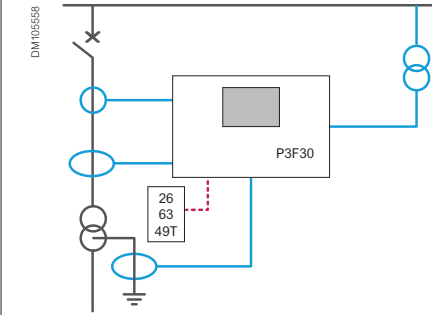

- Earth-fault overcurrent on the secondary side

**Transformer feeder protection with differential function**

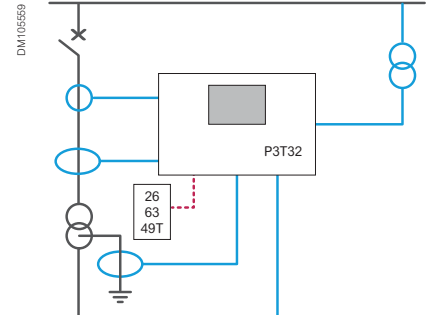


- Differential protection
- Restricted earth-fault protection (high impedance)




### Transformer incomer protection

- Busbar overcurrent protection
- Inter-trip from primary CB protection

#### Transformer incomer protection without voltage monitoring

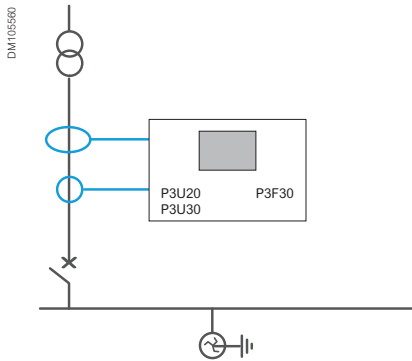


- Transformer earth-fault overcurrent

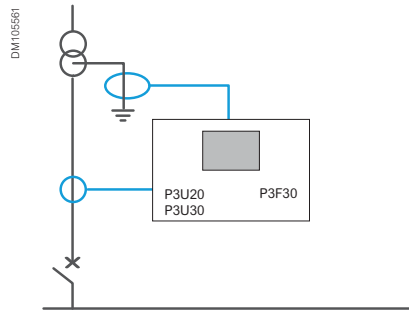


- Earth-fault overcurrent for transformer and back-up protection

#### Transformer feeder protection with voltage monitoring

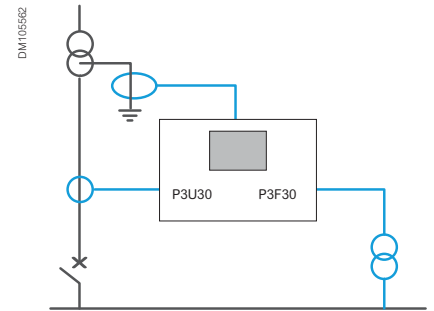


- Over and undervoltage protection
- Power and energy measurement
- Min and max demand values over the last 31 days and 12 months

#### Parallel transformer incomer protection

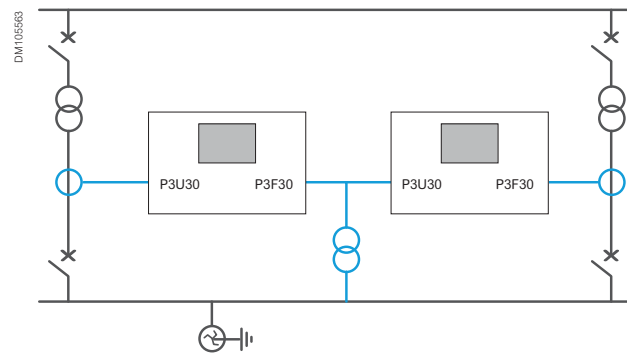

- Directional phase overcurrent

#### Transformer incomer protection with differential function overcurrent

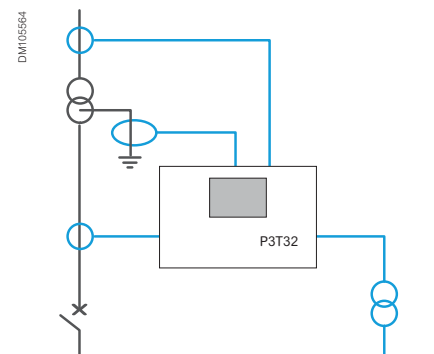


- Transformer differential overcurrent
- Restricted earth-fault overcurrent (high impedance)


### Small generator transformer unit protection

- Overcurrent protection of the supplied network
- Voltage and frequency monitoring
- External trip from thermostat/Buchholz

#### Protection of a stand-alone generator-transformer unit

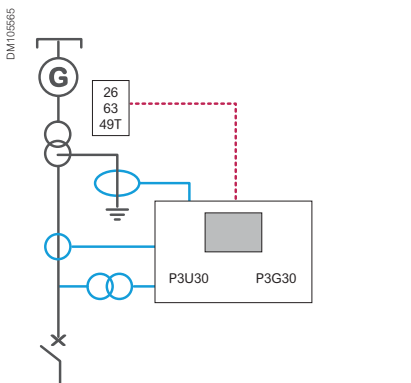


- Earth-fault overcurrent protection of the supplied network
- Note: monitoring of generator insulation must be ensured by another device

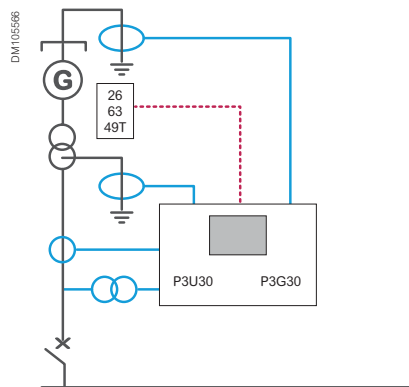


- Earth-fault overcurrent protection of the generator
- Earth-fault overcurrent protection of the supplied network

#### Protection of a generator-transformer unit coupled to another source

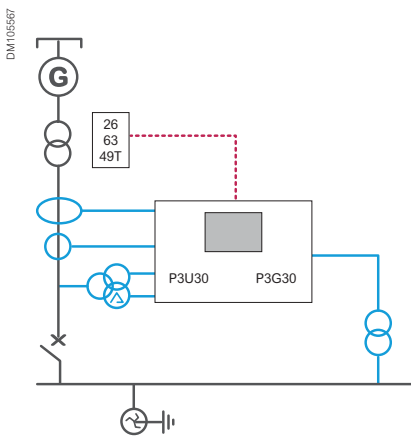

- Earth-fault overcurrent protection of the transformer
  - Neutral voltage displacement to detect transformer earth-fault when CB is open
  - Synchro-check
- Note: monitoring of generator insulation must be ensured by another device

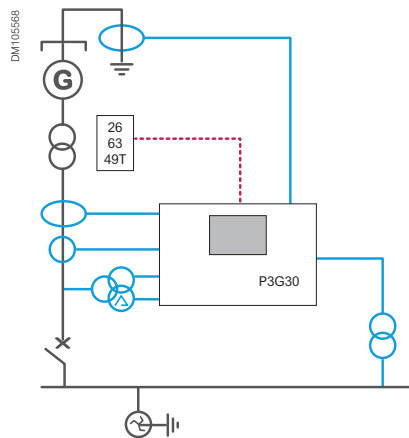


- Earth-fault overcurrent protection of the generator and the transformer
- Neutral voltage displacement to detect transformer earth-fault when CB is open
- Synchro-check

**Mid-size generator protection**


- Under-impedance
- Loss of field
- Voltage and frequency monitoring

**Protection of a generator coupled to another source**

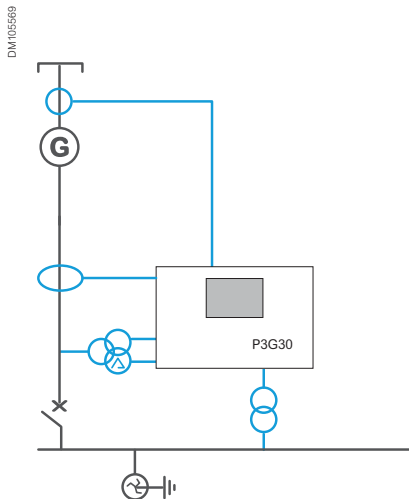


- Earth-fault overcurrent protection of the generator when coupled
- Neutral voltage displacement to detect generator earth-fault when CB is open
- Synchro-check

**Generator protection with differential function**

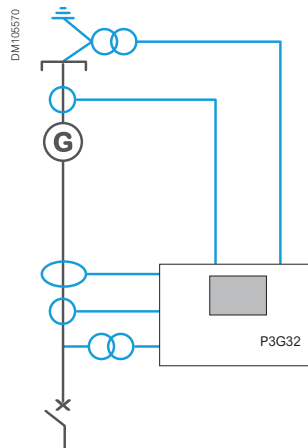

- Stator earth-fault detection
- Differential protection

**Generator-transformer unit protection with differential function**

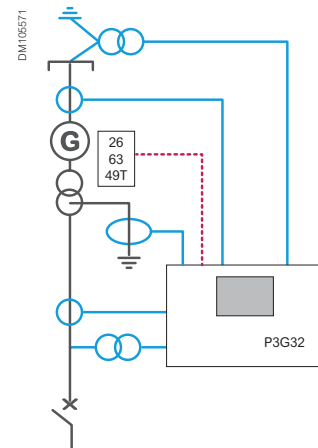


- Stator earth-fault detection
- Differential protection
- Restricted earth-fault protection (high impedance)

### Capacitor bank protection


- Capacitor bank overcurrent and earth-fault protection
- Capacitor bank overload protection

#### Capacitor bank protection without voltage monitoring

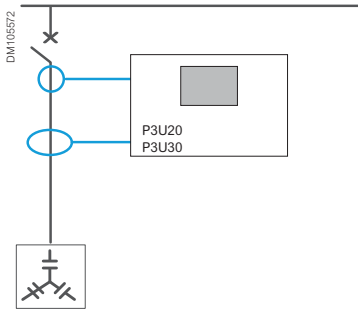


- Capacitor overvoltage protection, based on current measurement and harmonics
- Current harmonic values and THD

#### Capacitor bank protection with voltage monitoring

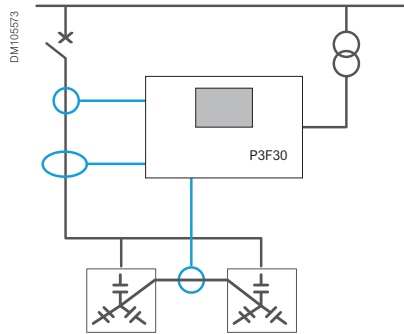


- Capacitor bank unbalance
- Overvoltage
- Current and voltage harmonic values and THD

#### Protection of harmonic filters

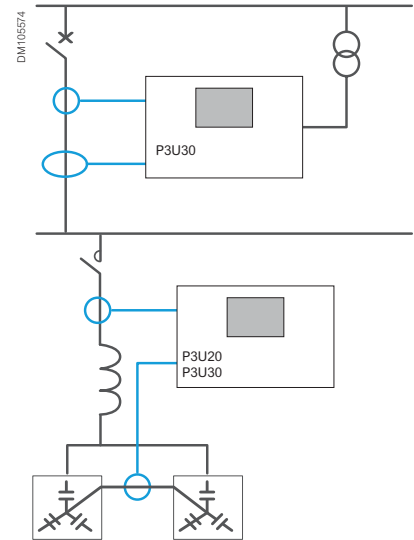

- Overvoltage
- Capacitor bank unbalance
- Capacitor overvoltage protection, based on current measurement and harmonics
- Current harmonic values and THD

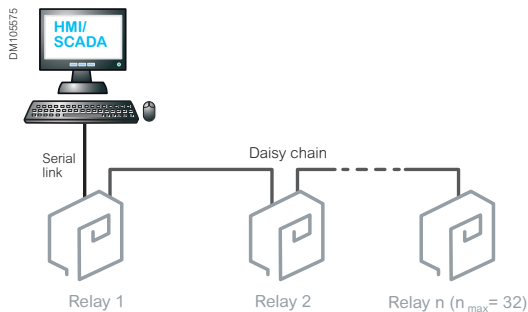

### Connection to SCADA using Serial Line


This architecture allows you to connect HMI/SCADA to a set of PowerLogic protection relays using a multi-drop serial communication link with client-server communication.

**Available protocols:**

- Modbus RTU
- IEC 60870-5-101
- IEC 60870-5-103
- DNP3
- Profibus
- SPAbus

**Time synchronization protocol:**

- IRIG-B
- Minute pulse

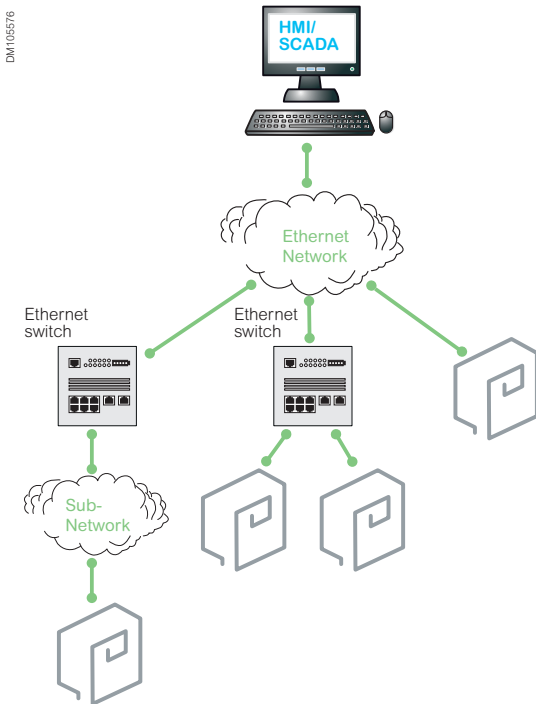

### Connection to SCADA using Ethernet

This architecture allows you to connect a set of PowerLogic protection relays directly to an Ethernet network.

**Available protocols:**

- IEC 61850
- IEC 60870-5-101
- DNP3
- Modbus
- EtherNet/IP

Note: It is possible to mix on the same Ethernet network the IEC 61850 protocol with any of the 4 other protocols.


This allows you to use the GOOSE messages between relays together with another protocol for communication to SCADA.

It is also possible to connect a PowerLogic relay to 2 different control systems, using the same Ethernet communication port and IEC 61850 protocol for one of them and any available protocol for the other one.

The PowerLogic P3 relay handles the IEC 61850 station bus, in compliance with standards IEC 61850-6, 7-1, 7-2, 7-3, 7-4 and 8-1 Ed.1 or Ed.2, according to configuration.

**Other available Ethernet protocols:**

- FTP for file transfer
- SNTP for time synchronization
- HTTP for web server

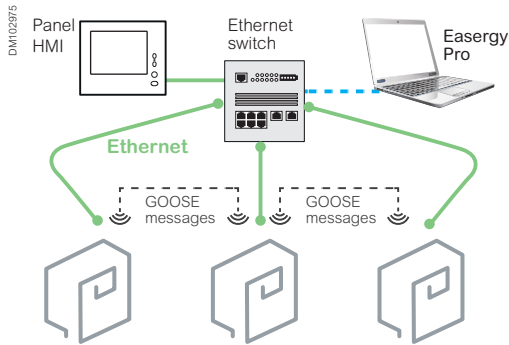


### Architecture Example 1

#### Switchboard internal network

This architecture allows fast GOOSE communication between PowerLogic protection relays of the switchboard, thus avoiding costly wiring. Typical uses are logic discrimination, load shedding, etc.

In addition, a panel HMI featuring a web browser can be used to monitor and control the entire switchboard.

A spare connection on the panel Ethernet switch can also be provided for connecting the Easergy Pro.

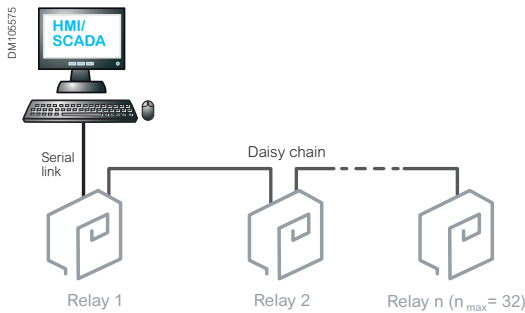


### Architecture Example 2

#### Connection to SCADA using serial lines and legacy protocols

This architecture allows you to connect HMI/SCADA to a set of PowerLogic protection relays using a multi-drop serial communication link with client-server communication protocols such as Modbus-RTU, DNP3, or IEC 61870-5-103.

The RS485 serial communication port of the PowerLogic protection relay enables simple daisy chaining wiring thanks to its 2 RJ45 connectors, suited for 2-wire or 4-wire cabling. A termination module is plugged into the last connection. As an alternative, the fiber optic serial communication port can be used.

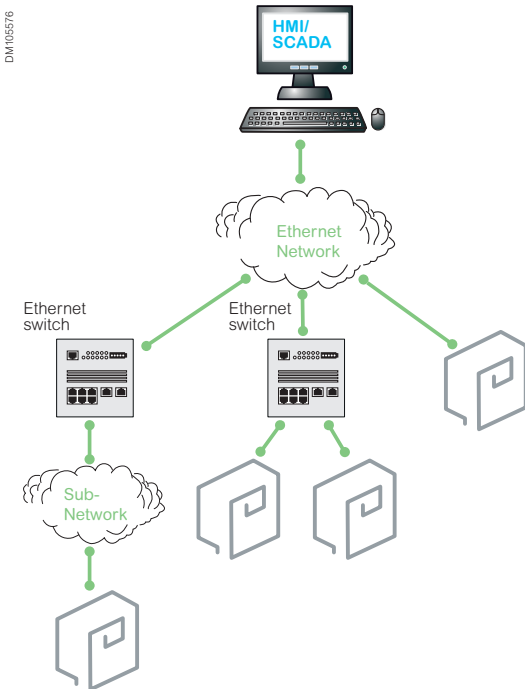

### Architecture Example 3


#### Connection to HMI/SCADA using Ethernet with redundant paths

When using an Ethernet infrastructure for the system network, redundant paths are often created. This is usually a deliberate action to improve communication availability, but can also result from non-mastered and overly complicated network architectures.

Redundant paths, however, can result in loops that are not compatible with normal Ethernet operation because they permit frames to propagate endlessly, inducing a phenomenon known as "frame storm." Using such network topologies therefore requires the use of special management techniques.



DM105577

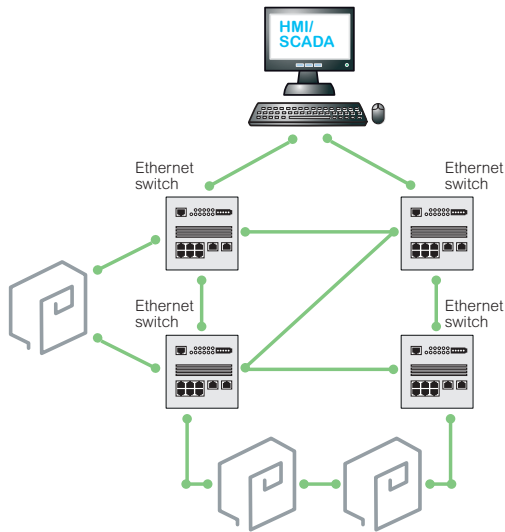


### RSTP (Rapid Spanning Tree Protocol)

The principle of RSTP is to virtually cut all links that are not necessary at a given time, changing the meshed topology into a tree topology.

The main advantage of RSTP is that it is widespread and works on any network topology. On the other hand, RSTP takes seconds to reconfigure the network in case of network interruption.

Do not connect more than 10-15 relays in one RSTP loop.

DM105578

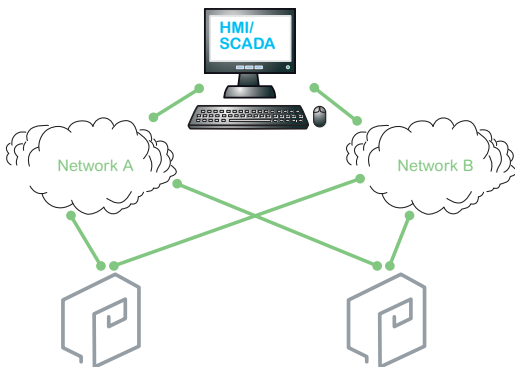

### PRP (Parallel Redundancy Protocol)

The principle of PRP is to transmit frames in parallel on two independent network infrastructures: A and B.

The receiving device is in charge of eliminating the redundant frame if it is received.

PRP features a 0 ms recovery time in case of lost or failed frame.

PRP is supported by PowerLogic P3 relays.

# Communication

Data Exchanged between  
PowerLogic™ P3 and SCADA

## Ethernet Ports

Protocol	IEC 61850	Ethernet/IP	FTP
<b>Real-time data</b>			
Measurement	•	•	-
Alarms and status	•	•	-
Controls	•	•	-
Time-stamped events	•	•	-
<b>Historical data</b>			
Disturbance records	•	-	•
<b>Setting management</b>			
Setting group change	•	•	-

## Serial Ports

Protocol	IEC 60870-5-103	Profibus	SPAbus
<b>Real time data</b>			
Measurement	•	•	•
Alarms and status	•	•	•
Controls	•	•	•
Time-stamped events	•	•	•
<b>Historical data</b>			
Disturbance records	•	-	-
Sequence of event record files	•	-	-
<b>Setting management</b>			
Setting group change	•	•	•
Settings	-	-	•

# Communication


Data Exchanged between  
PowerLogic™ P3 and SCADA

## Ethernet or Serial Ports

Protocol	DNP3	IEC 60870-5-101	Modbus
<b>Real-time data</b>			
Measurement	•	•	•
Alarms and status	•	•	•
Controls	•	•	•
Time-stamped events	•	•	•
<b>Setting management</b>			
Setting group change	•	•	•

# Communication

## Engineering System and System Configuration

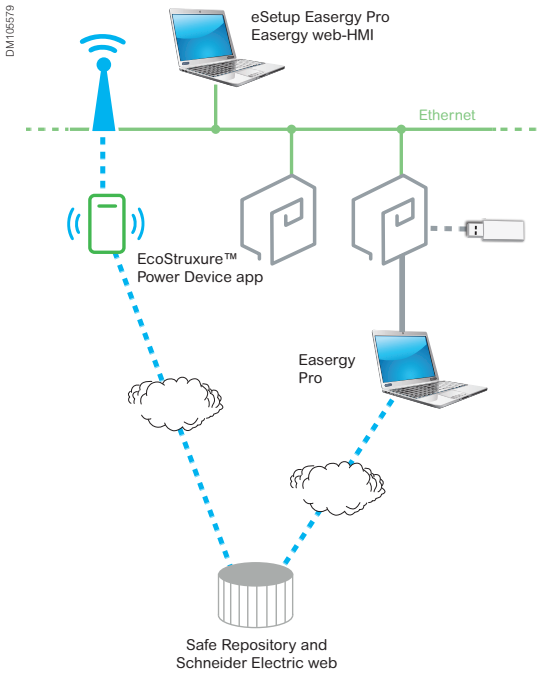

### Engineering System

#### eSetup Easergy Pro

eSetup Easergy Pro can be connected to a single PowerLogic protection relay on the front USB port or to a group of PowerLogic protection relays via Ethernet.

eSetup Easergy Set allows you to prepare the configuration of the relay without having any physical relay. For this purpose, eSetup Easergy Pro provides the latest version of the configuration description file directly from the web.

#### EcoStruxure™ Power Device app

EcoStruxure™ Power Device app can be connected to the PowerLogic protection relays using a Wi-Fi router.


EcoStruxure™ Power Device app is also connected to the safe repository, allowing you to access to documents and store files downloaded from the relay.

#### PowerLogic web-HMI

In addition to eSetup Easergy Pro, most of the resources of the relay can be accessed with a standard web browser, using the web pages embedded into the relay.

### System Configuration according to IEC 61850

The methodology described in IEC 61850-6 standard can be applied with PowerLogic protection relays to build a protection and control system based on this standard.

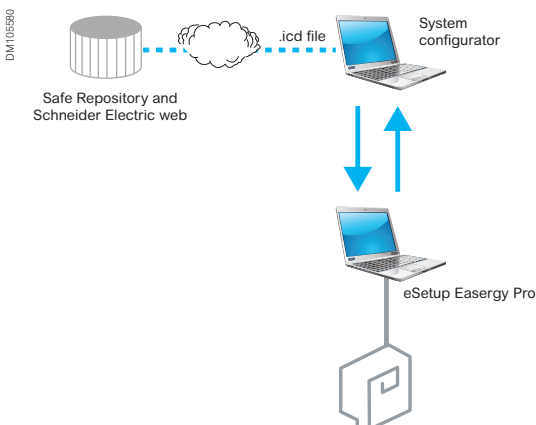

#### .icd file

When the configuration of an PowerLogic protection relay is done, setting tool can generate IED capability file. This file can be used by the system configurator.

Note: Configure maximum 2 clients for the IEC 61850 application.

# Communication

## Arc Flash Protection System by Network Communication


### Arc Flash Protection System: Application Example

In this application example, the arc flash sensor for zone 4.1 is connected to Device 1. If the arc flash sensor awakens and simultaneously Device 3 sends a current signal, the zone 4.1 is isolated by the outgoing feeder breaker.

The arc flash sensor for zone 4.2 is connected to Device 2 and operates the same way.

The arc flash sensors for zone 3 are connected to Device 1, 2, or 3. If a sensor awakens in zone 3, the light-only signal is transferred to Device 3, which then trips the main circuit breaker.


An eventual arc flash fault in zone 1 or 2 does not necessarily activate the current element in Device 2. However, arc detection can be achieved by using the light-only principle. If an arc flash occurs in cable termination, zone 1, or zone 2, the fault is cleared by the upstream circuit breaker.

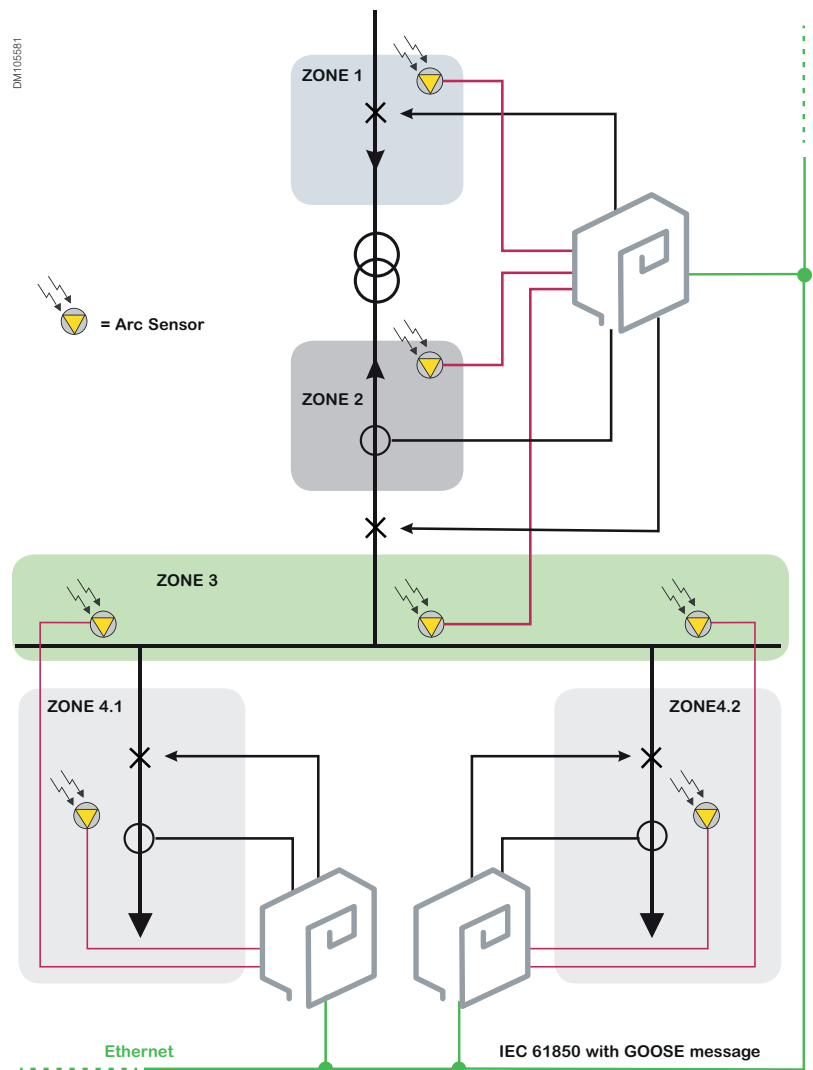

# Application

## Arc Flash Detection Application

### Arc Flash Detection Application Example IEC

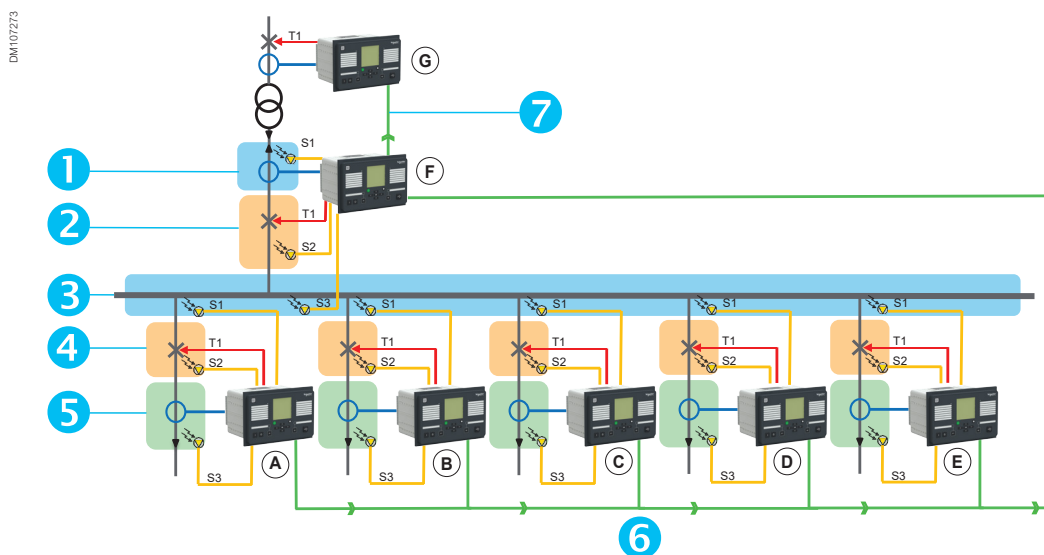

- 1 Incomer cable zone
- 2 Incomer circuit breaker zone
- 3 Busbar zone
- 4 Feeder circuit breaker zone
- 5 Feeder cable zone
- 6 Light information via BIO L> (feeder cable and circuit breaker)
- 7 Light information via BIO L> (incomer busbar and circuit breaker)

In this application example, the arc flash sensor for zone 5 is connected to device A. If the sensor detects a fault and simultaneously, device A detects an overcurrent signal, zone 5 is isolated by the outgoing feeder breaker.


The arc flash sensor for the second feeder zone 5 is connected to device B, and it operates the same way. The arc flash sensors for zones 3 and 4 are connected to device A, B, C, D, E and F. If a sensor detects a fault in zone 3 or 4, the light-only signal is transferred to device F which also detects the overcurrent and then trips the main circuit breaker.

An arc flash fault in zone 1 or 2 does not necessarily activate the current detection in device F. However, arc flash detection can be achieved by using the light-only principle, or alternatively, the light detection signal can be transferred to device G. If an arc flash occurs in the cable termination or incomer circuit breaker in zone 1 or 2, the fault is cleared by an overcurrent signal.

# Application

## Arc Flash Detection Application

### Arc Flash Detection Application Example IEC with Fiber

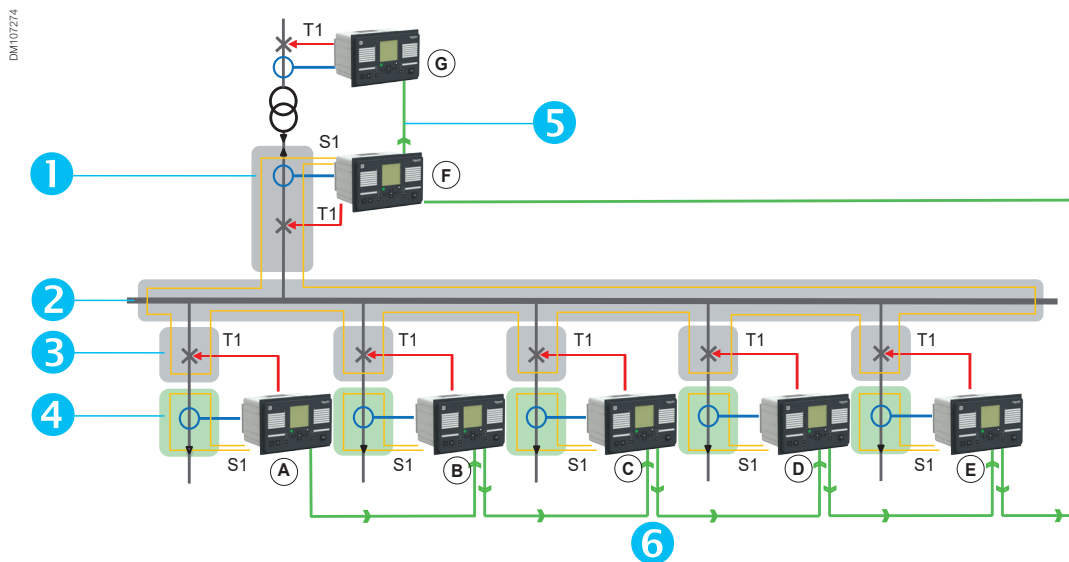


- 1 Incomer cable zone
- 2 Busbar zone
- 3 Feeder circuit breaker zone
- 4 Feeder cable zone
- 5 Light information via BIO L+ (incomer busbar and circuit breaker)
- 6 Light information via BIO L+ (feeder cable and circuit breaker)

The fiber-loop arc flash sensor for zone 5 is connected to device A. If the sensor detects a fault and simultaneously, device A detects an overcurrent signal, zone 5 is isolated by the outgoing feeder breaker.

For the other feeders, the fiber-loop arc flash sensors monitoring zone 5 are connected to the appropriate feeder relays and they operate the same way as feeder A.

The fiber loop arc flash sensors for zones 3, 2 and 1 are connected to device F. If a sensor detects a fault in zones 3, 2 or 1 and simultaneously, device F detects an overcurrent signal, the fault is cleared by the incoming breaker operation.

Device G measures the overcurrent and receives light detection signals from zones 1, 2, and 5. It trips the substation if device F is unable to measure the overcurrent.

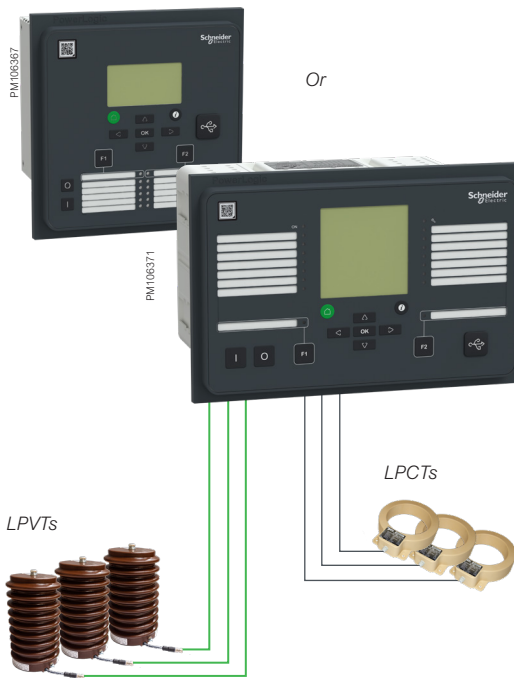

LPCT and LPVT connection to PowerLogic P3U30, P3F30 and P3M30 protection relays

## Compatibility with Low Power Sensors LPCT/LPVT...

PowerLogic P3 relays can be ordered with either a conventional CT/VT measuring module or with a low-power CT/VT measuring module, compatible with low-power sensors compliant to IEC 61869-10 and IEC 61869-11 standards.

PowerLogic P3 protection relays can work with both resistive divider and capacitive divider LPVTs.

**Low Power Current Transformer (LPCT)** is a magnetic sensor with integrated shunt providing a voltage output (mV) which represents the primary current (A). LPCTs provide a low voltage output signal compatible with PowerLogic P3 protection relays.

**Low Power Voltage Transformer (LPVT)** is a voltage sensor based on resistor dividers for digital protection and measuring devices. LPVTs provide a low voltage output signal compatible with PowerLogic P3 protection relays.

The LPCT/LPVT compatibility of PowerLogic P3 allows users to move from conventional instrument transformers to better low power sensors technology which brings a variety of benefits at every stage of the project and throughout the whole life cycle of your installation.

## ...for more reliability...

Low power sensors are free of ferroresonance and represent high accuracy up to short circuit levels.

They can be used in protection and measurement purposes with very wide operating range. This technology ensures easier maintenance thanks to very low voltage values present on the secondary side.

## ... and simplicity

Solutions bring significant simplification during project execution stage.

Simpler engineering (no CT sizing), procurement, stocking (very less variants) and installation ensures high effectiveness and improves the project delivery time.



LPCT TLP130 - 0,72 kV insulation



LPVT GIS type C - 24 kV insulation



Notes

---

# PowerLogic™ P3 Standard

# PowerLogic™ P3 Standard

<b>Presentation</b>	<b>34</b>
<b>Functional View</b>	<b>36</b>
<b>Base Unit Presentation</b>	<b>38</b>
Local HMI	38
Rear Panel Connections	39
<b>Base Unit Dimensions</b>	<b>40</b>
Cut-Out and Mounting	40
<b>Base Unit Characteristics</b>	<b>41</b>
Technical Characteristics	41
Environmental Characteristics	42
<b>Communication Protocols</b>	<b>44</b>
<b>Programmable Stages</b>	<b>45</b>
<b>Circuit Breaker Control</b>	<b>46</b>
<b>Connection Diagram</b>	<b>47</b>
<b>Model Selection</b>	<b>50</b>

The PowerLogic P3 Standard protection relay has been developed to meet your standard protection needs for building, distribution utilities, and industrial applications. Thanks to its optimized and flexible design, the PowerLogic P3 Standard provides an excellent solution for various protection applications.

The user-friendly PowerLogic P3 Standard brings greater efficiency to your operations by enabling rapid ordering, configuration, and operations for an unparalleled digital experience

## PowerLogic P3 Standard at a Glance

### Universal

- All-in-one box with feeder, transformer, and motor protections
- All communication protocols embedded on serial and Ethernet links including IEC 61850 ed.1 and ed. 2

### Robust

- Best-in class reliability based on 100+ years of experience in Sepam, MiCOM and Vamp relays
- Strong tests performed in international laboratories
- Compliant to IEC electro-mechanical standards
- Designed for demanding industrial conditions with conformal-coated printed circuit boards


### Efficient and connected

- Easy to order with 10 standard configurations delivered off the shelf in less than 7 days (location dependent)
- Easy to configure with the unique eSetup Easergy Pro setting software
- Easy to test with the virtual simulation test for direct injection of current and voltage from eSetup Easergy Pro
- Easy to install with withdrawable rear connectors with CT shortening
- Easy to use and maintain with the embedded web-HMI and EcoStruxure™ Power Device app for direct access on site via your laptop, smartphone, or tablet.

PM106572



PowerLogic P3 is designed to cover all the standard applications with only one device: the Universal Protection.

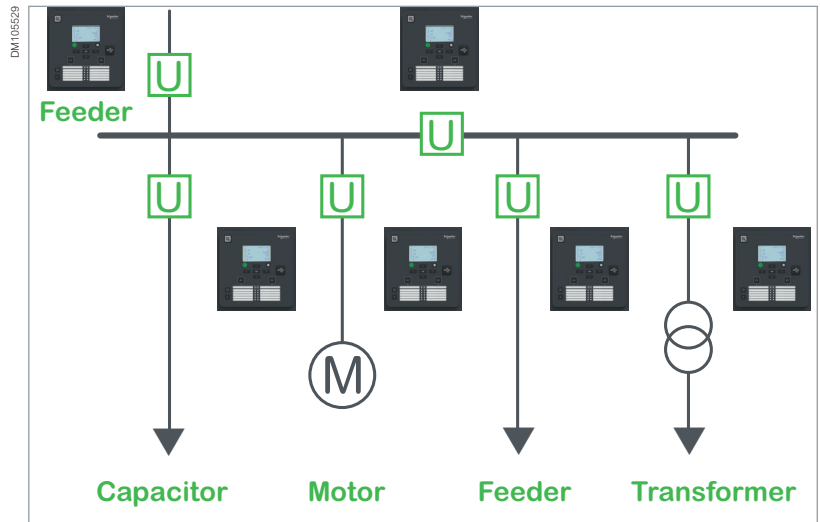


PowerLogic P3 Standard is available in **2 models**:

Model	Communication	Main advantages
<b>PowerLogic P3U20</b> <ul style="list-style-type: none"> <li>• 4 CT/1VT</li> <li>• 10 DI/5 DO/WD</li> <li>• 8 DI/8 DO/WD</li> </ul>	Open communication protocols on serial or Ethernet links, with IEC 61850	<b>Openness to IEC 61850</b> , while keeping the core functionalities of PowerLogic P3 Standard relay
<b>PowerLogic P3U30</b> <ul style="list-style-type: none"> <li>• 4 CT/4VT</li> <li>• 16 DI/8 DO/WD</li> <li>• 14 DI/11 DO/WD</li> </ul>	Open communication protocols on serial or Ethernet links, with IEC 61850	<b>Wide scope of possibilities</b> , with the directional protection, synchro-check, fault location, and increased number of input and outputs


**A common set of functions** extends the possibilities of protection and control:


- Single-line diagrams (mimic) in the display
- Programmable protection stages
- Programmable logics
- 2 programmable function keys
- Synchro-check function
- Direct-access USB port
- Up to 6 objects controlled

DM105584

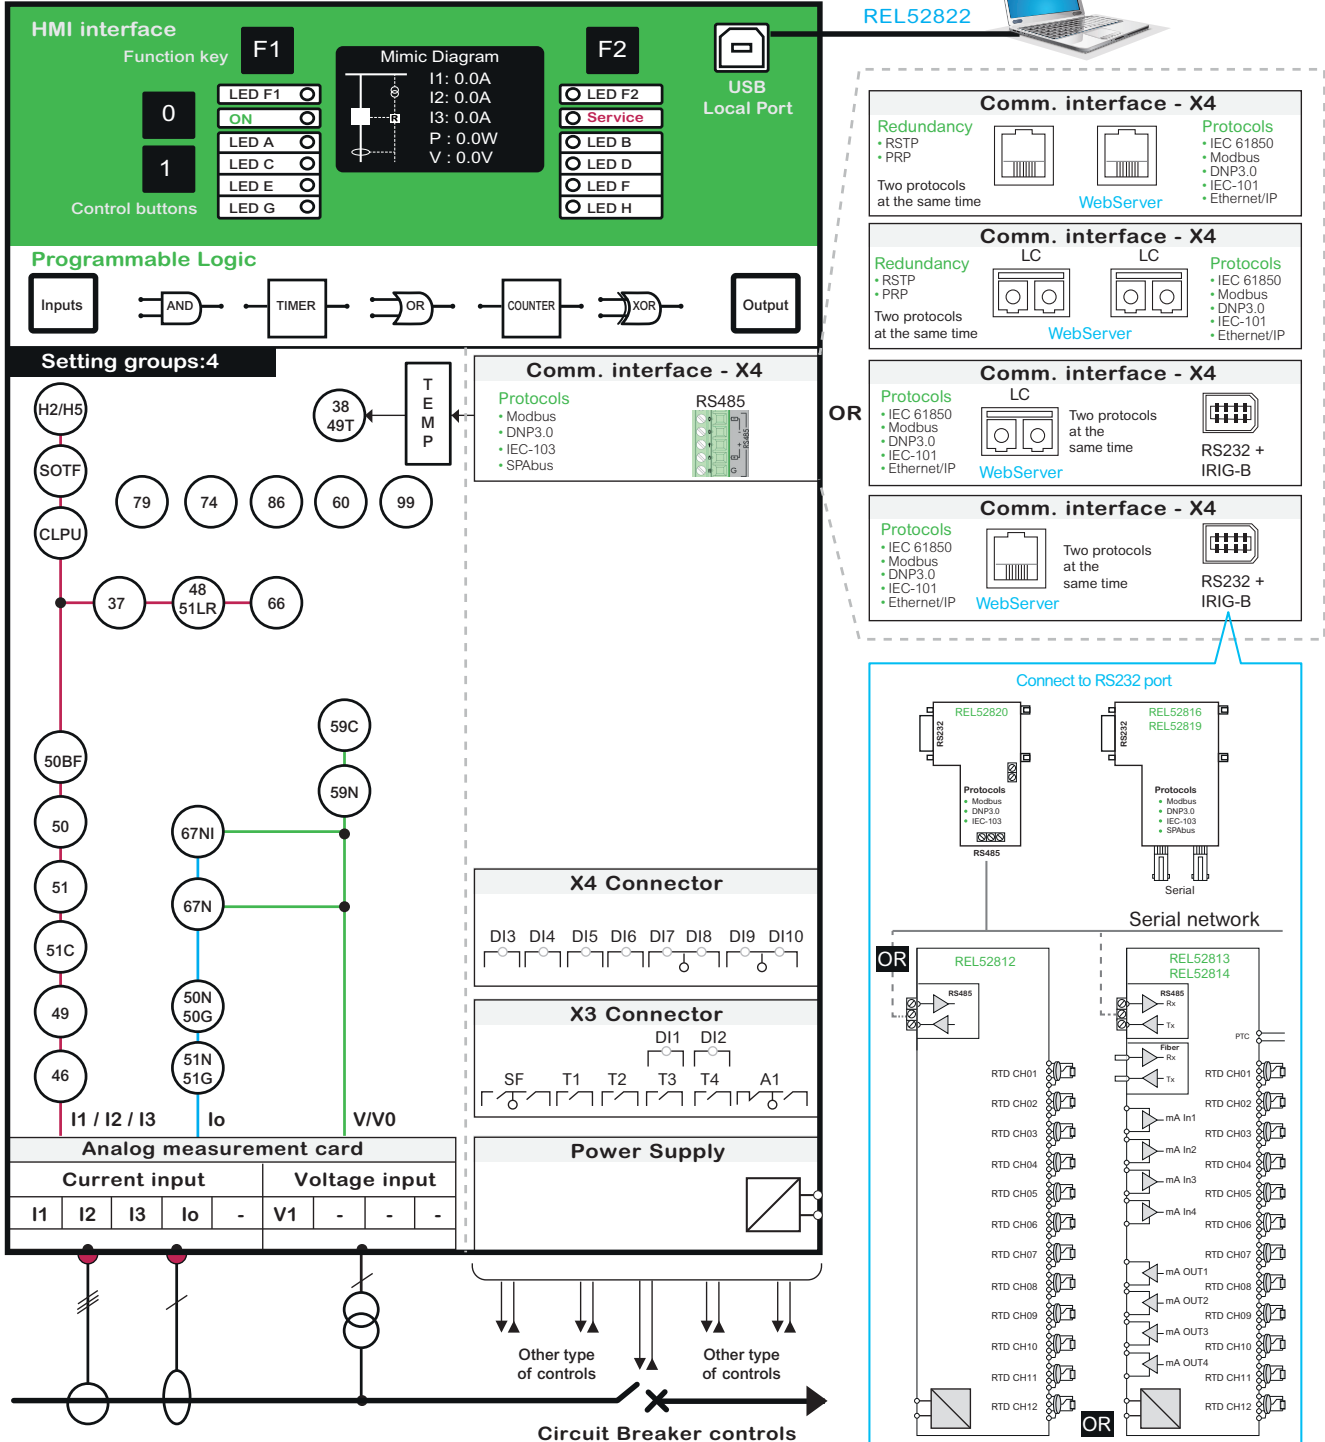

DM105585

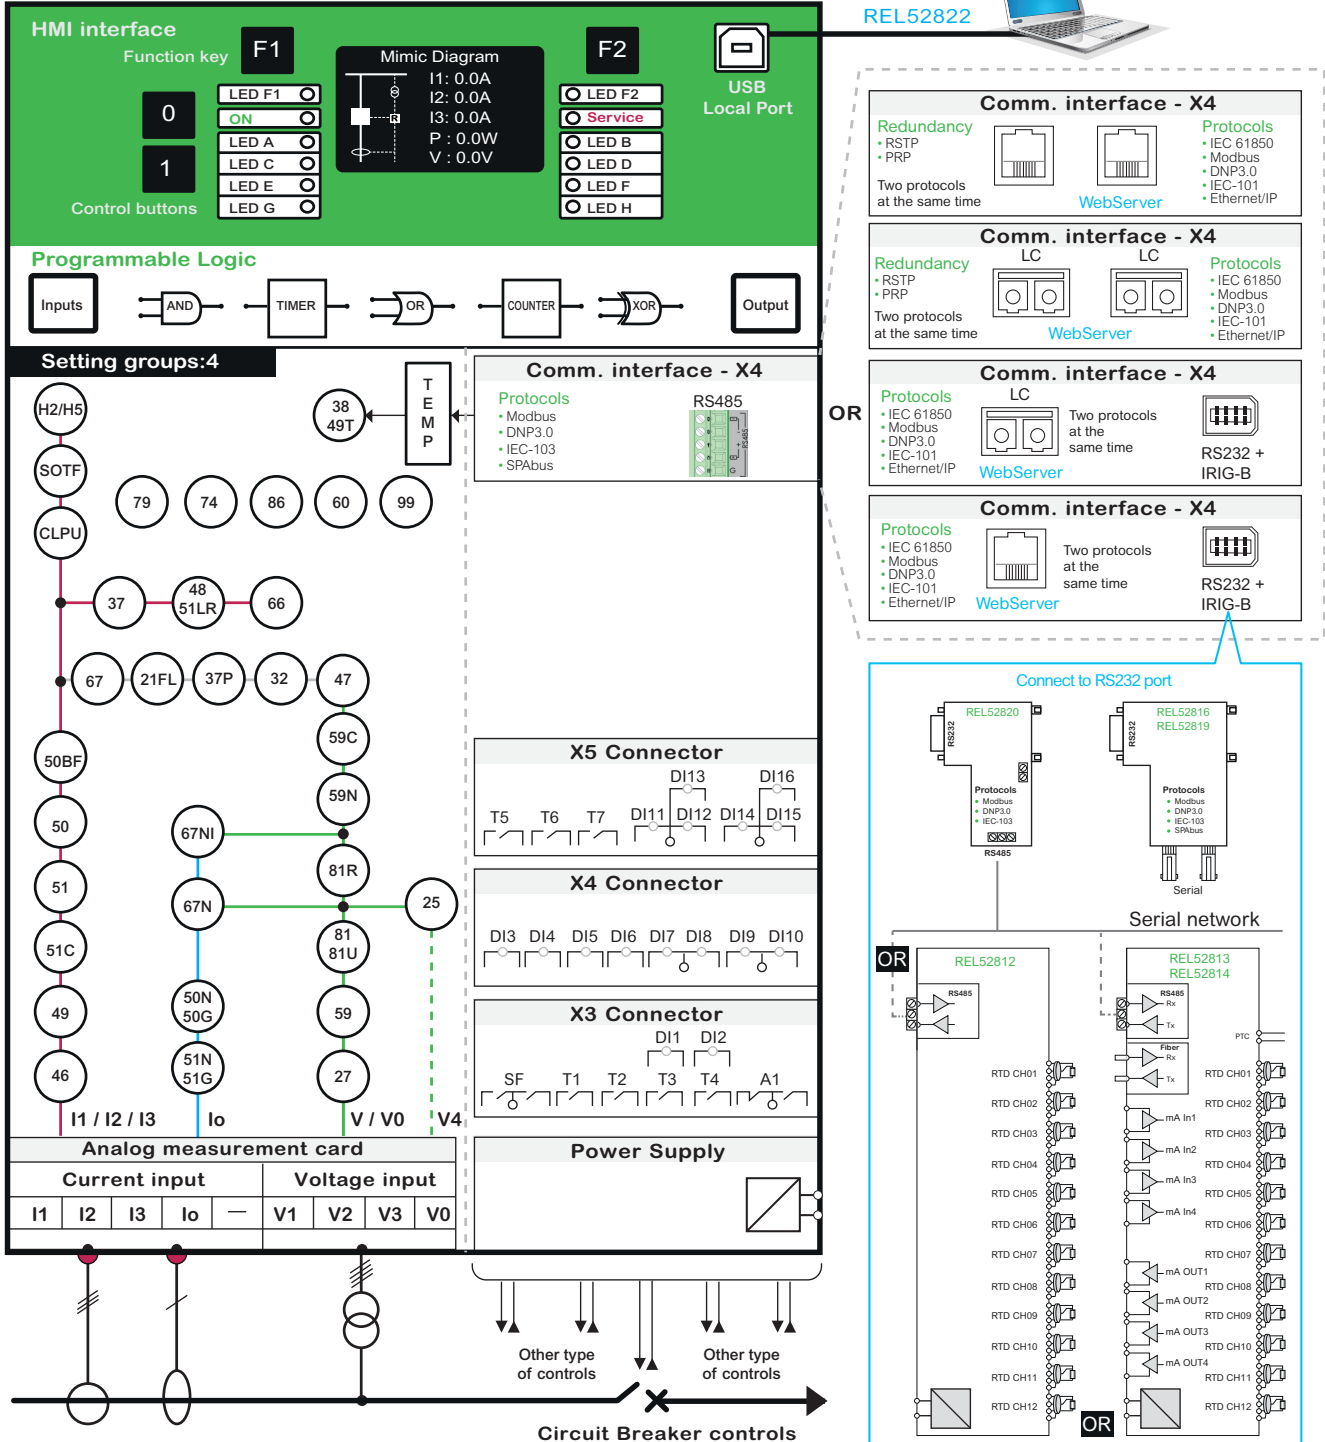

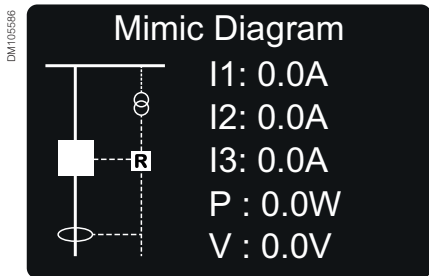

Single-line diagram of the power system

## Comprehensive Data for Fast and Easier Operation

All the data required for a local equipment operation may be displayed on demand:


- Display the single-line diagram and freely assignable analog values
- Display of all measurements
- Display of operation and alarm messages
- Display and setting of all parameters
- Entry of password to protect parameter and protection settings

## Ergonomic Data Presentation

- Keypad keys identified by pictograms for intuitive navigation
- Graphical 128x64 LCD screen to display any character or symbol
- Excellent display quality under all lighting conditions
- Control buttons (0/1) to operate the circuit breaker and/or other controlled object
- 8 freely programmable LEDs to identify easily the message showed
- Labels are printed on a transparent film allowing customization of the relay
- Programmable function key (F1/F2)

### Front Panel: Control and Push-Buttons

- INFO push-button for viewing additional information, entering the password view, and adjusting the LCD contrast
- F1** Programmable function push-button
- F2** Programmable function push-button
- OK** ENTER push-button for activating or confirming a function
- UP navigation push-button for moving up in the menu or increasing a numerical value
- DOWN navigation push-button for moving down in the menu or decreasing a numerical value
- LEFT navigation push-button for moving backwards in a parallel menu or selecting a digit in a numerical value
- RIGHT navigation push-button for moving forwards in a parallel menu or selecting a digit in a numerical value
- Circuit breaker OFF push-button
- Circuit breaker ON push-button
- HOME/CANCEL push-button for returning to the previous menu. To return to the first menu item in the main menu, press the button for at least three seconds

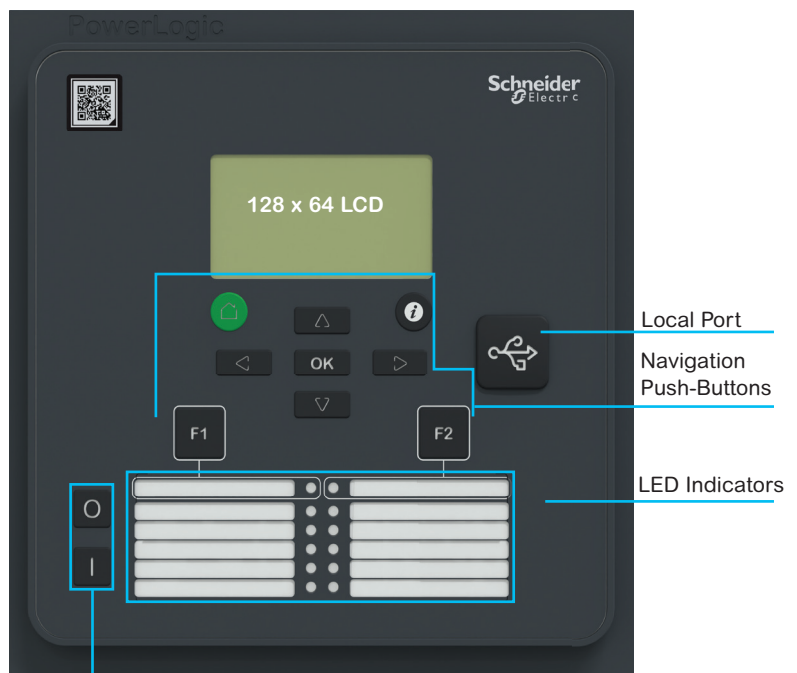


Object Control Buttons

## Working Language


All the texts and messages displayed on the PowerLogic P3U are available in two languages at the same time. Consult us for availability.



### Rear Panels Views

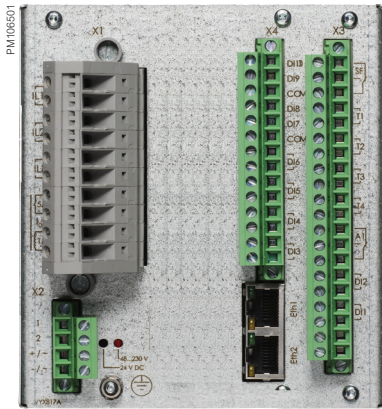


PowerLogic™ P3U20

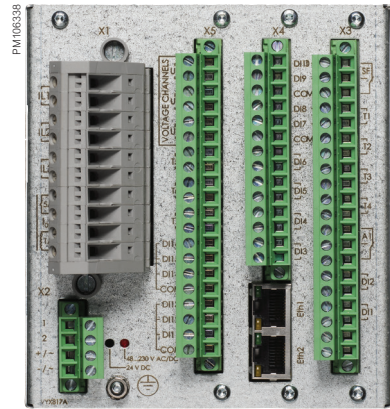


PowerLogic™ P3U30


### Withdrawable Connectors

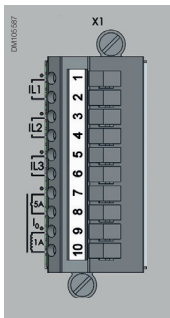

Optional terminal X1:  
Pluggable screw  
clamp connector

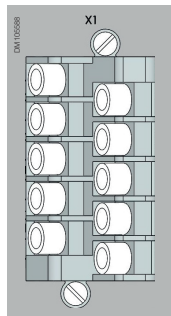


Optional terminal X1:  
Pluggable ring-lug connector

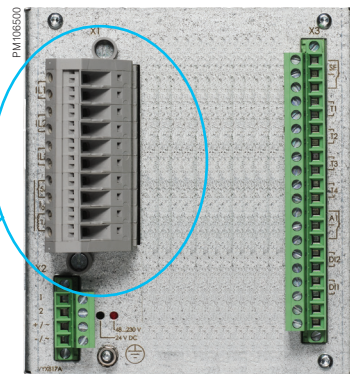

## Cut-Out and Mounting


Cut-out accuracy must be complied with to ensure good withstand.

Weight (Maximum)	
PowerLogic P3U20/P3U30	2.5 Kg (5.519 lb)
Degree of Protection (IEC 60529)	
IP54 Front Panel/IP20 Rear Side	

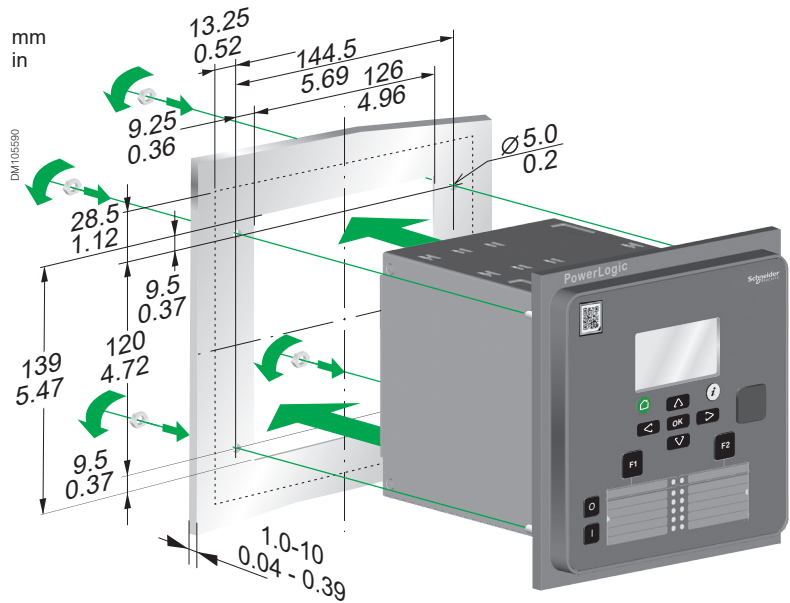


### Panel Mounting

	A	B
With screw connector	214 mm/8.43 in	192 mm/7.6 in
With ring-lug connector	226 mm/8.90 in	204 mm/8.0 in

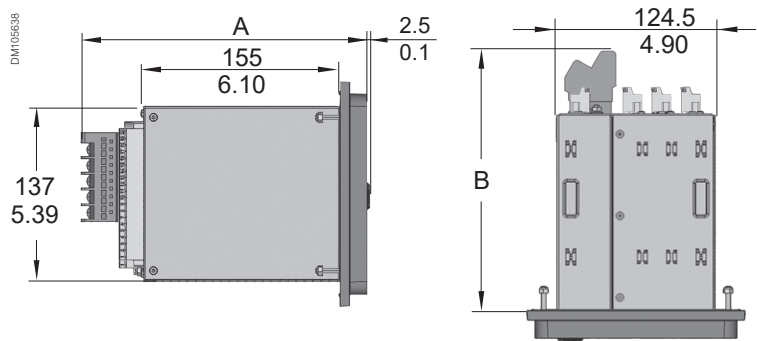

### Projection Mounting with the Raising Frame REL52834

	A	B
With screw connector	214 mm/8.43 in	147 mm/5.8 in
With ring-lug connector	226 mm/8.90 in	159 mm/6.2 in

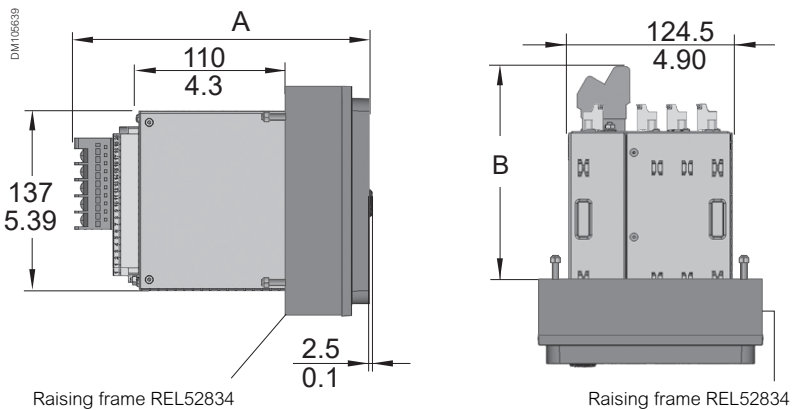

Raising frame  
Ref: VYX860-  
REL52834



## Analog inputs

	Setting range	Measuring range	Input Impedance	Consumption	Rated thermal withstand	1-second overload	10-second overload
Phase Current Input 5 A CT Configurable for CT secondaries 1 to 10 A	$I_N = 5 \text{ A}$ or 1 A Overcurrent: 0.05 - 40 x $I_N$	0.05...250 A	0.003 Ohm	0.075 VA	20 A (Continuously)	500 A	100 A
Residual Current Input (IO) 5 A CT Configurable for CT secondaries 0.1 to 10 A	$I_N = 5 \text{ A}$ or 1 A Residual current: 0.005 - 20 x $I_N$	0.015...50 A	0.003 Ohm	0.075 VA	20 A (Continuously)	500 A	100 A
Residual Current Input (IO) 1 A CT Configurable for CT secondaries 0.1 to 10.0 A	$I_{0N} = 1 \text{ A}$ Residual current: 0.005 - 20 x $I_N$	0.003...10 A	0.02 Ohm	0.02 VA	4 A (Continuously)	100 A	20 A
Residual Current Input (IO) 0.2 A Configurable for CT secondaries 0.1 to 10.0 A	$I_{0N} = 0.2 \text{ A}$ Residual current: 0.005 - 20 x $I_N$	0.0006...2 A	0.02 Ohm	0.02 VA	0.8 A (Continuously)	20 A	4 A
Residual Current Input (IO) CSH 2 A/20 A (using 470/1 sensor)	$I_{0N} = 2$ or 20 A Residual current: 0.050-8 $I_{0N}$	0.02 - 42 x $I_N$	0.02 Ohm	n.a.	1.8 A rms (Continuously)	40 A rms	n.a.
Voltage Input Configurable for VT secondaries 50 to 120 V	$U_N = 100$ or 110 V Overvoltage: 50 - 160% x $U_N$	0.5...190 V (100 V/110 V)	n.a.	< 0.015 VA	250 V (Continuously)	n.a.	600 V

## Analog temperature input and Analog output

Type of temperature sensor	Pt100	Ni100	Ni120	Cu10
Maximum distance between sensor and module	up to 2,000 m <sup>(1)</sup>	up to 2,000 m <sup>(1)</sup>	up to 2,000 m <sup>(1)</sup>	up to 2,000 m <sup>(1)</sup>
Analog Output	0 mA			
Minimum current	20 mA			
Maximum current	20 mA			
Operating temperature:	0 °C (32 °F)...+55 °C (131 °F)			
Power supply	REL52811/REL52812	24...230 Vac/dc, 50/60 Hz		
	REL52813	24 Vdc		
	REL52814	48...230 Vac/dc, 50/60 Hz		

## Digital Input

	DI1 to DI16	24...230 Vac/dc	110...230 Vac/dc	220...230 Vac/dc
Nominal operation voltage				
Typical switching threshold		12 Vdc	75 Vdc	155 Vdc
Input limit voltage	At state 1	≥19.2 Vdc	≥88 Vdc	≥176 Vdc
	At state 0	<10.0 Vdc	<60 Vdc	<140 Vdc
Frequency		45...65 Hz	45...65 Hz	45...65 Hz
Typical consumption		<4 mA (typical approx. 3 mA)		
Voltage withstand		255 Vac/dc		

## Digital Output

Type of contact	Control and Trip contact, Tx	Signal contact, A1	Signal Contact, SF
Rated Voltage	250 Vac/dc	250 Vac/dc	250 Vac/dc
Continuous current	5 A	5 A	5 A
AC	2.000 VA	2.000 VA	2.000 VA
Breaking capacity	at 48 Vdc	1.15 A	1 A
	at 110 Vdc	0.5 A	0.3 A
	at 220 Vdc	0.25 A	0.15 A
DC (L/R=40ms)			
Making capacity	≤0.5 s	30 A	30 A
	≤3.0 s	15 A	15 A
Minimum making capacity		100 mA @ 24 Vac/dc	100 mA @ 24 Vac/dc
Typical operation time		<8 ms	-
Contact material		AgNi 90/10	AgNi 0.15 gold plated
			AgNi 0.15

## Power supply

Nominal Voltage	48...230 Vac/dc	24...48 Vdc <sup>(2)</sup>
Range	-20%/+10% (38.4...253 Vac/dc)	±20% (19.2...57.6 Vdc) <sup>(2)</sup>
Inrush current (DC)	25 A with time constant of 1000 μs	
	25 A with time constant of 750 μs	
	15 A with time constant of 500 μs	
Power consumption	Normal conditions	<15 W (<30 VA)
	Output relays activated	<25 W (<50 VA)
Acceptable momentary outages	<50 ms (110 Vdc)	

(1) 78,750 in

(2) Check the available power supply range from the device's serial number label

## Electromagnetic Compatibility

	Standard and test class/level	Test value
<b>Emission tests</b>		
IEC/EN 60255-26 (ed3)		
Conducted	EN 55022, Class A / CISPR 22	0.15...30 MHz
Emitted (P3Ux)	EN 55011, Class A/CISPR 11	30...1000 MHz
Emitted (P3x3x)	Class A/CISPR 11/IACS E10	150 kHz...6 GHz
<b>Immunity</b>		
IEC/EN 60255-26 (ed3)		
Slow damped oscillatory wave 1 MHz	IEC/EN 61000-4-18	±2.5kVp CM ±2.5kVp DM
Fast damped oscillatory wave 3 MHz, 10 MHz and 30 MHz	IEC/EN 61000-4-18	±2.5kVp CM
Static discharge (ESD)	IEC/EN 61000-4-2 Level 4	±8 kV contact ±15 kV air
Emitted HF field (P3Ux)	IEC/EN 61000-4-3 Level 3 IEEE C37.90.2	80...2700 MHz, 10 V/m 80...1000 MHz, 20 V/m
Emitted HF field (P3x3x)	IEC/EN 61000-4-3 Level 3 IEEE C37.90.2 / IACS E10	80 MHz...6 GHz, 10 V/m 80...1000 MHz, 20 V/m
Fast transients (EFT)	IEC/EN 61000-4-4 Level 4	±4 kV, 5/50 ns, 5 kHz
Surge	IEC/EN 61000-4-5 Level 3	±4 kV, 1.2/50 µs, CM ±2 kV, 1.2/50 µs, DM
Conducted HF field	IEC/EN 61000-4-6 Level 3	0.15...80 MHz, 10 Vrms
Power-frequency magnetic field	IEC/EN 61000-4-8	300 A/m (continuous) 1000 A/m 1–3 s
Pulse magnetic field	IEC/EN 61000-4-9 Level 5	1000 A/m, 1.2/50 µs
ac and dc voltage dips	IEC/EN 61000-4-29, IEC/EN 61000-4-11	0% of rated voltage • ac: ≥ 0.5 cycle • dc: ≥ 10 ms 40% of rated voltage • ac: 10 cycles • dc: 200 ms 70% of rated voltage • ac: 25 cycles • dc: 500 ms
ac and dc voltage interruptions	IEC/EN 61000-4-29, IEC/EN 61000-4-11	100% interruption • ac: 250 cycles • dc: 5 s
Voltage alternative component	IEC/EN 61000-4-17	15% of operating voltage (dc)/10 min

## Mechanical Robustness

	Standard and test class/level	Test value
<b>In operation</b>		
Vibrations	IEC 60255-21-1, Class II/IEC 60068-2-6, Fc	1 Gn, 10...150 Hz
Shocks	IEC 60255-21-2, Class II/IEC 60068-2-27, Ea	10 Gn/11 ms
Seismic	IEC 60255-21-3 Method A, Class II	2G horizontal/1G vertical, 1...35 Hz
<b>De-energized</b>		
Vibrations	IEC 60255-21-1, Class II/IEC 60068-2-6, Fc	2 Gn, 10...150 Hz
Shocks	IEC 60255-21-2, Class II/IEC 60068-2-27, Ea	30 Gn/11 ms
Bump	IEC 60255-21-2, Class II/IEC 60068-2-27, Ea	20 Gn/16 ms

## Environment Tests

	Standard and test class/level	Test value
<b>In operation</b>		
Dry heat	EN/IEC 60068-2-2, Bd	70 °C (158 °F)
Cold	EN/IEC 60068-2-1, Ad	-40 °C (-40 °F)
Damp heat, cyclic	EN/IEC 60068-2-30, Db	From 25 °C (77 °F)...55 °C (131 °F) From 93% RH to 98% RH Testing duration: 6 days
Damp heat, static	EN/IEC 60068-2-78, Cab	40 °C (104 °F) 93% RH Testing duration: 10 days
Change of temperature	IEC/EN 60068-2-14, Nb	Lower temp -40 °C (-40 °F) Upper temp 70 °C (158 °F) 5 cycles
Flowing mixed gas corrosion test, method 1	IEC 60068-2-60, Ke	25 °C (77 °F), 75% RH, 21 days 100 ppb H <sub>2</sub> S, 500 ppb SO <sub>2</sub>
Flowing mixed gas corrosion test, method 4	IEC 60068-2-60, Ke	25 °C (77 °F), 75% RH, 21 days 10 ppb H <sub>2</sub> S, 200 ppb NO <sub>2</sub> , 10 ppb CL <sub>2</sub> , 200 ppb SO <sub>2</sub>
<b>In storage</b>		
Dry heat	EN/IEC 60068-2-2, Bb	70 °C (158 °F)
Cold	EN/IEC 60068-2-1, Ab	-40 °C (-40 °F)

## Environmental Conditions

Ambient temperature, in-service	-40...60 °C (-40...140 °F)
Ambient temperature, storage	-40...70 °C (-40...158 °F)
Relative air humidity	< 95%, no condensation allowed
Maximum operating altitude	2000 m (6561.68 ft)

## Safety

	Standard and test class/level	Test value
<b>Electrical safety tests</b>		
Impulse voltage withstand	IEC/EN 60255-27	5 kV, 1.2/50 μs, 0.5 J 1 kV, 1.2/50 μs, 0.5 J Communication
Dielectric test	IEC/EN 60255-27	2 kV, 50 Hz 0.5 kV, 50 Hz Communication
Insulation resistance	IEC/EN 60255-27	
Protective bonding resistance	IEC/EN 60255-27	
Clearance and creepage distance	Design criteria for distances as per IEC 60255-27 Annex C (pollution degree 2, overvoltage category 3)	
Power supply burden	IEC 60255-1	

PowerLogic™ P3 Standard can be connected to networks, thus providing access to the following type of data:

- Events
- Status information
- Measurements
- Control commands
- Clock synchronizing
- Settings (SPA-bus and embedded SPA-bus only)



EcoStruxure™ Power Device app.

## Main Protocols

PowerLogic P3 Standard can be connected directly to serial and/or Ethernet protocols with two different protocols at the same time, selected by eSetup Easergy Pro software.

Communication protocols:

### Serial protocols - RS232 / RS485 / serial Fiber Optic (\*) port

Modbus RTU

DNP3.0

IEC 60870-5-101

IEC 60870-5-103

ProfibusDP (\*)

SPA-Bus (\*)

### Ethernet protocols - RJ45 / LC port

IEC61850 ed1 & ed2


Modbus TCP

DNP3.0


IEC60870-5-101  
IEC60870-5-104

Ethernet IP

Communication ports:

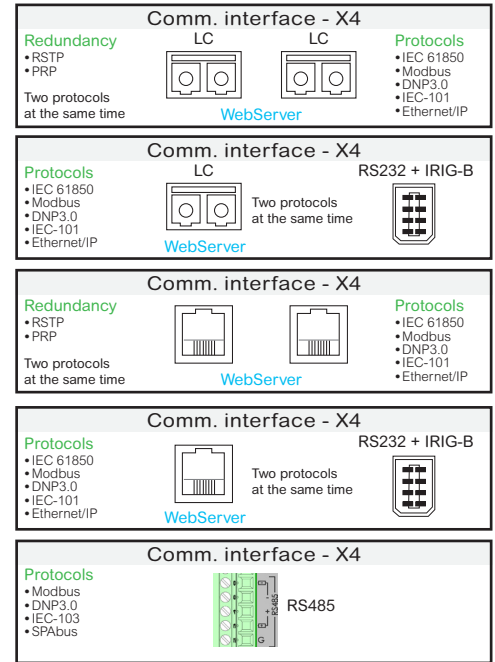

\*Need external accessories to connect.

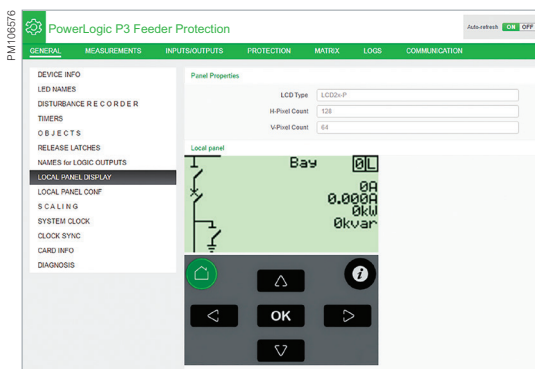

PowerLogic web-HMI

## Redundancy Protocols (RSTP or PRP)

When the devices are connecting in Ethernet link and demand for higher availability, PowerLogic P3 Standard can use Rapid Spanning Tree Protocol (RSTP) or Parallel Redundancy Protocol (PRP) to recover from a network failure.

## PowerLogic P3 Web-HMI

A webserver is available in PowerLogic P3 Standard to get information from the device to monitor all data, send commands, and change protection settings.

# Programmable Stages


## Programmable Protection Function

### Personalize your Protection Function

PowerLogic P3 Standard allows you to create or personalize the protection function when you need to achieve specific levels of protection.

There are now eight stages available to use with various applications. Each stage can monitor any analog (measured or calculated) signal and issue start and trip signals. Programmable stages extend the protection functionality of the manager series to a new level. The Programmable stage has the possibility of comparing two freely selectable signals between each other. Using this feature you can create a comparison function using the relay's own measured or calculated signals. One or both of the signals can be connected to the comparison function over GOOSE.

For example, if four stages of frequency are not enough, it is possible to reach a maximum of 12 using programmable stages. Other examples include using the stages to issue an alarm when there are too many harmonics (THD) or indicating reverse power condition by GOOSE.

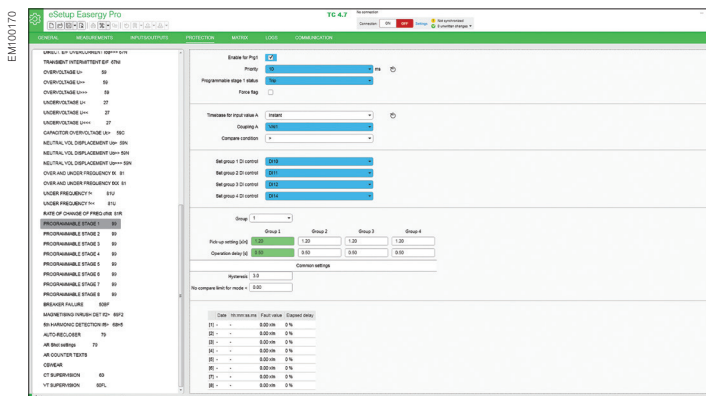



With PowerLogic™ P3 Standard, you get intuitive functionality to protect your electrical network system.

Main CB functions are:

- Trip circuit supervision (ANSI 74)
- CT/VT supervision (ANSI 60/60FL)
- Latching (ANSI 86)
- CB close/open order
- Number of operations
- Cumulative breaking current
- Personalized functions

## Maximize Circuit Breaker Control


PowerLogic P3 Standard is a simple protection relay with a single-line diagram with control buttons (open and close), two personalized function keys, and eight configurable single-color LEDs in P3 Standard and fourteen tricolor LEDs in P3 advanced.

You can manage the control without external or additional component.

### Example of implementation

The schematic is structured for typical use in MV switchgears, 100% adapted for your use case. You are free to change the internal logic to adapt the PowerLogic P3 Standard to follow your needs.

If a problem occurs, clear and concise information allows users to make the right decisions at the right time.

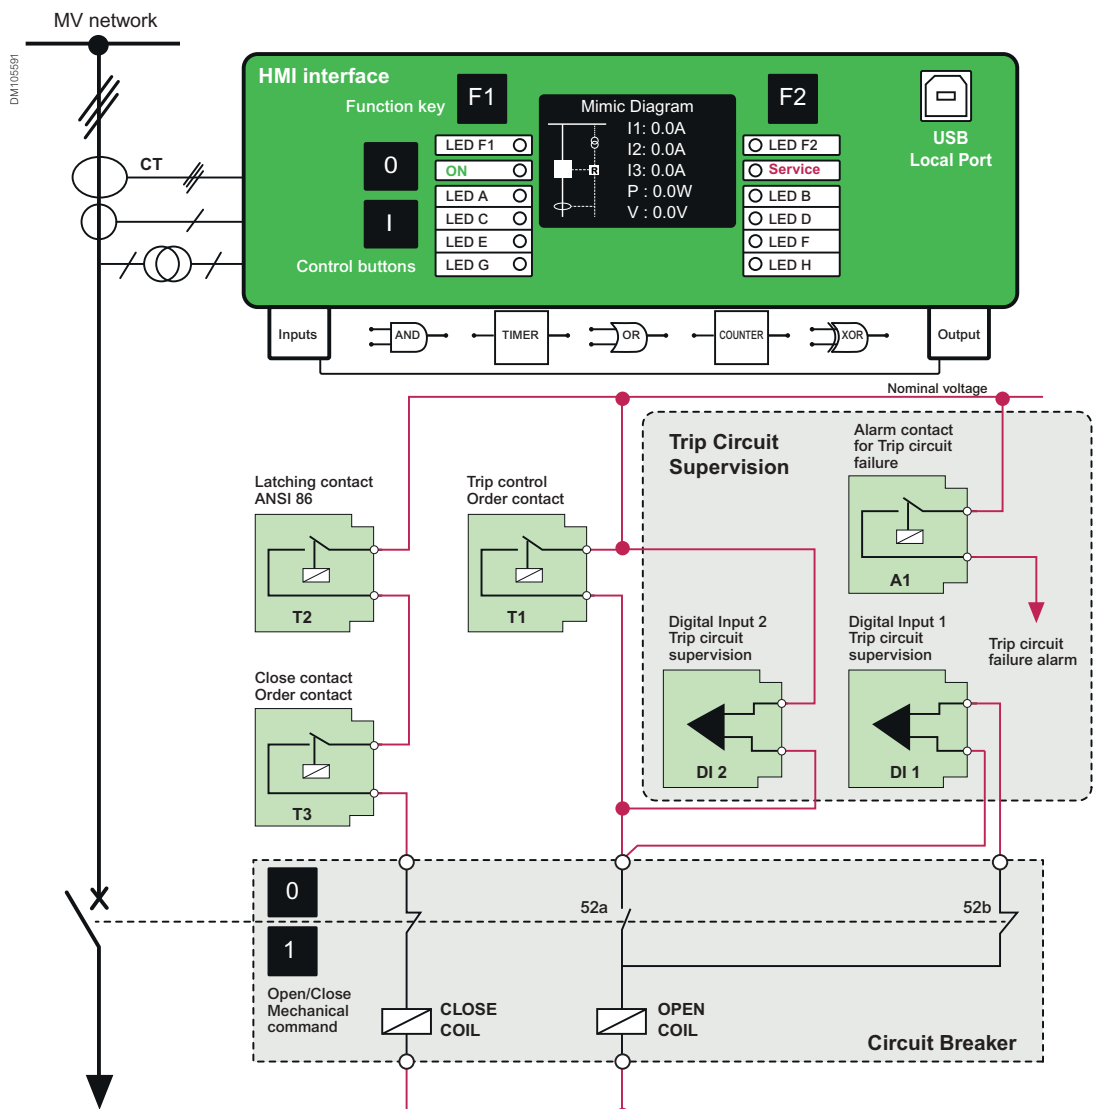


This electrical schematic can facilitate the IEC 61850 implementation because all the logics are determined by the protection unit that will make the decisions and if necessary can send GOOSE messages to other units.



# Connection Diagrams

## PowerLogic™ P3U30 Example

Application with 3 Phase CTs, 1 Earth CT, 1 VT and CB Control

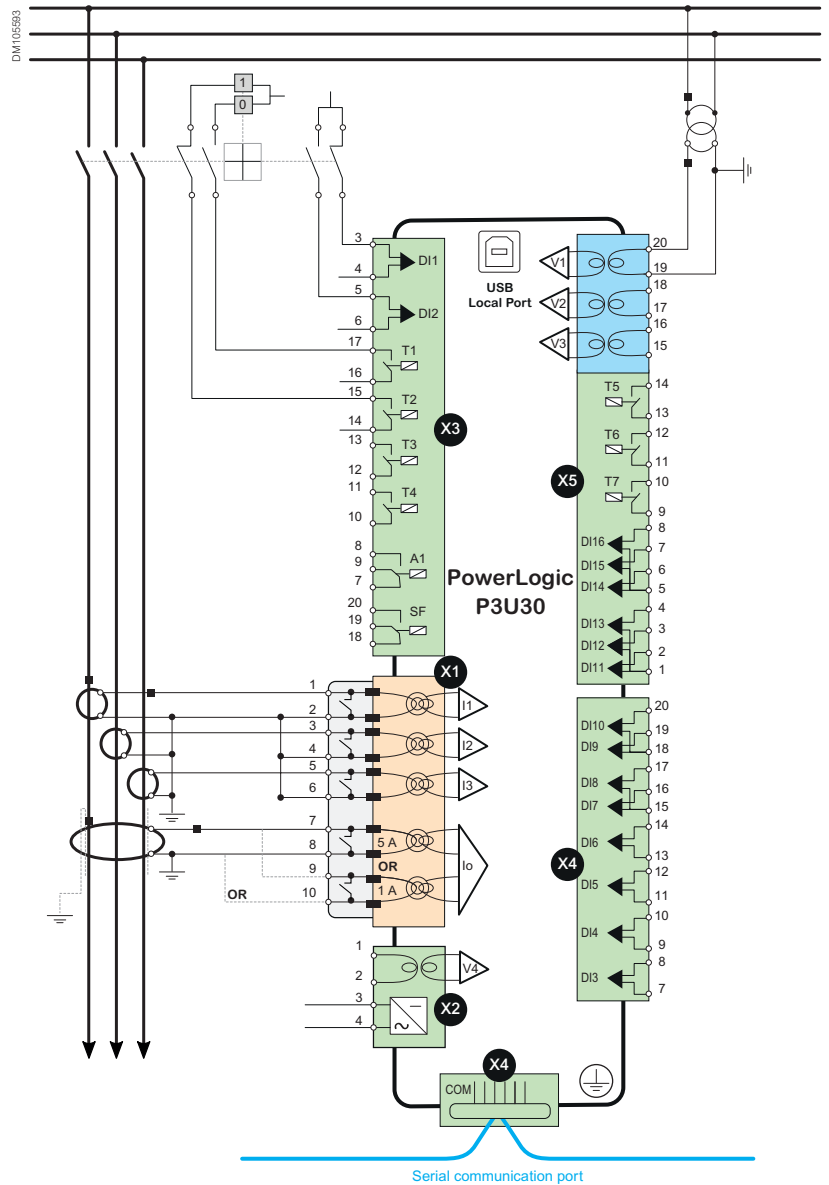


Note: Dangerous environment, make sure to read all information, including warning instructions (left).

# Connection Diagrams

## PowerLogic™ P3U30 Example

Application with 3 Phase CTs, 1 Earth CT, 3 VTs, Synchro-Check and CB Control

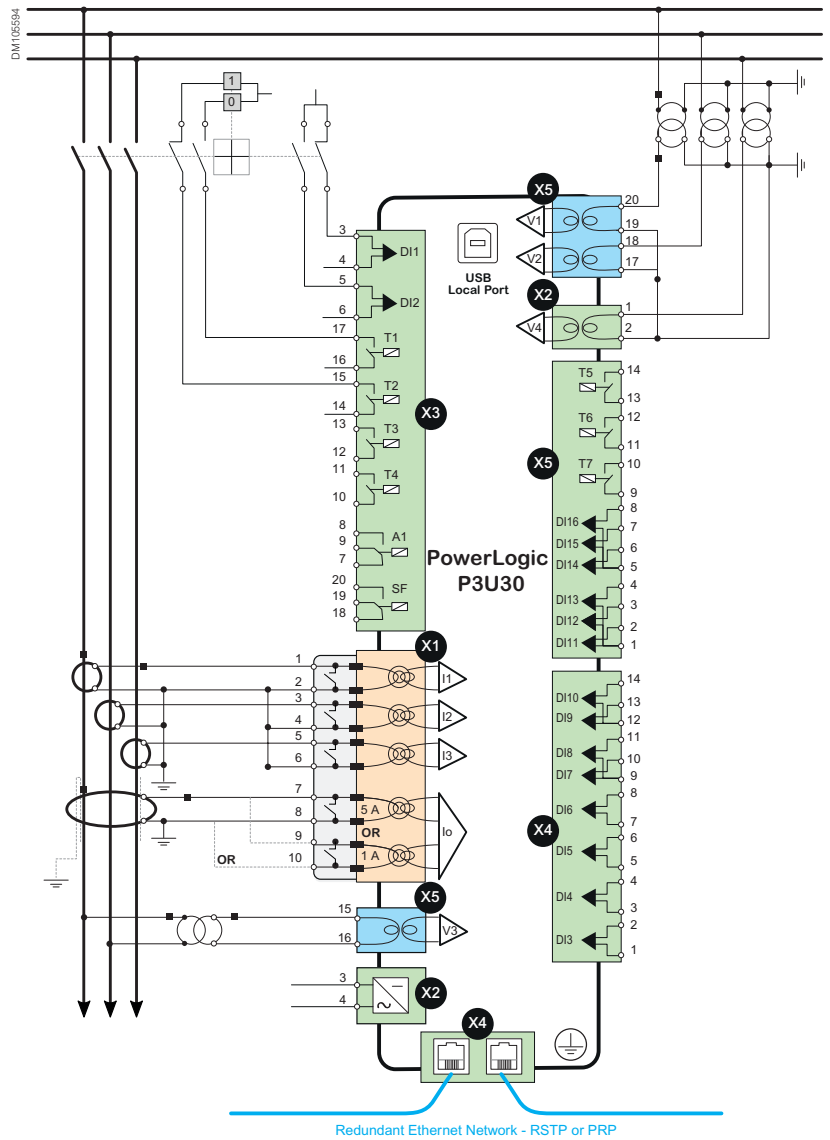


Note: Dangerous environment, make sure to read all information, including warning instructions (left).

# Connection Diagrams

## PowerLogic™ P3U30 Example

Application with 3 Phase CTs, 1 Earth CT, 4 VTs and CB Control

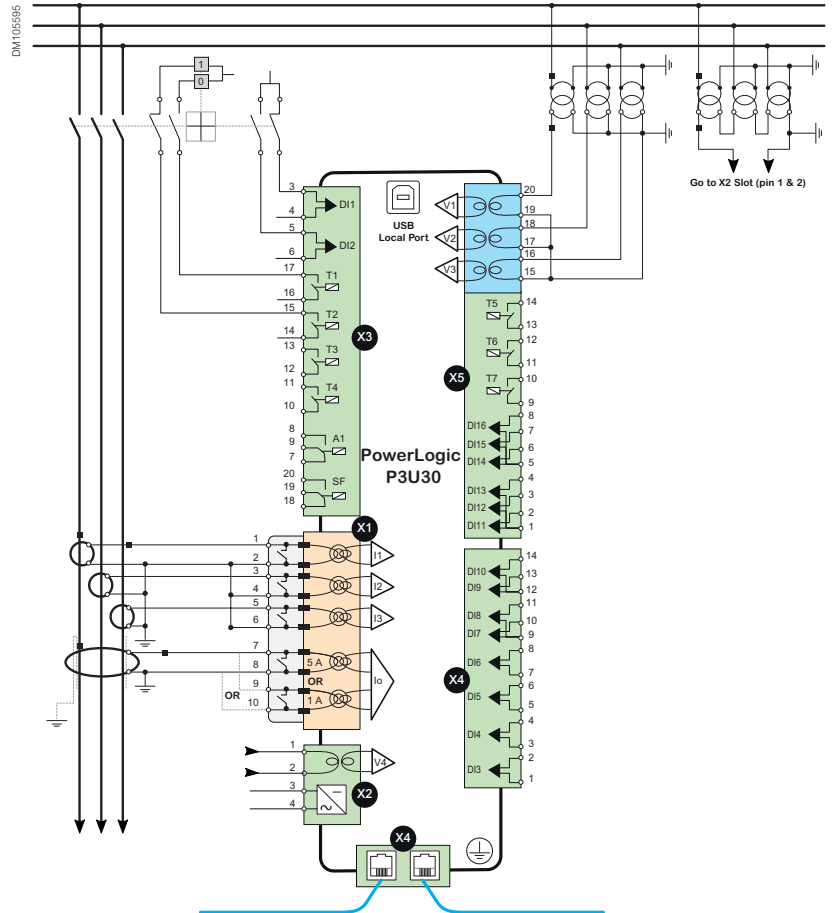

Note: Dangerous environment, make sure to read all information, including warning instructions (left).

# Model Selection

## Selecting Product

Please, consult the “Ordering” section to choose specific characteristics in the relays for your system:



P3U20 Standard Application

Page 117



P3U30 Standard Application

Page 118

Or use our web configuration tool:

[Go to web configurator](#)

Notes

---

# PowerLogic™ P3 Advanced

# PowerLogic™ P3 Advanced

<b>Presentation</b>	<b>54</b>
<b>Functional View</b>	<b>56</b>
<b>Base Unit Presentation</b>	<b>63</b>
Integrated Arc Flash Protection	63
Local HMI	64
Rear Panel	65
Remote HMI	67
<b>Base Unit Dimensions</b>	<b>68</b>
Dimensions	68
Cut-Out and Mounting	69
<b>Base Unit Characteristics</b>	<b>70</b>
Technical Characteristics	70
Environmental Characteristics	71
<b>Communication</b>	<b>73</b>
Communication Protocols	73
<b>Programmable Stages</b>	<b>74</b>
<b>Circuit Breaker Control</b>	<b>75</b>
<b>Power Quality Measurements</b>	<b>76</b>
<b>Connection Diagrams</b>	<b>77</b>
<b>Model Selection</b>	<b>80</b>

The PowerLogic P3 advanced is a protection relay developed to satisfy the protection needs for buildings, distribution utilities, and industrial applications. Thanks to a wide scope of functionality and Ethernet communication, PowerLogic P3 advanced provides a cost-effective solution for the upper end of protection requirements in these applications.

Protect your staff and equipment and ensure safer operations with PowerLogic™ P3 Advanced's built-in arc flash detection and protection functions.

You will experience greater operational efficiency with rapid ordering, configuration, and operations for an unparalleled digital experience provided with PowerLogic™ P3.

## PowerLogic™ P3 Advanced at a glance

### Extended capabilities

- Extended protection functions, including differential of line, transformer, motor, and generator
- Arc flash detection
- All communication protocols embedded on serial and Ethernet links, including IEC 61850 ed.1 and ed. 2
- Increased number of inputs and outputs

### Robust

- Best-in class reliability based on 100+ years of experience in Sepam, MiCOM and Vamp relays
- Strong tests performed in international laboratories
- Compliant with IEC electro-mechanical standards

### Efficient and connected


- Easy to configure with the unique eSetup Easergy Pro setting software
- Easy to test with the virtual simulation test for direct injection of current and voltage from eSetup Easergy Pro
- Easy to use and maintain with the embedded web-HMI and EcoStruxure™ Power Device app for direct access on site via your laptop, smartphone, or tablet

PM108370





PowerLogic P3 is designed to cover a large scope of applications

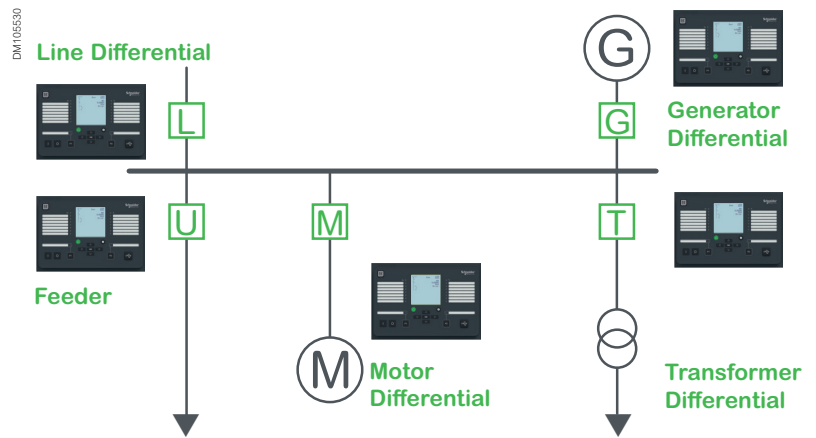


PowerLogic™ P3 Advanced is designed in **7 models, per application**:

Model	Function
PowerLogic™ P3F 30	Feeder Protection
PowerLogic™ P3L 30	Line Differential
PowerLogic™ P3M	30 Protection
	32 Differential
PowerLogic™ P3G	30 Protection
	32 Differential
PowerLogic™ P3T 32	Transformer Differential



**A common set of functions** extends the possibilities of protection and control:

- Single-line diagrams (mimic) in the display
- Programmable protection stages
- Programmable logics
- 2 programmable function keys
- Synchro-check function
- Direct-access USB port
- Up to 6 objects controlled
- Arc flash protection


DM105596b

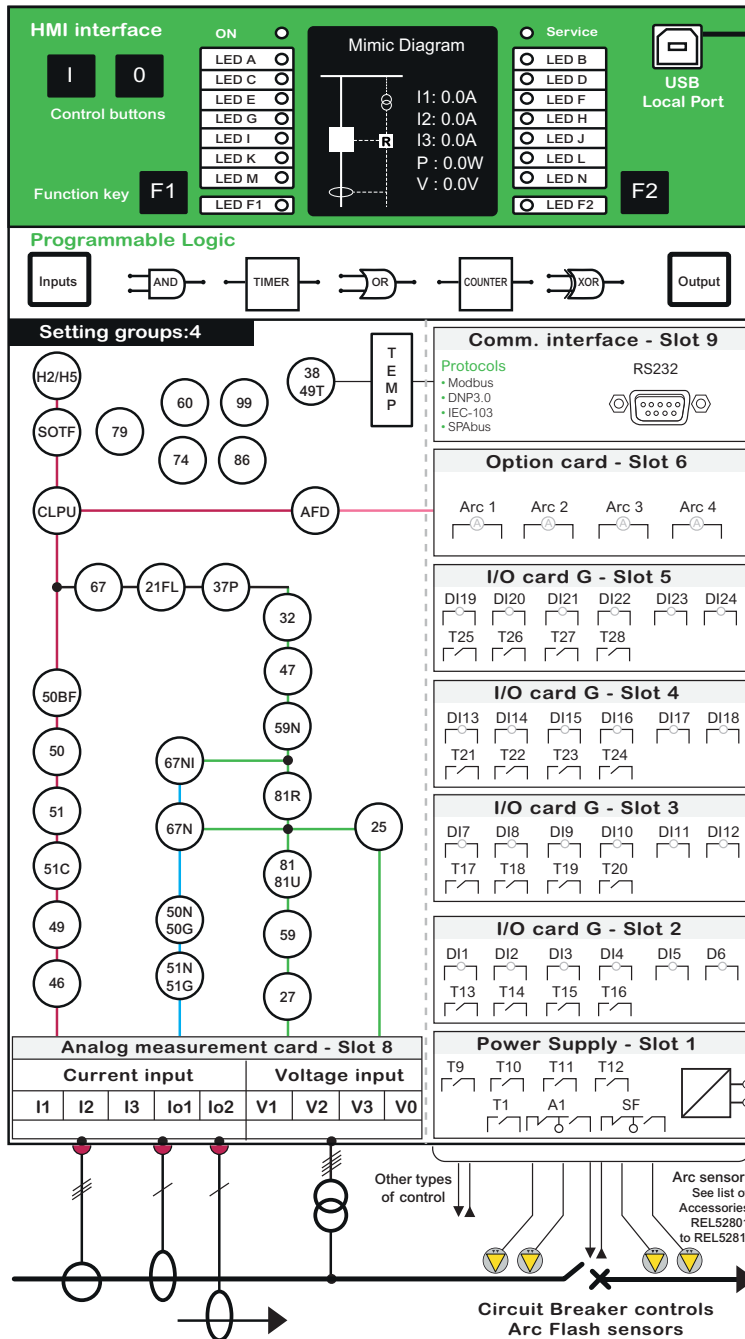



REL52822

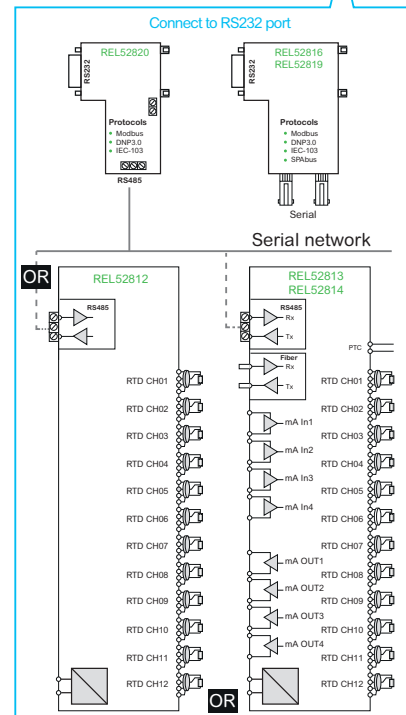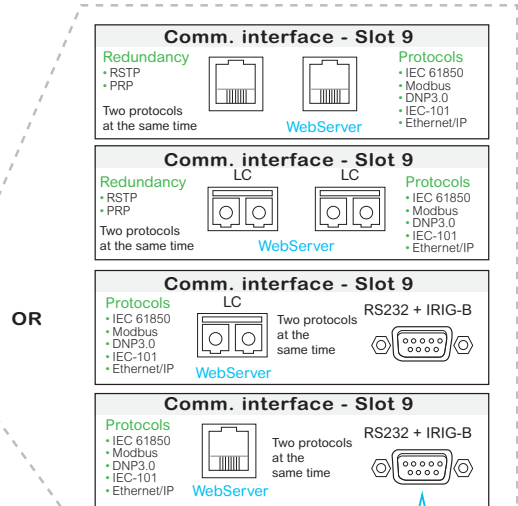


DM105597b

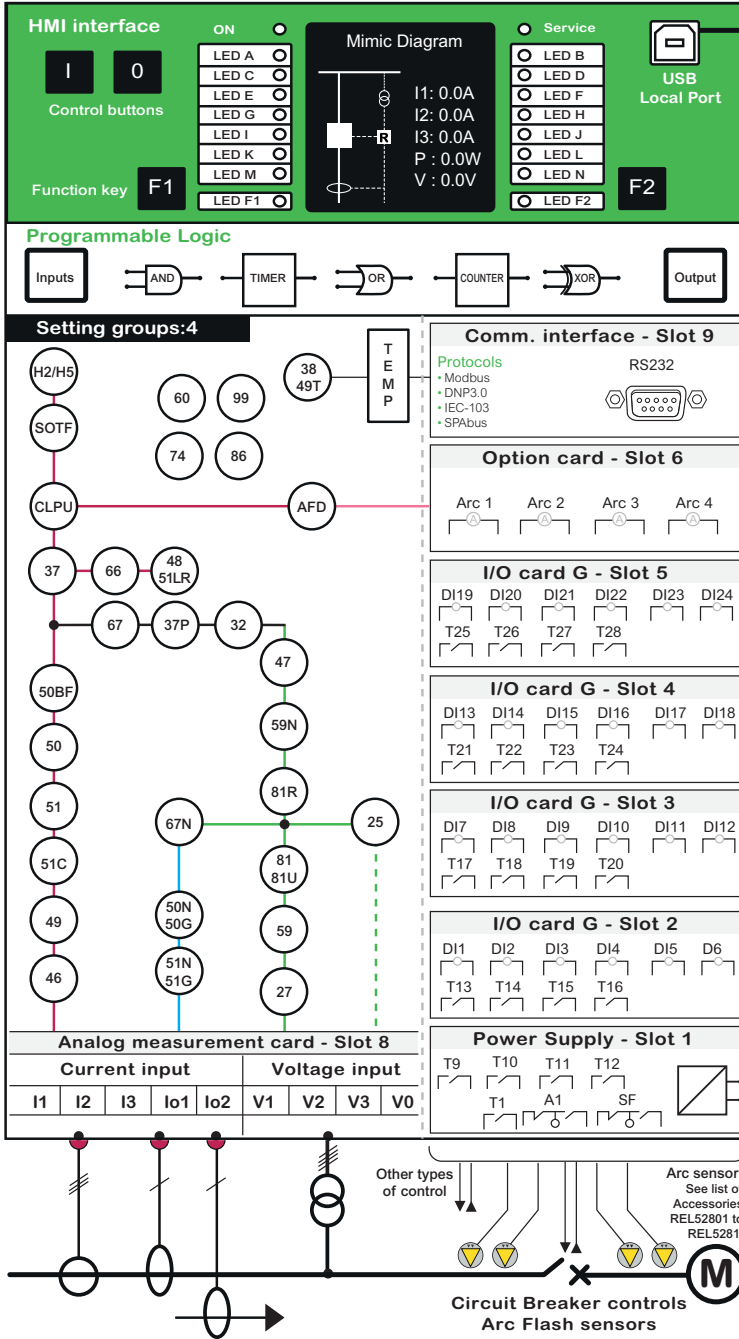





REL52822

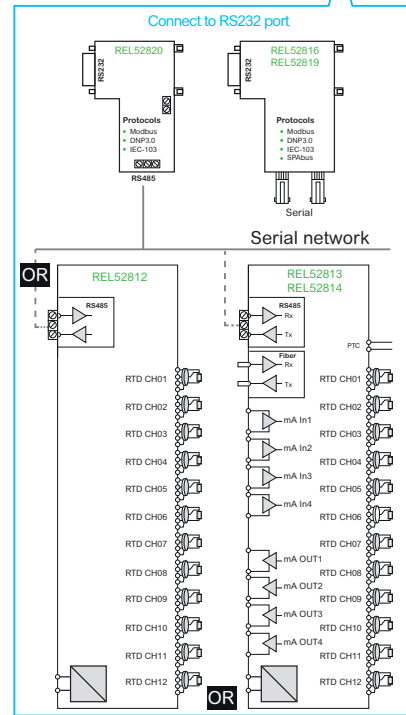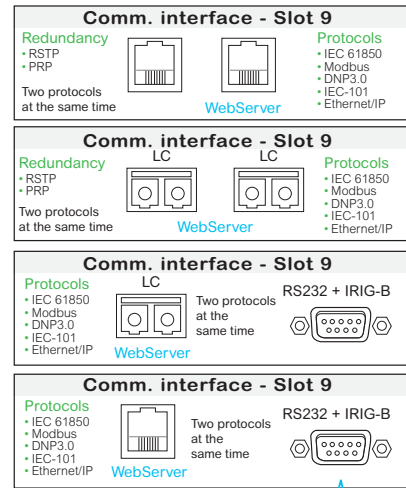


DM105590b

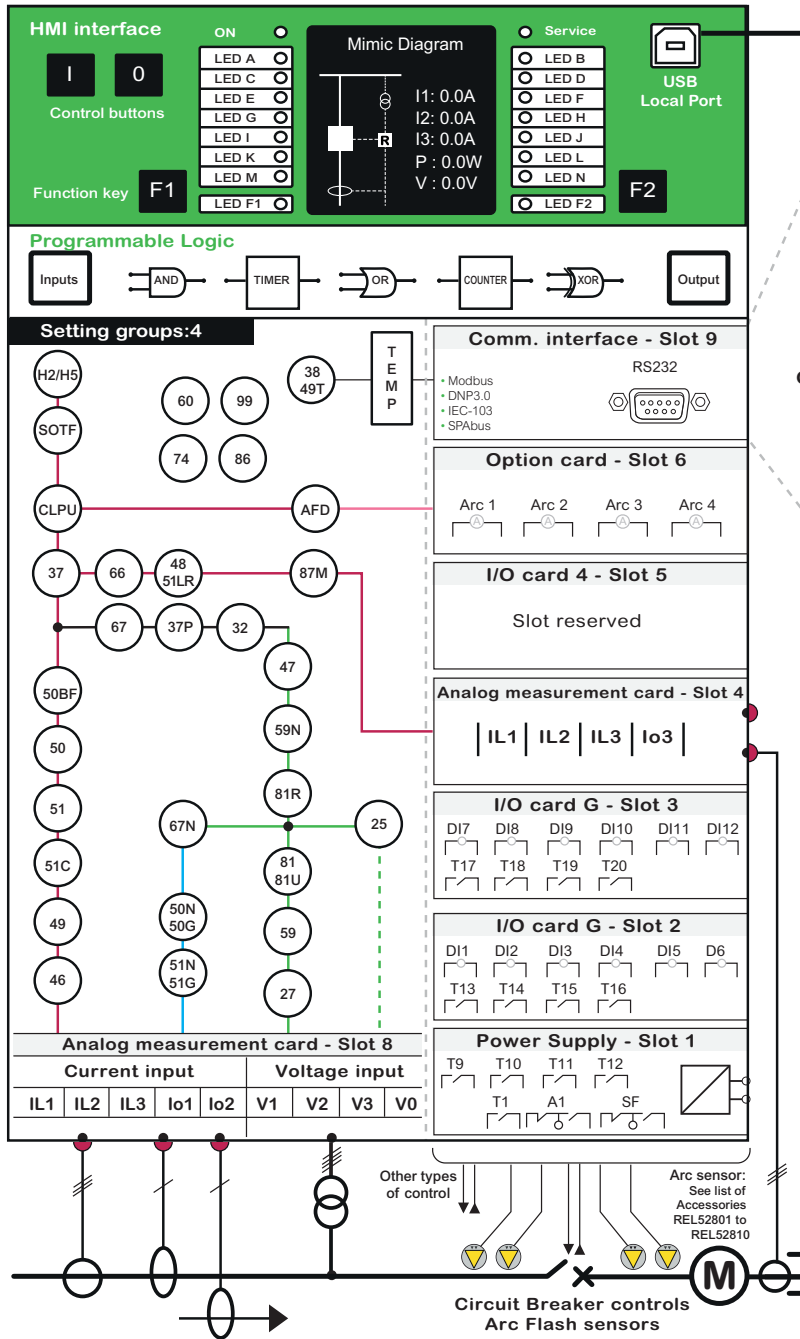


REL52822




OR

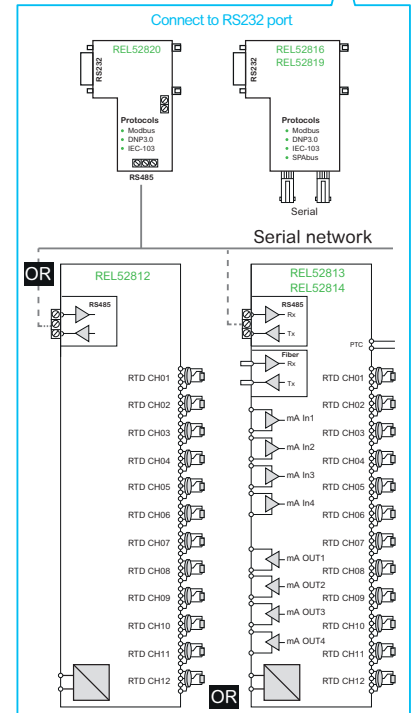



DM105599b

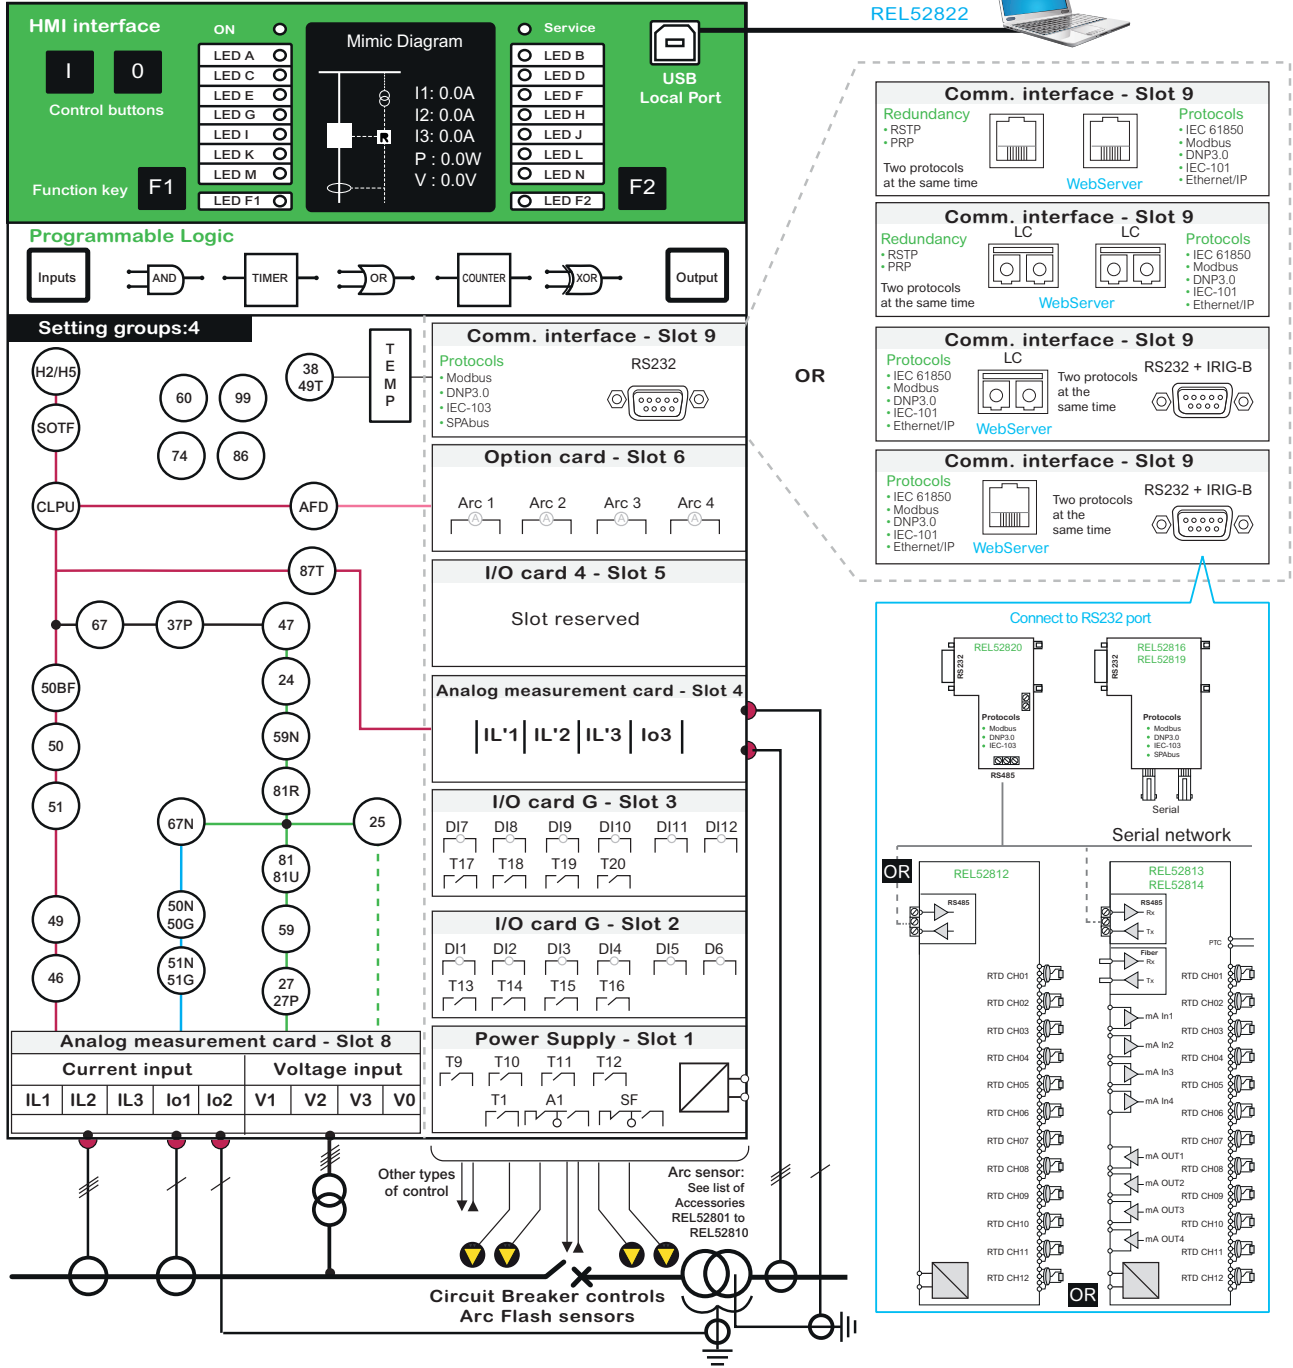


DM105600b

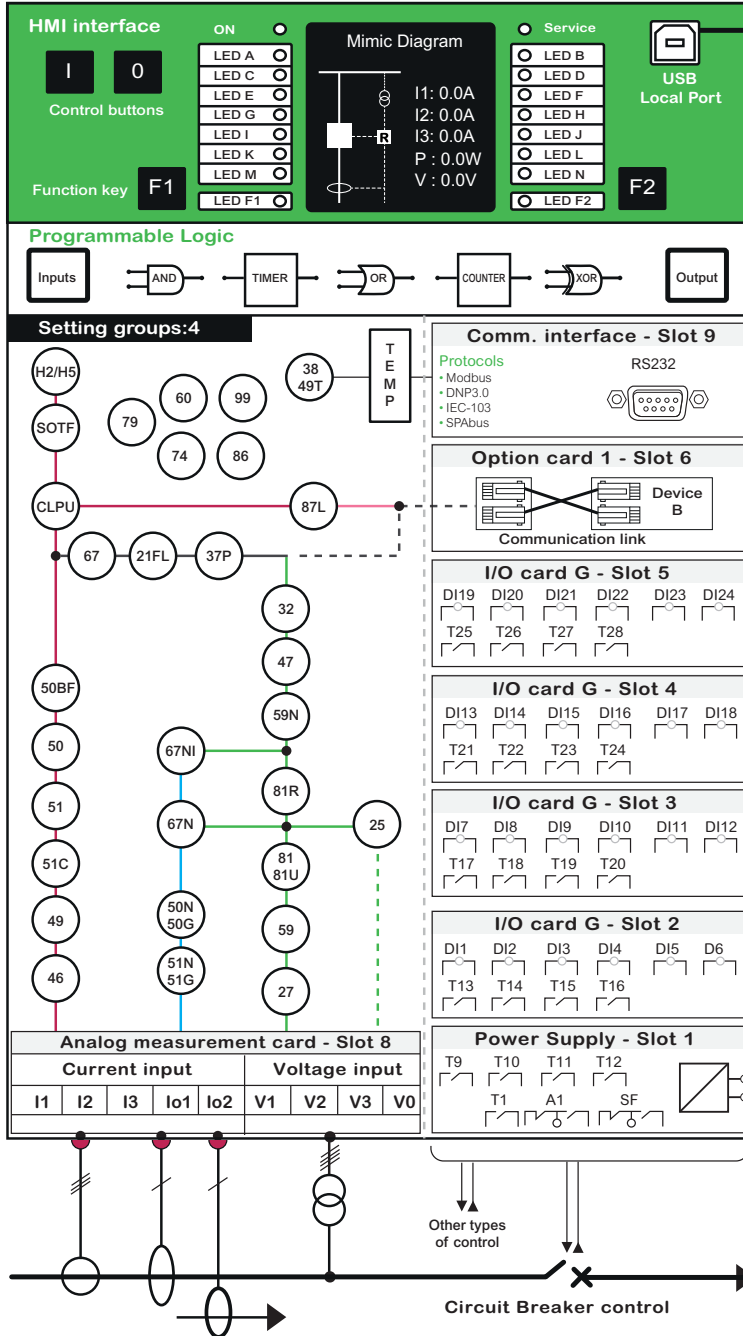



REL52822

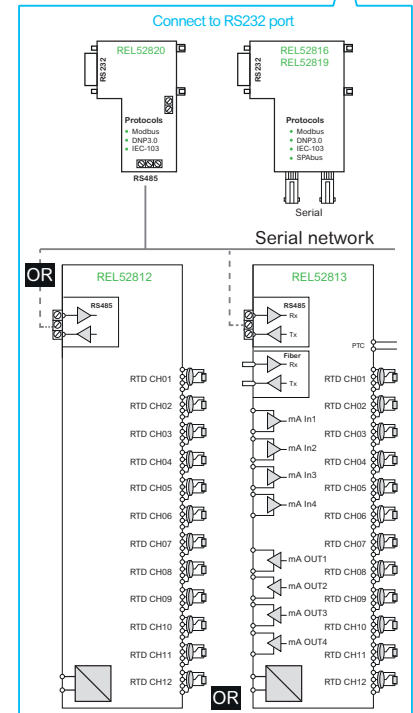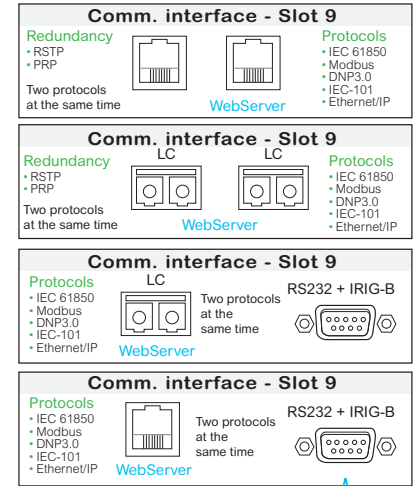

DM105601b

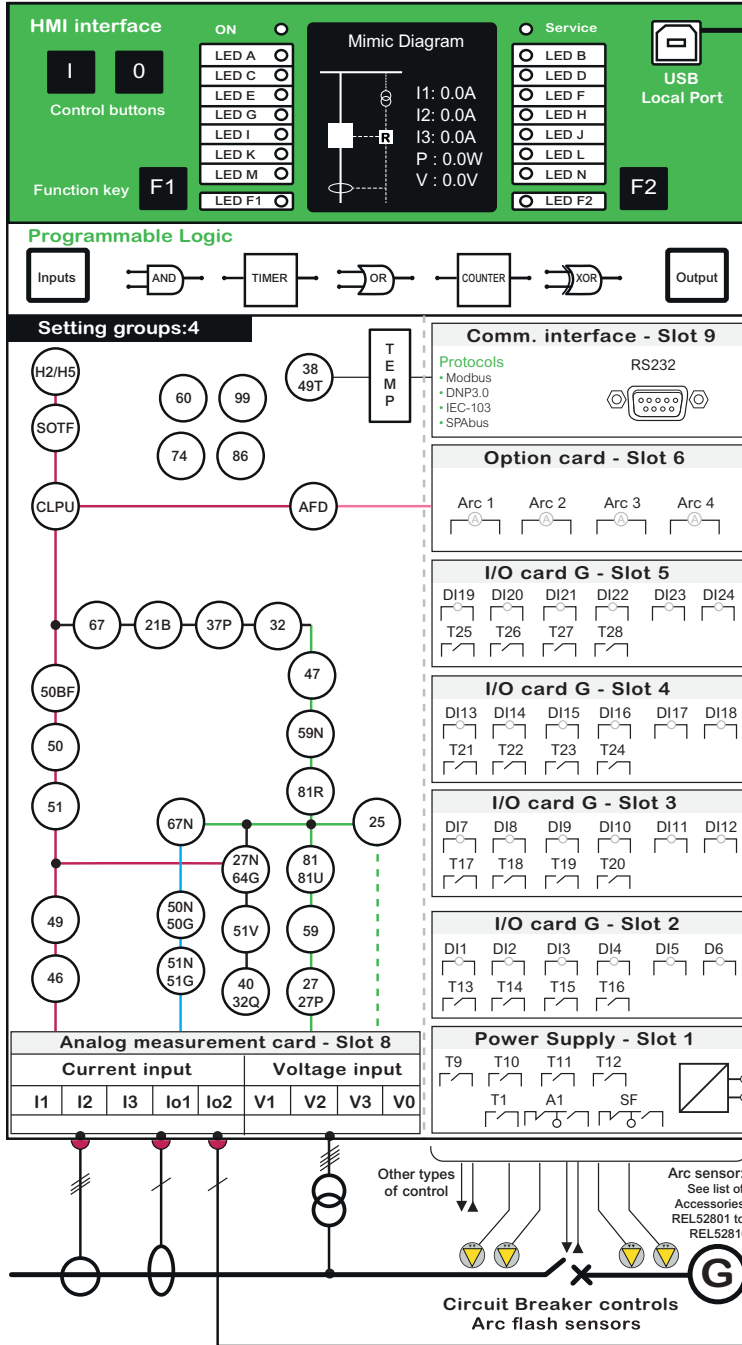


REL52822



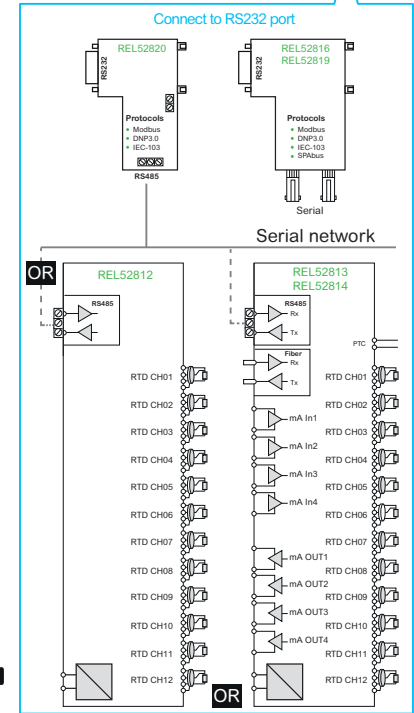
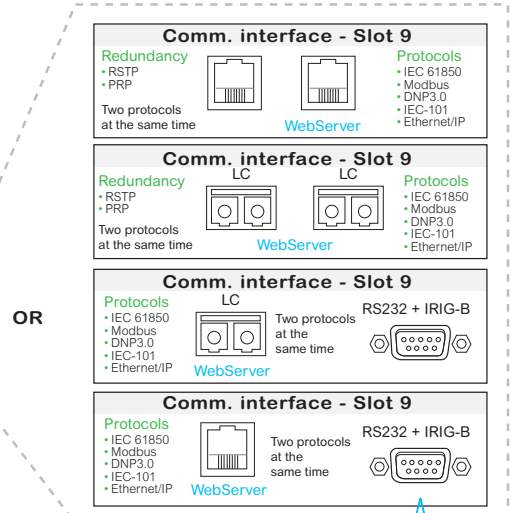





DM1105602b

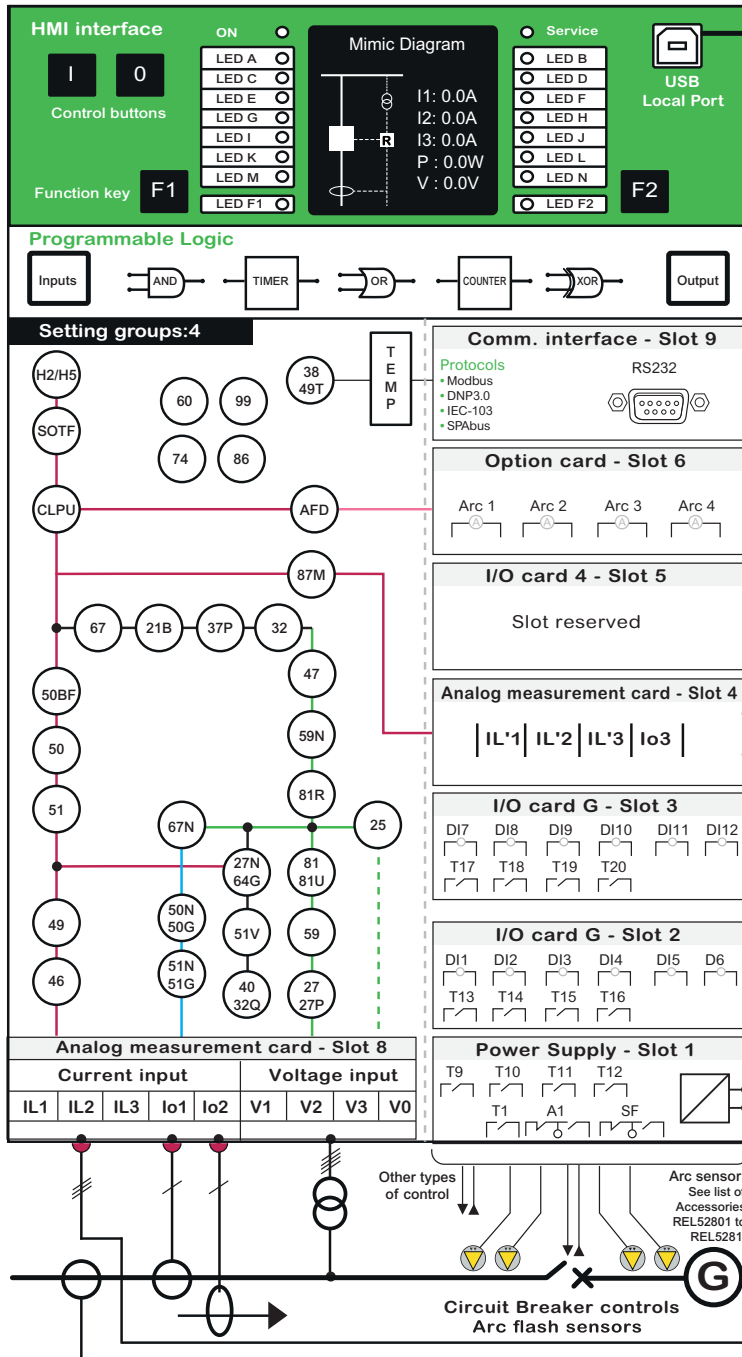

REL52822

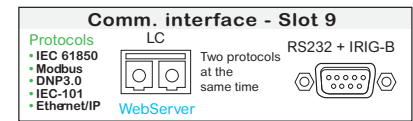

OR

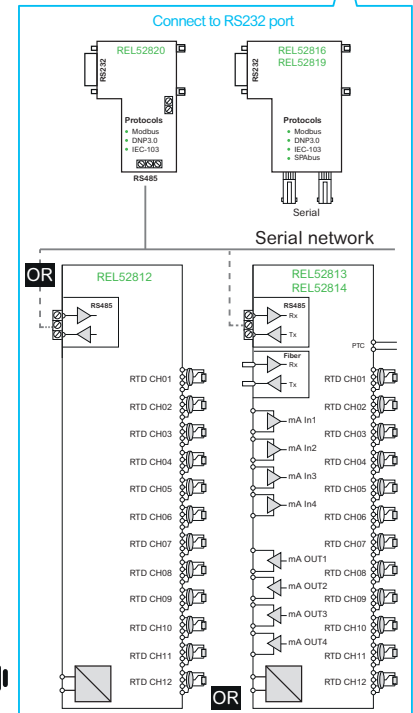




PowerLogic P3 Advanced measures fault current, and with arc protection, also light via arc sensor channels that provide monitoring for the whole switchgear.

An arc flash is a mass of heat and pressure caused by a switchgear fault. It not only causes power outages but can also result in loss of business and extensive material damage. If an arc fault occurs in the switchgear, the arc protection system prevents the fault from spreading by tripping the circuit breaker within less than 10 ms.


PowerLogic P3 Advanced relays can connect up to four arc flash sensors that have continuous self-supervision to check the sensor status.

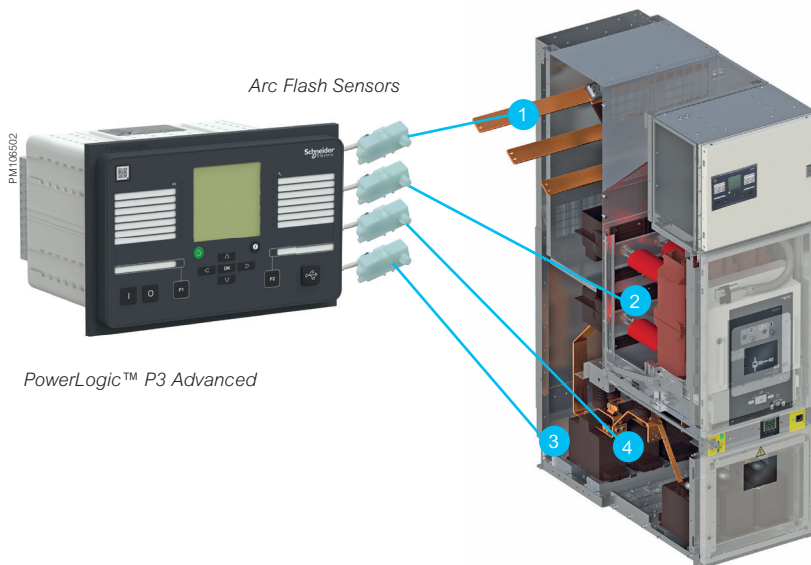


### Example of Application

The four arc flash sensors can be installed in specific parts of the switchgear:

1. Busbars compartment
2. Circuit breaker compartment
3. Current/voltage transformers compartment
4. Cables connections compartment

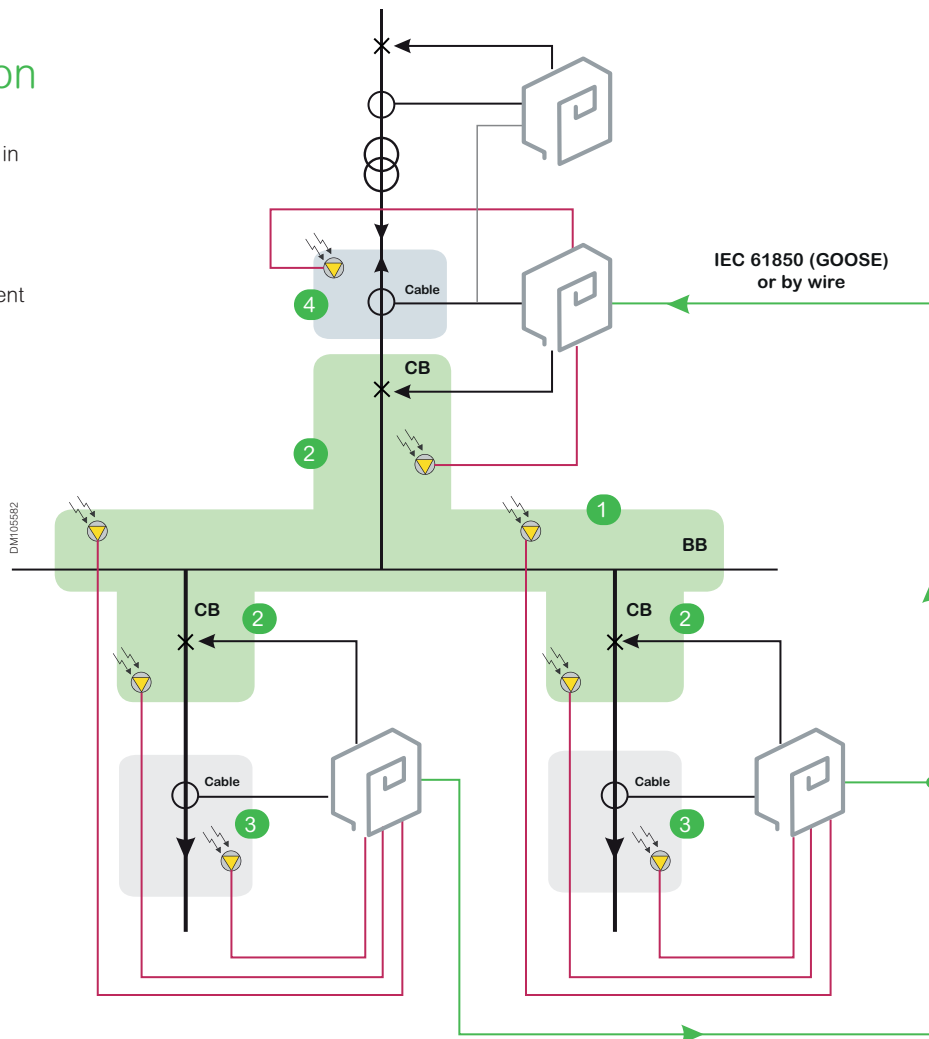

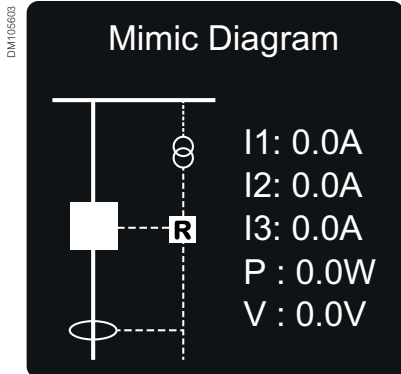

Single line diagram of the power system

## Comprehensive Data for Easier and Faster Operation

All the data you require for a local equipment operation can be displayed on demand:

- Display the single line diagram and freely assignable analog values
- Display of all measurements
- Display of operation and alarm messages
- Display and setting of all parameters
- Password entry to protect parameter and protection settings

## Ergonomic Data Presentation

- Keypad keys identified by pictograms for intuitive navigation
- Graphical 128x128 LCD screen displays any character or symbol
- Excellent display quality under all lighting conditions
- Control buttons (0/1) to operate the circuit breaker and/or others controlled object
- 14 freely programmable LEDs with 3 different colors (red, orange, and green) to identify easily the message shown
- Labels are printed on a transparent film allowing customization of the relay
- 2 programmable function keys (F1/F2)


- INFO push-button for viewing additional information, entering the password view, and adjusting the LCD contrast
- F1 Programmable function push-button
- F2 Programmable function push-button
- ENTER push-button for activating or confirming a function
- UP navigation push-button for moving up in the menu or increasing a numerical value
- DOWN navigation push-button for moving down in the menu or decreasing a numerical value
- LEFT navigation push-button for moving backwards in a parallel menu or selecting a digit in a numerical value
- RIGHT navigation push-button for moving forwards in a parallel menu or selecting a digit in a numerical value
- Circuit Breaker OFF push-button
- Circuit Breaker ON push-button
- HOME/CANCEL push-button for returning to the previous menu. To return to the first menu item in the main menu, press the button for at least three seconds



## Working Language

All the texts and messages displayed on the PowerLogic P3 Advanced are available in two languages at the same time.


### Rear Panel Example

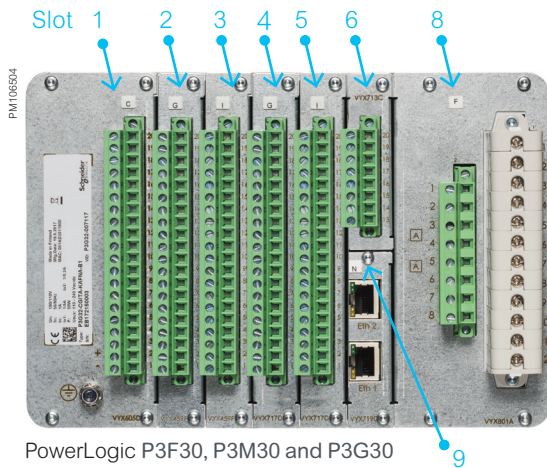

PowerLogic P3F30, P3M30 and P3G30

#### Slots description for P3x30 models


- Slot 1 - Power supply and output contacts
- Slot 2 - I/O card 1
- Slot 3 - I/O card 2
- Slot 4 - I/O card 3
- Slot 5 - I/O card 4
- Slot 6 - Option card 1
- Slot 8 - Analog measurement card 1
- Slot 9 - Communication interface

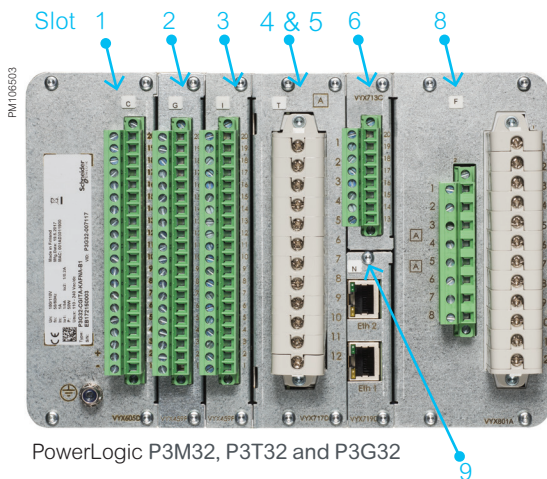

PowerLogic P3M32, P3T32 and P3G32

#### Slots description for P3x32 models

- Slot 1 - Power supply and output contacts
- Slot 2 - I/O card 1
- Slot 3 - I/O card 2
- Slot 4/5 - Analog measurement card 2
- Slot 6 - Option card 1
- Slot 8 - Analog measurement card 1
- Slot 9 - Communication interface

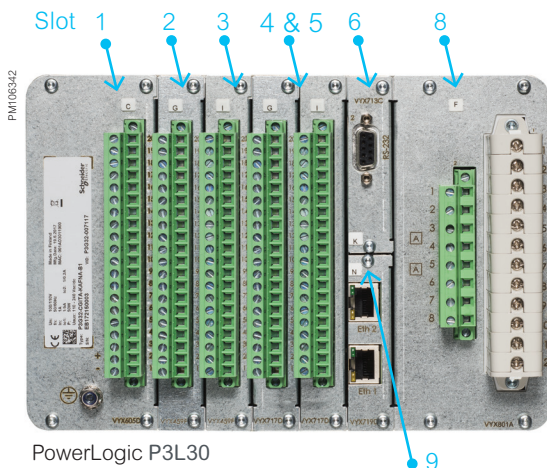

PowerLogic P3L30

#### Slots description for P3L30 models

- Slot 1 - Power supply and output contacts
- Slot 2 - I/O card 1
- Slot 3 - I/O card 2
- Slot 4 - I/O card 3
- Slot 5 - I/O card 4
- Slot 6 - Option card 1- Line differential com.
- Slot 8 - Analog measurement card 1
- Slot 9 - Communication interface


### Digital Input and Output Capability

The PowerLogic P3 Advanced has a modular concept in term of digital inputs and outputs.

#### Description of the optional boards


- C = 5 x DO heavy duty, A1, SF
- D = 5 x DO heavy duty, A1, SF
- A = None
- G = 6DI+4DO (6 x DI, 4 x DO)
- H = 6DI+4DO (6 x DI, 4 x DO(NC))
- I = 10DI (10 x DI)

Number of		Type of I/O card – P3X30				
Input	Output	Slot 1	Slot 2	Slot 3	Slot 4	Slot 5
6	11	C/D	G	None	None	None
12	15	C/D	G	G or H	None	None
18	19	C/D	G	G or H	G or H	None
24	23	C/D	G	G or H	G or H	G or H
22	16	C/D	G	G or H	I	None
32	16	C/D	G	G or H	I	I
28	19	C/D	G	G or H	G or H	I
16	11	C/D	G	I	None	None
26	11	C/D	G	I	I	None
36	11	C/D	G	I	I	I

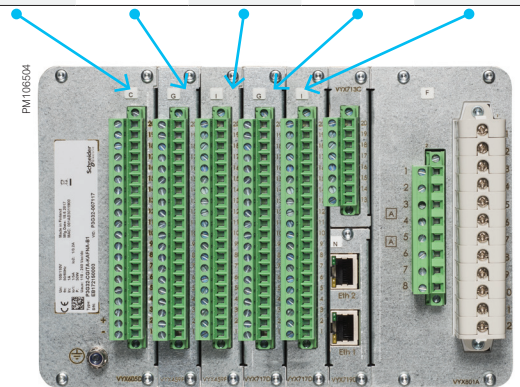

P3x30 units

Number of		Type of I/O card – P3X32				
Input	Output	Slot 1	Slot 2	Slot 3	Slot 4	Slot 5
6	11	C/D	G	None	None	None
12	15	C/D	G	G or H	None	None
16	11	C/D	G	I	None	None

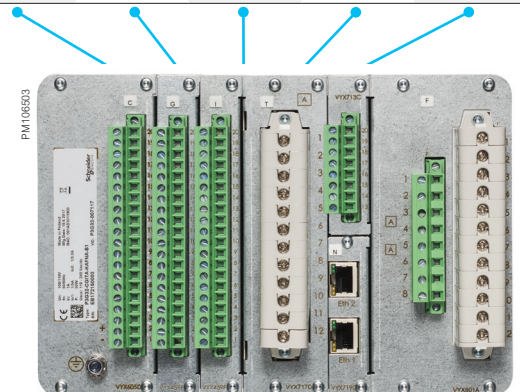

P3x32 units


The slots 4 and 5 are used to receive the analog current input when PowerLogic P3 is used with differential overcurrent (ANSI 87).

# Base Unit Presentation

## Remote HMI

This mounting technique allows for a lighter door because the relay's frame is installed in the back of the secondary compartment. Communication, DI, and DO cabling is easier, too, as the door movement does not need to be considered.

In this case, only the communication between IED base and display has to be wired.

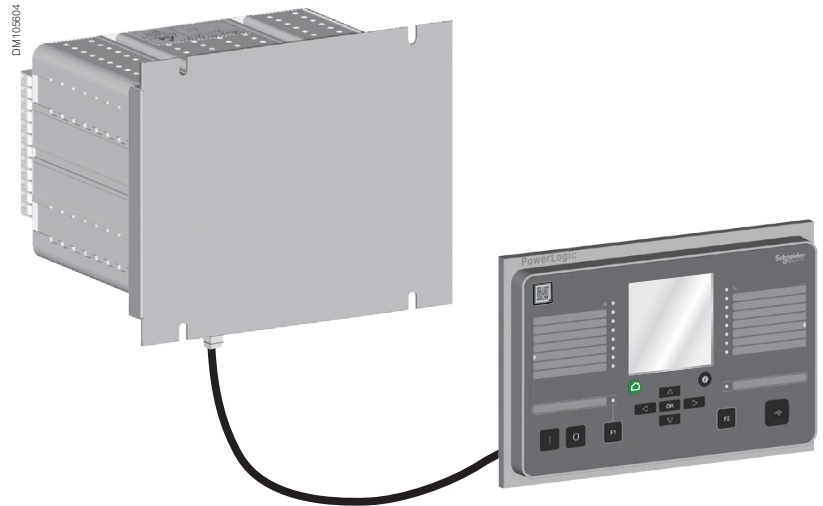





# Base Unit Dimensions

## Dimensions

### Conventional HMI

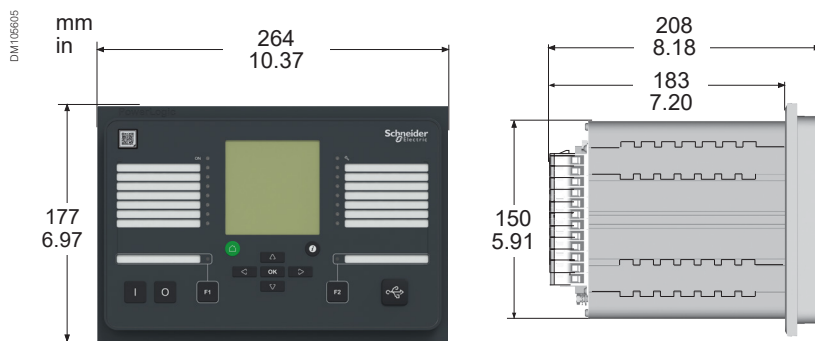

### Remote HMI

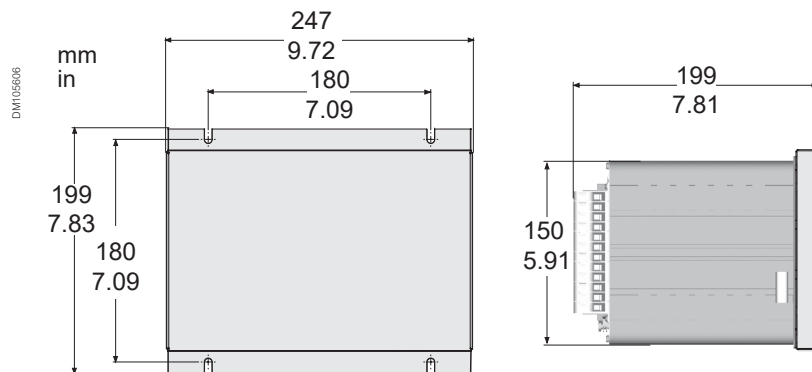

#### Weight (maximum)

PowerLogic P3 Advanced 4.2 Kg (9.272 lb) or higher (depends of options)

#### Degree of protection (IEC 60529)

IP54 Front panel/IP20 Rear side


Cut-out accuracy must be complied with to ensure good withstand.

### Mounting


In case the depth dimension behind the compartment door is limited, the IED can be equipped with a frame (REL52832) around the collar. This arrangement reduces the depth inside the compartment by 45 mm (1.77 in).

Projection mounting with the raising frame REL52832

Panel mounting

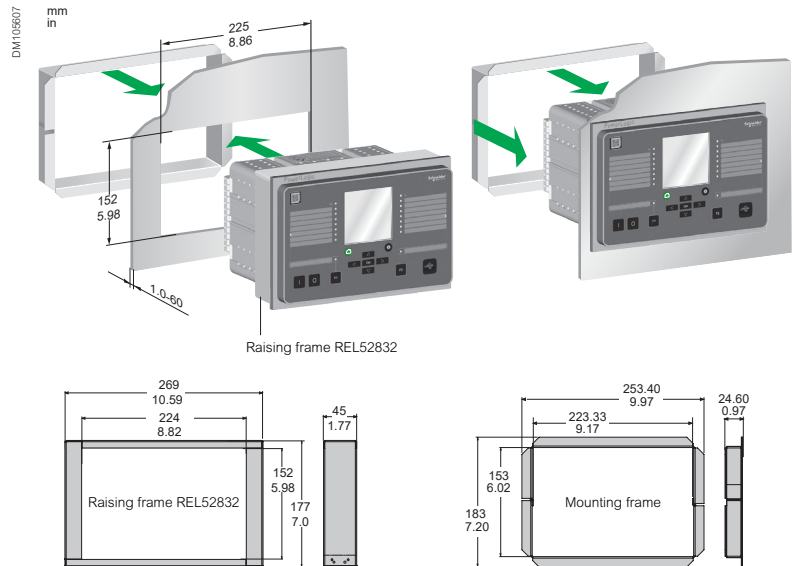

### Wall Mounting with Remote HMI

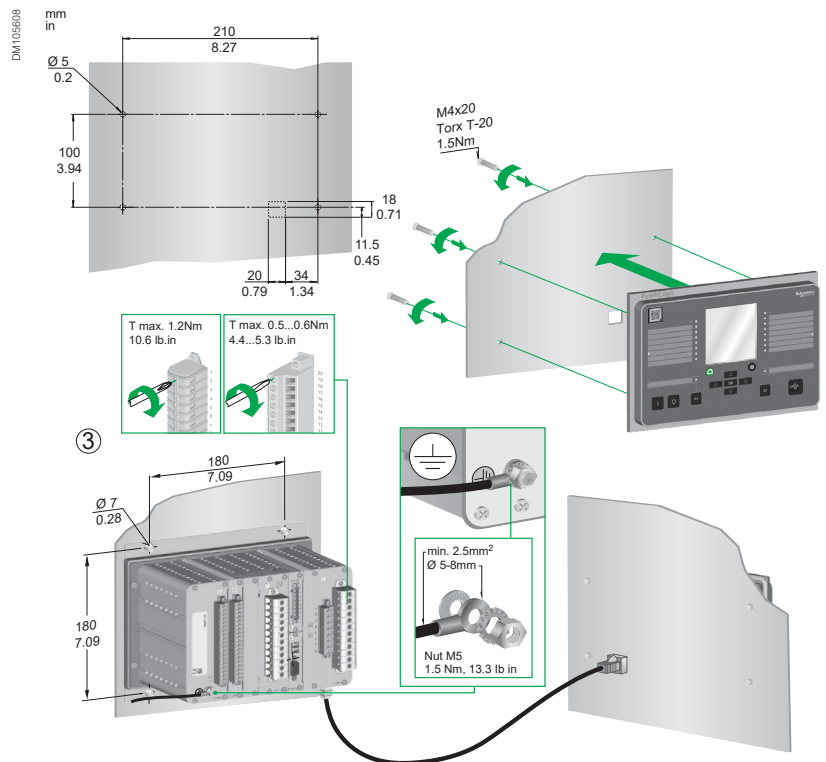

## Analog inputs

	Rated phase current	Measuring range	Input Impedance	Consumption	Rated thermal withstand	1-second overload	10-second overload
<b>Phase Current Input (I)</b> Slot 8	5 A CT	0.05...250 A	0.003 Ohm	0.075 VA	20 A	500 A	100 A
<b>Residual Current Input (I0)</b> Slot 8 - 5 A CT		0.015...50 A	0.003 Ohm	0.075 VA	20 A	500 A	100 A
Configurable for CT secondaries 0.1 to 10A							
<b>Residual Current Input (I0')</b> Slot 8 - 1 A CT		0.003...10 A	0.02 Ohm	0.02 VA	4 A	100 A	20 A
Configurable for CT secondaries 0.1 to 10.0A							
<b>Residual Current Input (I0'')</b> Slot 8 - 0.2 A CSH sensor		0.0006...2 A	0.02 Ohm	0.02 VA	0.8 A	20 A	4 A
Configurable for CT secondaries 0.1 to 10.0A							
<b>Phase Current Input - (I')</b> Slot 4 (Only for device with differential overcurrent)	1A CT	0.02...50 A	0.02 Ohm	0.02 VA	4 A	100 A	20 A
	5A CT	0.05...250 A	0.003 Ohm	0.075 VA	20 A	500 A	100 A
<b>Residual Current Input (I0'')</b> Slot 4 (Only for device with differential overcurrent)	1A CT	0.02...50 A	0.02 Ohm	0.02 VA	4 A	100 A	20 A
	5A CT	0.05...250 A	0.003 Ohm	0.075 VA	20 A	500 A	100 A
<b>Voltage Input</b> Configurable for VT secondaries 50 to 120 V		0.5...190 V (100V/110 V)	n.a.	< 0.5 VA	250 V (Continuously)	n.a.	600 V

## Analog temperature input / Analog output

Type of temperature sensor	Pt100	Ni100	Ni120	Cu10
Maximum distance between sensor and module	up to 2000 m <sup>(1)</sup>	up to 2000 m <sup>(1)</sup>	up to 2000 m <sup>(1)</sup>	up to 2000 m <sup>(1)</sup>
Analog Output	0 mA			
Minimum current	0 mA			
Maximum current	20 mA			
Operating temperature:	0 °C (32 °F)...+55 °C (131 °F)			
Power supply	REL52811/REL52812	24...230 Vac/dc, 50/60 Hz		
	REL52813	24 Vdc		
	REL52814	48...230 Vac/dc, 50/60 Hz		

## Digital Input

Nominal operation voltage	DI1 to DI16	24...230 Vac/dc	110...230 Vac/dc	220...230 Vac/dc
Typical switching threshold		12 Vdc	75 Vdc	155 Vdc
Input limit voltage	At state 1	≥ 19.2 Vdc	≥ 88 Vdc	≥ 176 Vdc
	At state 0	< 10.0 Vdc	< 60 Vdc	< 140 Vdc
Frequency		45...65 Hz	45...65 Hz	45...65 Hz
Typical consumption		< 4 mA (typical approx. 3 mA)		
Voltage withstand		255 Vac/dc		

## Digital Output

Type of contact	Control and Trip contact, Tx	Signal contact, A1	Signal Contact, SF
Rated Voltage	250 Vac/dc	250 Vac/dc	250 Vac/dc
Continuous current	5 A	5 A	5 A
Breaking capacity	2,000 VA	2,000 VA	2,000 VA
AC capacity (L/R=40ms)	at 48 Vdc	1 A	1 A
	at 110 Vdc	0.5 A	0.3 A
	at 220 Vdc	0.25 A	0.15 A
Making capacity	≤ 0.5 s	30 A	-
	≤ 3.0 s	15 A	-
Minimum making capacity	100 mA @ 24 Vac/dc	100 mA @ 24 Vac/dc	100 mA @ 24 Vac/dc
Typical operation time	< 8 ms	-	-
Contact material	AgNi 90/10	AgNi 0.15	AgNi 0.15

## Power supply

Nominal Voltage	110...240 Vac/dc	24...48 Vdc
Range	-20%/+10% (88...264 Vac/dc)	-20%/+20% (19.2-57.6 Vdc)
Inrush current (DC)	25 A with time constant of 1000 μs	
	25 A with time constant of 750 μs	
	15 A with time constant of 500 μs	
Power consumption	Power consumption increases when more I/O or optional I/O or communication cards are used	
	Max. 50 W	
Acceptable momentary outages	< 50 ms (110 Vdc)	

(1) 78,740 in



## Disturbance Tests

	Standard and test class/level	Test value
<b>Emission</b>		
IEC/EN 60255-26 (ed3)		
Conducted	EN 55022, Class A/CISPR 22	0.15...30 MHz
Emitted	EN 55011, Class A/CISPR 11	30...1000 MHz
<b>Immunity</b>		
IEC/EN 60255-26 (ed3)		
Slow damped oscillatory wave 1MHz	IEC/EN 61000-4-18	±2.5kVp CM ±2.5kVp DM
Fast damped oscillatory wave 3MHz, 10 MHz and 30 MHz	IEC/EN 61000-4-18	±2.5kVp CM
Static discharge (ESD)	IEC/EN 61000-4-2 Level 4	±8 kV contact ±15 kV air
Emitted HF field	IEC/EN 61000-4-3 Level 3	80...2700 MHz, 10 V/m
Fast transients (EFT)	IEC/EN 61000-4-4 Level 4	±4 kV, 5/50 ns, 5 kHz
Surge	IEC/EN 61000-4-5 Level 4	±4 kV, 1.2/50 µs, CM ±2 kV, 1.2/50 µs, DM
Conducted HF field	IEC/EN 61000-4-6 Level 3	0.15...80 MHz, 10 Vrms
Power-frequency magnetic field	IEC/EN 61000-4-8	300 A/m (continuous) 1000 A/m 1–3 s
Pulse magnetic field	IEC/EN 61000-4-9 Level 5	1000 A/m, 1.2/50 µs
ac and dc voltage dips	IEC/EN 61000-4-29, IEC/EN 61000-4-11	0% of rated voltage <ul style="list-style-type: none"> <li>ac: ≥0.5 cycle</li> <li>dc: ≥10 ms</li> </ul> 40% of rated voltage <ul style="list-style-type: none"> <li>ac: 10 cycles</li> <li>dc: 200 ms</li> </ul> 70% of rated voltage <ul style="list-style-type: none"> <li>ac: 25 cycles</li> <li>dc: 500 ms</li> </ul>
ac and dc voltage interruptions	IEC/EN 61000-4-29, IEC/EN 61000-4-11	100% interruption <ul style="list-style-type: none"> <li>ac: 250 cycles</li> <li>dc: 5 s</li> </ul>
Voltage alternative component	IEC/EN 61000-4-17	15% of operating voltage (dc)/10 min

## Mechanical robustness

	Standard and test class/level	Test value
<b>In operation</b>		
Vibrations	IEC 60255-21-1, Class III/IEC 60068-2-6, Fc	1 Gn, 10...150 Hz
Shocks	IEC 60255-21-2, Class III/IEC 60068-2-27, Ea	10 Gn/11 ms
Seismic	IEC 60255-21-3 Method A, Class II	2G horizontal/1G vertical, 1...35 Hz
<b>De-energized</b>		
Vibrations	IEC 60255-21-1, Class III/IEC 60068-2-6, Fc	2 Gn, 10...150 Hz
Shocks	IEC 60255-21-2, Class III/IEC 60068-2-27, Ea	30 Gn/11 ms
Bump	IEC 60255-21-2, Class III/IEC 60068-2-27, Ea	20 Gn/16 ms

## Electrical Safety

	Standard and test class/level	Test value
<b>In operation</b>		
Impulse voltage withstand	IEC/EN 60255-27	5 kV, 1.2/50 μs, 0.5 J 1 kV, 1.2/50 μs, 0.5 J Communication
Dielectric test	IEC/EN 60255-27	2 kV, 50 Hz 0.5 kV, 50 Hz Communication
Insulation resistance	IEC/EN 60255-27	
Protective bonding resistance	IEC/EN 60255-27	
Clearance and creepage distance	Design criteria for distances as per IEC 60255-27 Annex C (pollution degree 2, overvoltage category 3)	
Power supply burden	IEC 60255-1	

## Environmental tests

	Standard and test class/level	Test value
<b>In operation</b>		
Dry heat	EN/IEC 60068-2-2, Bd	70 °C (158 °F)
Cold	EN/IEC 60068-2-1, Ad	-40 °C (-40 °F)
Damp heat, cyclic	EN/IEC 60068-2-30, Db	From 25 °C (77 °F)...55 °C (131 °F) From 93% RH to 98% RH Testing duration: 6 days
Damp heat, static	EN/IEC 60068-2-78, Cab	40 °C (104 °F) 93% RH Testing duration: 10 days
Change of temperature	IEC / EN 60068-2-14, Nb	Lower temp -40 °C (-40 °F) Upper temp 70 °C (158 °F) 5 cycles
Flowing mixed gas corrosion test, method 1	IEC 60068-2-60, Ke	25 °C (77 °F), 75% RH, 21 days 100 ppb H <sub>2</sub> S, 500 ppb SO <sub>2</sub>
Flowing mixed gas corrosion test, method 4	IEC 60068-2-60, Ke	25 °C (77 °F), 75% RH, 21 days 10 ppb H <sub>2</sub> S, 200 ppb NO <sub>2</sub> , 10 ppb Cl <sub>2</sub> , 200 ppb SO <sub>2</sub>
<b>In storage</b>		
Dry heat	EN/IEC 60068-2-2, Bb	70 °C (158 °F)
Cold	EN/IEC 60068-2-1, Ab	-40 °C (-40 °F)

## Environmental conditions

Ambient temperature, in-service	-40 °C (-40 °F)...60 °C (140 °F) <sup>(1)</sup>
Ambient temperature, storage	-40 °C (-40 °F)...70 °C (158 °F)
Relative air humidity	< 95%, no condensation allowed
Maximum operating altitude	2000 m (6561.68 ft)

(1) with 1 x raising frame -> maximum ambient temperature 55 °C (+131 °F)  
with 2 x raising frame -> maximum ambient temperature 50 °C (+122 °F)

PowerLogic™ P3 Advanced can be connected to networks, providing access to the following type of data:

- Events
- Status information
- Measurements
- Control commands
- Clock synchronizing
- Settings (SPA-bus and embedded SPA-bus only)



EcoStruxure™ Power Device app

### Main Protocols

PowerLogic P3 Advanced can be connected directly to serial and/or Ethernet protocols with two different protocols at the same time, selected by eSetup Easergy Pro software.

Communication protocols:


#### Serial protocols - RS232/RS485/serial Fiber Optic (\*) port

- Modbus RTU
- DNP3.0
- IEC 60870-5-101
- IEC 60870-5-103
- ProfibusDP (\*)
- SPA-Bus (\*)

#### Ethernet protocols - RJ45/LC port

- IEC61850 ed1 & ed2
- Modbus TCP
- IEC60870-5-101
- DNP3.0
- Ethernet IP

Communication ports:

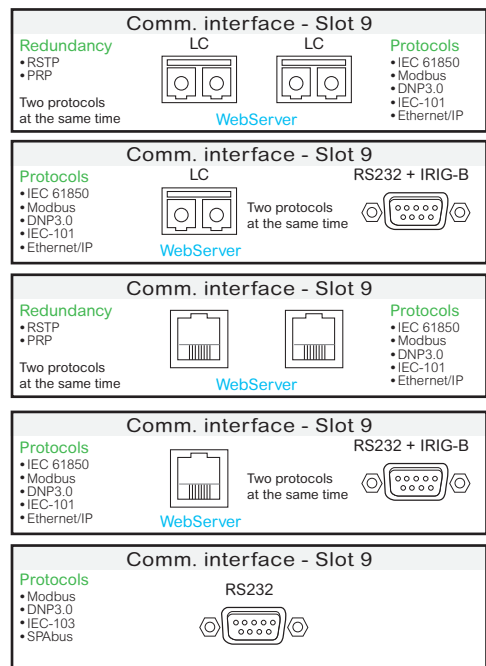


\*Need external accessories to connect.

### Redundancy Protocols (RSTP or PRP)

When the devices are connecting in Ethernet link and demand for higher availability, PowerLogic P3 Advanced can use Rapid Spanning Tree Protocol (RSTP) or Parallel Redundancy Protocol (PRP) to recover from a network failure.

### PowerLogic™ P3 Web-HMI

A webserver is available in all PowerLogic P3 Advanced to get information from the device to monitoring all data, send command and change protection setting.

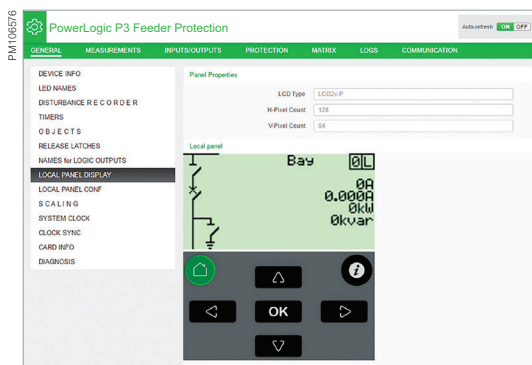

PowerLogic P3 web-HMI

# Programmable Stages


## Programmable Protection Function

### Personalize your Protection Function

PowerLogic P3 Standard enables you to create or personalize the protection function when you need to achieve specific levels of protection.

There are now eight stages available to use with various applications. Each stage can monitor any analog (measured or calculated) signal and issue start and trip signals. Programmable stages extend the protection functionality of the manager series to a new level. The Programmable stage has the possibility of comparing two freely selectable signals between each other. Using this feature, you can create a comparison function using the relay's own measured or calculated signals. One or both signals can be connected to the comparison function over GOOSE.

For example, if four stages of frequency are not enough, it is possible to reach a maximum of 12 using programmable stages. Other examples include using the stages to issue an alarm when there are too many harmonics (THD) or indicating reverse power condition by GOOSE.

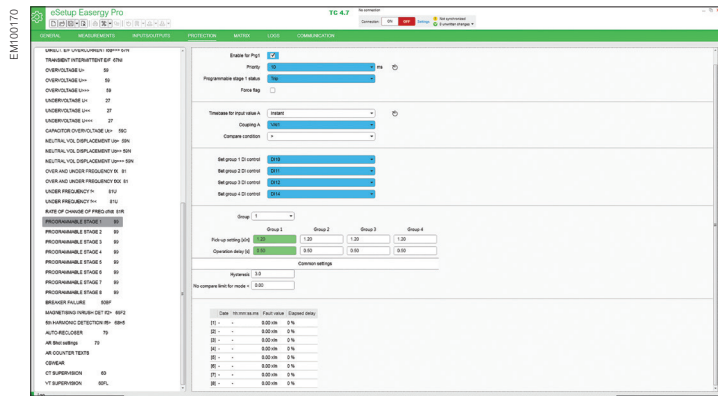

With PowerLogic P3 Advanced, you get intuitive functionality to protect your electrical network system.

Main CB functions are:

- Trip circuit supervision (ANSI 74)
- CT/VT supervision (ANSI 60/60FL)
- Latching (ANSI 86)
- CB close/open order
- Number of operations
- Circuit breaker operating time
- Charging time
- Cumulative breaking current
- Personalized functions

## Maximize Circuit Breaker Control


PowerLogic P3 Advanced is the simplest protection relay with mimic diagram with control buttons (open and close), two personalized function keys and 14 configurable bicolor LEDs. You can manage the control without external or additional components.


### Example of Implementation

The schematic is structured for typical use in MV switchgear, 100% adapted for your use case. You can change the internal logic to adapt the PowerLogic P3 to meet your needs.

If a problem occurs, clear and concise information allows users to make the right decisions at the right time.

This electrical schematic can facilitate the IEC 61850 implementation because all the logics are done by the protection unit that will make the decisions and, if necessary, send GOOSE messages to other units.

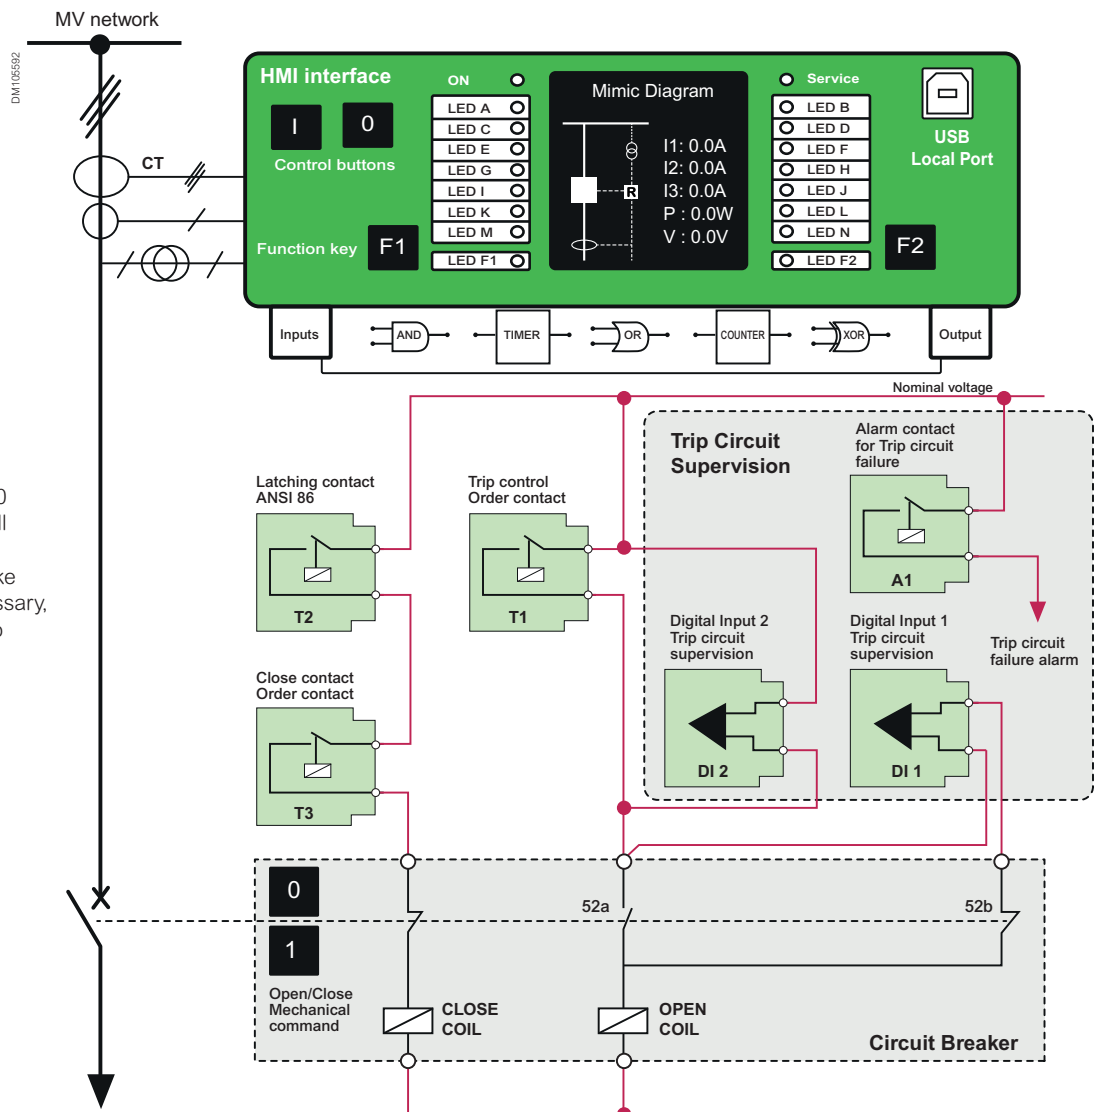

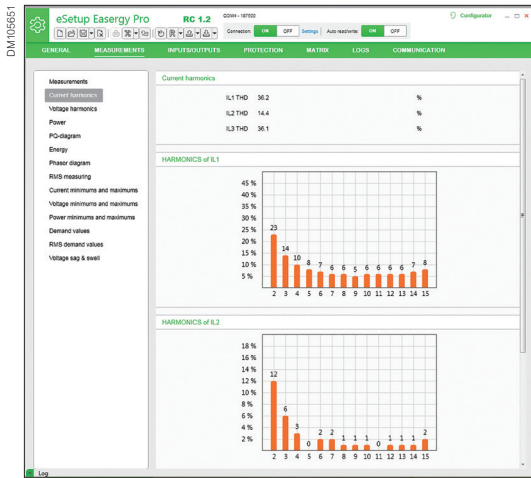

## Power Quality

The power quality of electrical networks has become increasingly important in modern society. Sophisticated loads, such as computers and automation systems, require an uninterrupted supply of “clean” electricity. PowerLogic P3 Advanced provides integrated power quality measuring and analysis functions, which help to reduce variations in the quality of the distributed power. The terminal supervises the harmonics of phase currents and voltages from the 2nd to the 15th order and the THD (total harmonic distortion).

One of the most important power quality functions is the monitoring of voltage sags and swells. PowerLogic P3 Advanced provides separate monitoring logs for sags and swells. The fault log comprises four registers for voltage sags and another four for voltage swells.


The disturbance recorder functionality can be used for recording measured currents and voltages and for recording status information of digital inputs and outputs, also including the signals of the arc protection system. The time stamped recordings provide indispensable information for the subsequent analysis of a fault situation.

### Example of harmonics content and voltage sag/swell registration (obtained from an PowerLogic P3 Advanced protection relay)


Many functions in modern society rely heavily on electrical energy, so the quality of the energy supply is gaining increased importance.

#### Power Quality Data in PowerLogic P3 Advanced

THD of IL1, IL2 and IL3	Total harmonic distortion of phase currents
H of IL1, IL2 and IL3	Harmonics phase current up to 15 <sup>th</sup>
THD of U	Total harmonic distortion of phase to phase or phase to ground voltages
H of U	Harmonic of phase to phase or phase to ground voltage up to 15 <sup>th</sup>
Sag and swell	
Voltage interruptions	

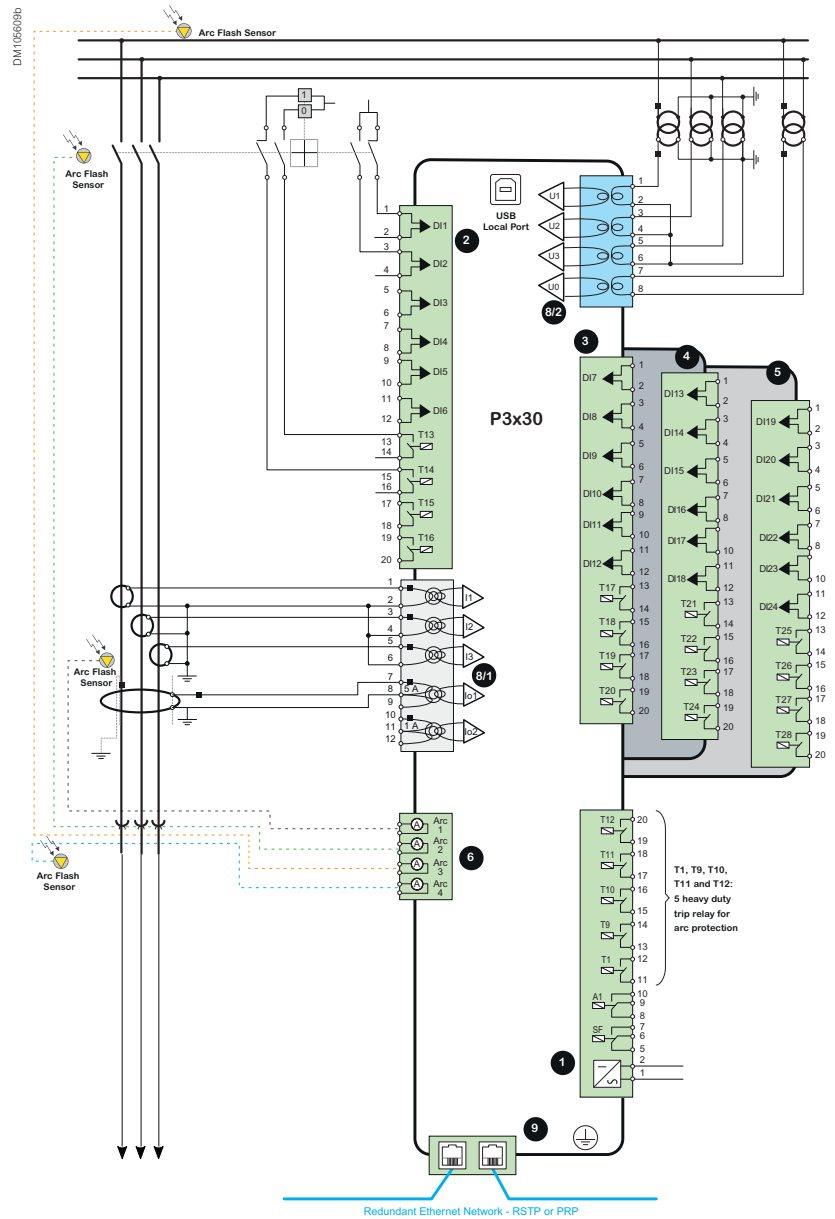


Note: Dangerous environment, make sure to read all information, including warning instructions (left).

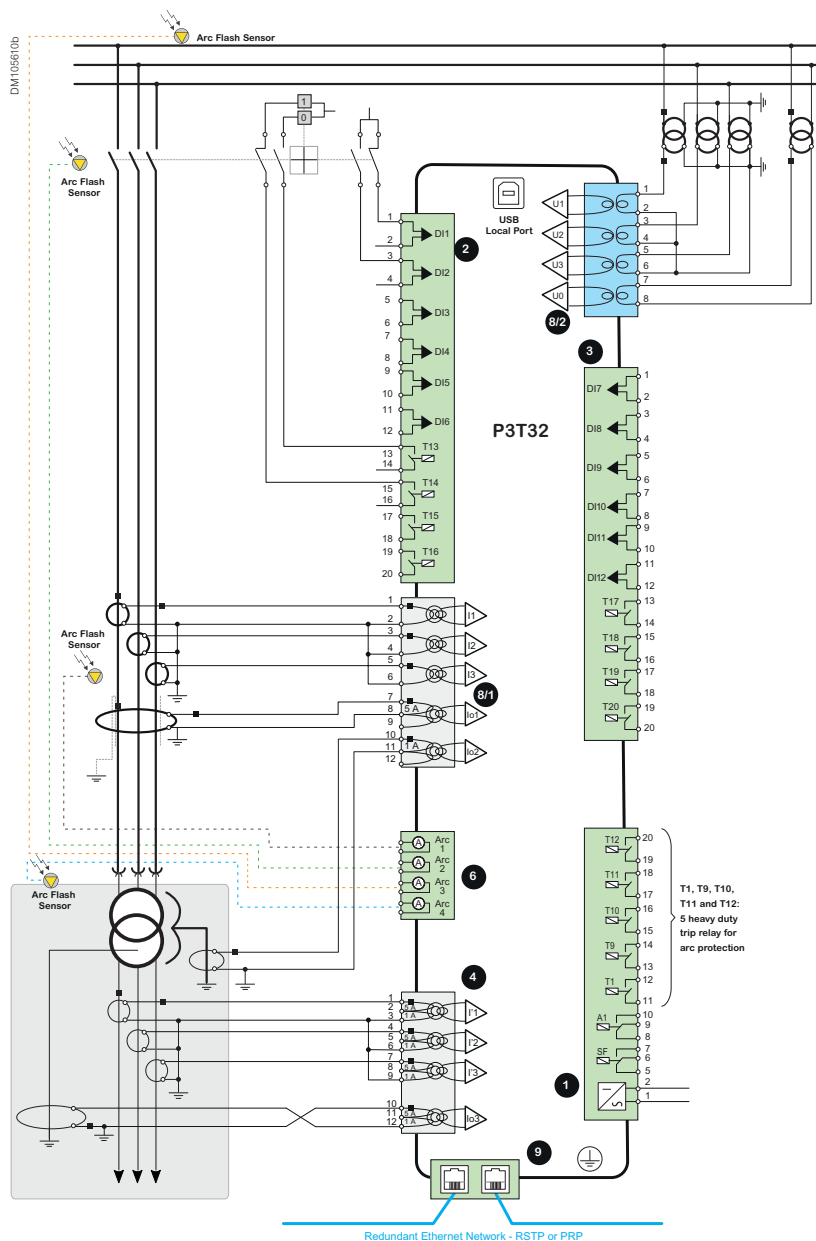

Note: Dangerous environment, make sure to read all information, including warning instructions (left).



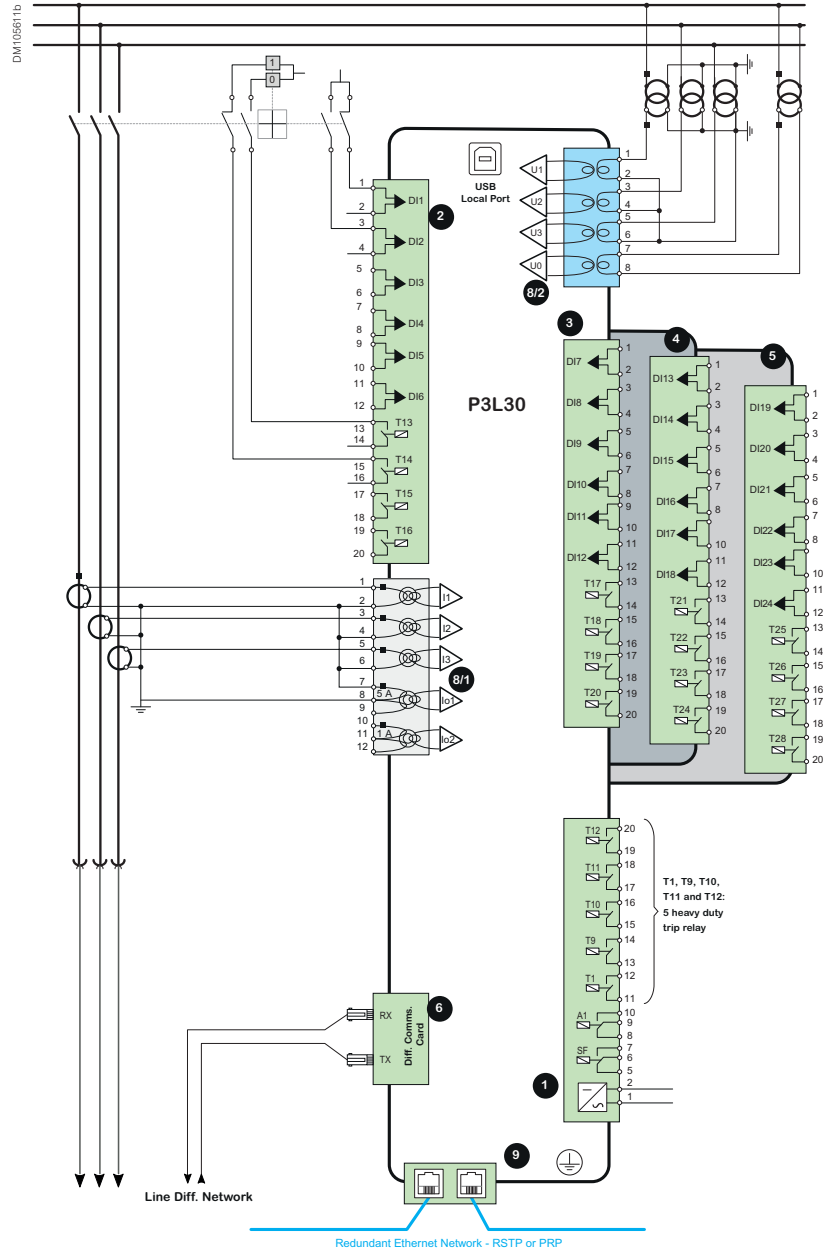

Note: Dangerous environment, make sure to read all information, including warning instructions (left).

# Model Selection

## Selecting Product

Please, consult the “Ordering” section to choose specific characteristics in the relays for your system:

	P3F30 Feeder Application	Page 119
	P3L30 Line Application	Page 120
	P3M30 Motor Application	Page 121
	P3G30 Generator Application	Page 124
	P3T32 Transformer with Differential Application	Page 123
	P3M32 Motor with Differential Application	Page 122
	P3G32 Generator with Differential Application	Page 125

Or use our web configuration tool:

[Go to web configurator](#)

Notes

---

# PowerLogic™ Digital experience

# PowerLogic™ Digital Experience

---

<b>PowerLogic™ P3 Software</b>	<b>84</b>
Presentation	84

---

<b>eSetup Easergy Pro</b>	<b>86</b>
eSetup Easergy Pro During Engineering	86
eSetup Easergy Pro During Commissioning	87
eSetup Easergy Pro During Operation	88

---

<b>PowerLogic™ Web-HMI</b>	<b>89</b>
----------------------------	-----------

---

<b>Mobile Application</b>	<b>90</b>
---------------------------	-----------

---

### Minimum requirements for running eSetup Easergy Pro:

- Windows 7 or higher
- 512 MB RAM
- 50 MB Disk space


## eSetup Easergy Pro

eSetup Easergy Pro offers full facilities to set up PowerLogic relays. Intuitive and simple, eSetup Easergy Pro is a user-oriented interface to assist you during the engineering, commissioning, and operation of PowerLogic protection relays. Its streamlined workflow and graphical representations has been designed to smooth your configuration process.


The software is available for download on the Schneider Electric website.



Use eSetup Easergy Pro in standalone mode during engineering to prepare the configuration.



Connect the PC running eSetup Easergy Pro to the USB port of the PowerLogic protection relay during commissioning to adjust the settings and test the relay.

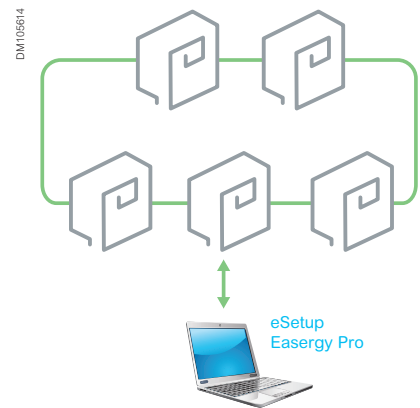

Connect the PC running eSetup Easergy Pro to the Ethernet network during operation to retrieve data from the relays and update the system.

*For connection to PowerLogic P3, use the REL52822 connection cord*

### eSetup Easergy Pro at Each Step of the Digital Life


DM105615



# eSetup Easergy Pro

## During Engineering

- Create the configuration of the PowerLogic P3 relay: select the appropriate options and receive the order code
- Set the characteristics of the CTs, VTs, or sensors connected to the relay, and select the protection functions that will be activated and their settings
- Build a specific logic, if required, using a graphic editor
- Map the digital inputs of the relay and different internal signals to the relevant functions, LEDs, and digital outputs, using a straightforward matrix format
- Draw the single-line diagram that will appear on the front display of the relay for switchgear control and select the measurements that will be displayed. If any, build the interlocking logic using a matrix format
- For IEC 61850 protocol, configure the data set and the report control blocks that will be published and select the GOOSE data to which you want to subscribe
- Complete the setting of additional functions (disturbance recorder, event logging system, clock synchronization, etc.).

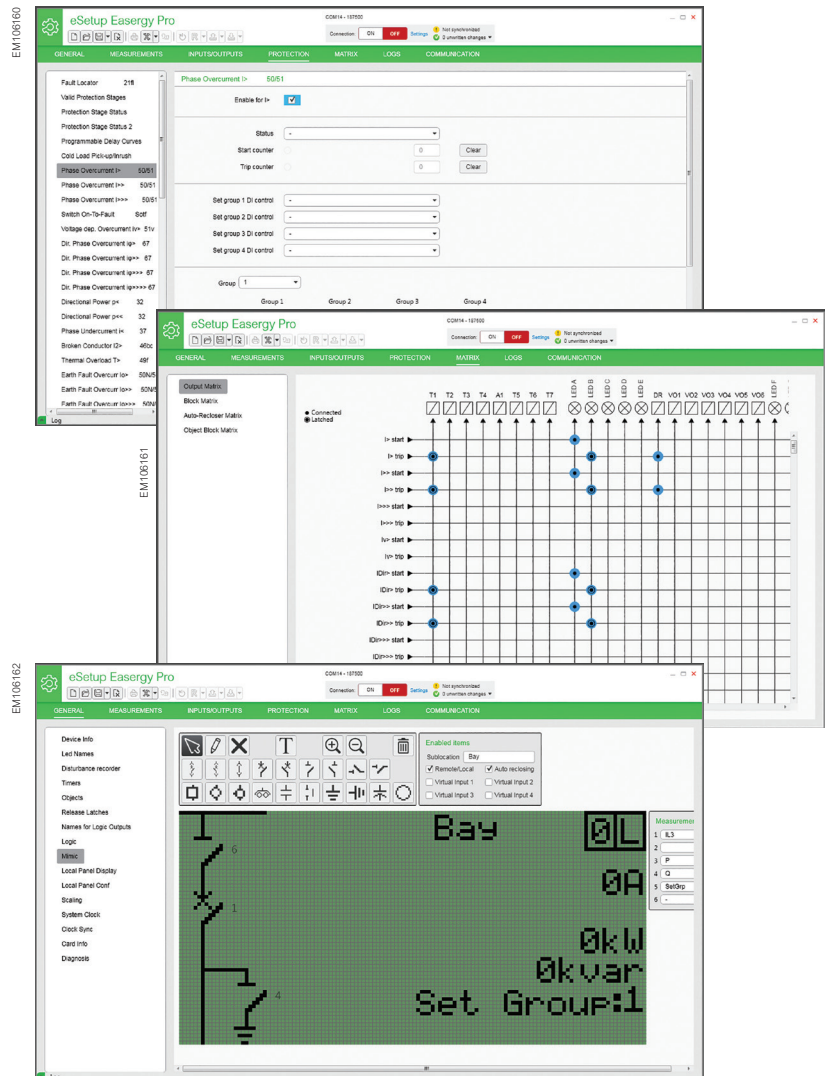



# eSetup Easergy Pro

## During Commissioning


- Connect to the front panel of one single relay or access several relays by connecting to Ethernet
- Open the Digital Inputs menu to check the status of inputs. Reverse the polarity or add a filtering delay if necessary
- Open the Relays menu and force the status change of the output relays to check the wiring
- Open the Phasor Diagram menu to see in real time the phasor of injected currents and voltages and the value
- Use virtual injection for testing protection settings and circuit breaker tripping and for checking LEDs and connected outputs
- Open the Logic or the Matrix menu if the logic needs to be tested. The active signals appear in a different color and are updated in real time. Changes in the logic or in the matrix can be made and applied to the relay smoothly.



# eSetup Easergy Pro

## During Operation

- Connect to the front panel of a single relay or gain access to several relays by connecting to Ethernet
- During normal operation, get the most of the metering capabilities of the PowerLogic protection relay:
  - Open the different Measurements menus to access the power monitoring and power quality data
  - Open the disturbance recorder menu to get a waveform capture or program the recording of a power trend
- After a trip, use eSetup Easergy Pro to understand the fault:
  - Check the fault log of the protection that has tripped the circuit breaker
  - Download the disturbance record from the PowerLogic P3 and display it with a disturbance recorder evaluation tool, eg. Wavewin.

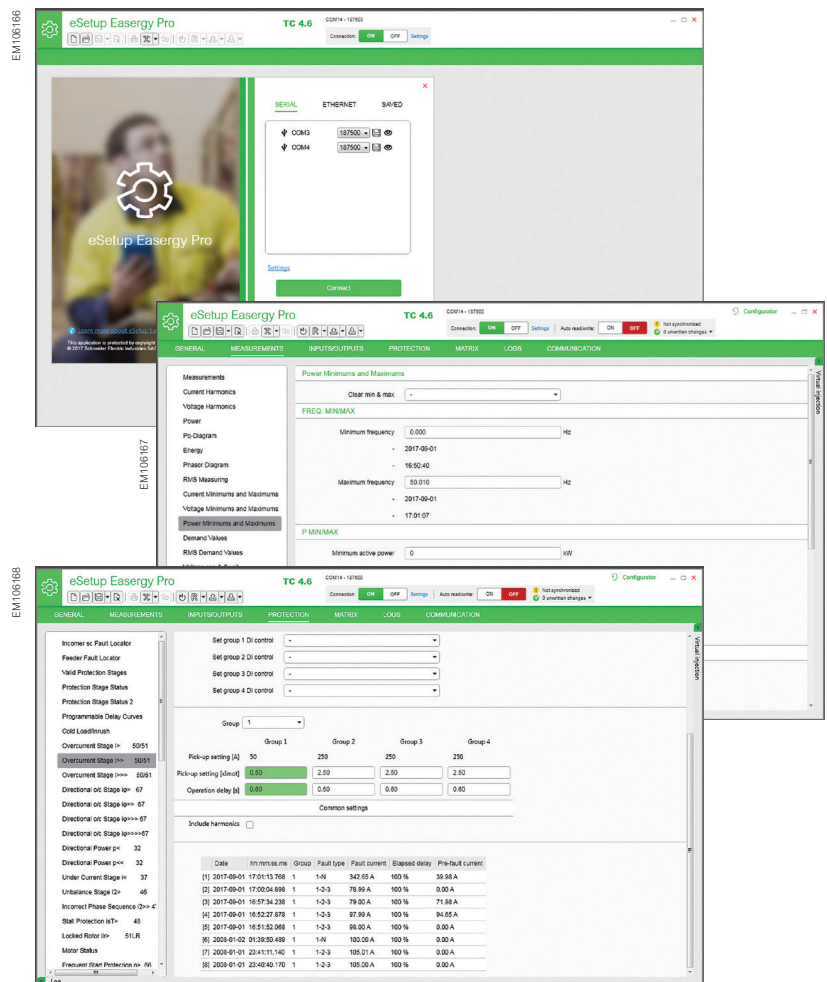


### Enhance operational efficiency

- Direct access to protection and communication settings
- Control and monitoring of circuit breakers and switches
- Mirror HMI function
- Direct access to measurements including the graphic phasors
- Device diagnosis
- MATRIX status
- Access to logs and other information

### Boost Operational Efficiency with the Embedded Web-HMI

Quickly and conveniently configure, monitor, and operate your PowerLogic P3 protection relay with our web-HMI. The web-HMI, accessible online via IP address of the relay, doesn't require you to install specific computer software—simply use your web browser to connect to the device. You only need to enable the web server

service during the initial configuration of PowerLogic P3 with eSetup Easergy Pro. The web-HMI is based on the same page design as eSetup Easergy Pro, making it easy to use!

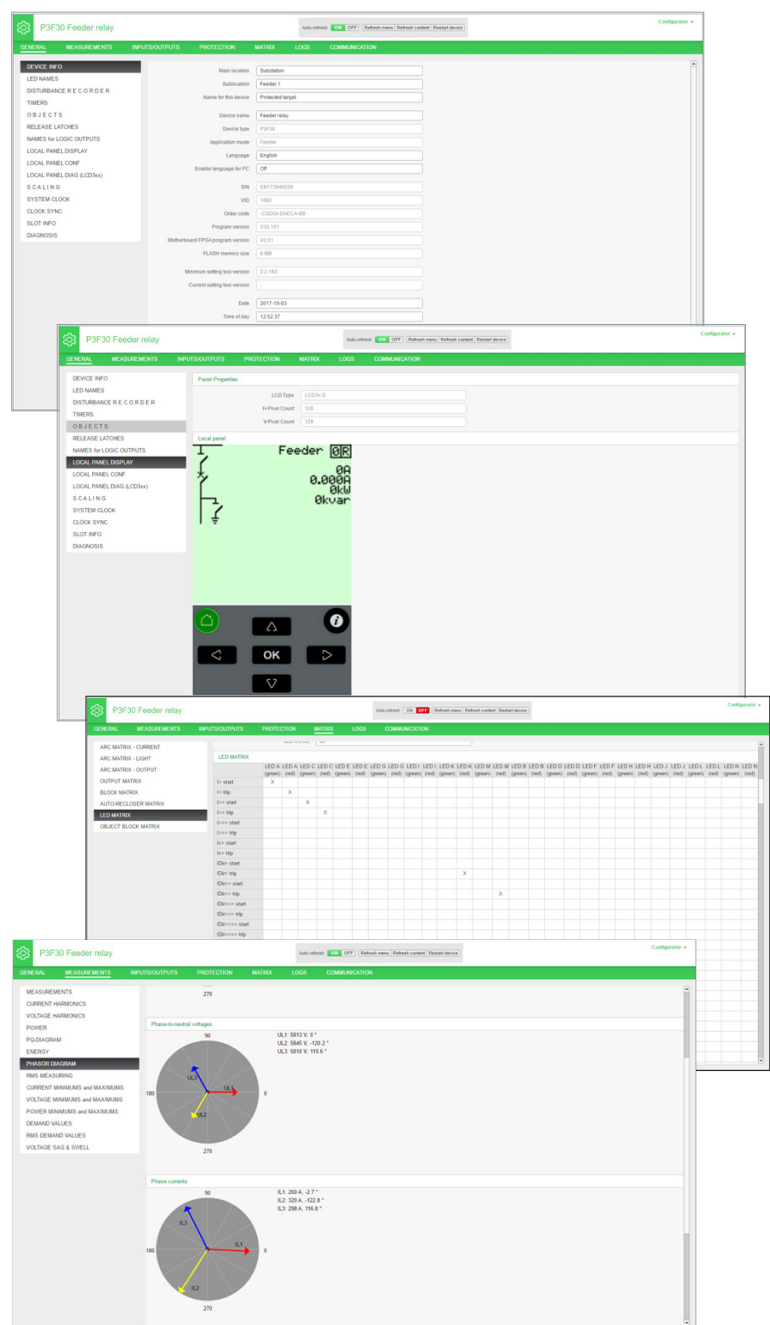

# Mobile Application

## Description



### EcoStruxure™ Power Device app

Within the palm of your hand, you can be connected to your Schneider Electric:

- Masterpact MTZ air circuit breaker
- TeSys GV4 motor circuit breaker
- PowerLogic P3 protection relays
- ... and more!

EcoStruxure Power Device app is a single mobile application with necessary information and capabilities to operate and efficiently maintain devices in the EcoStruxure architecture.

This app can be installed on your IOS and Android smartphone. The protection devices can be identified on the app by simply scanning their QR codes.


Wireless communication is possible via by WIFI, Bluetooth, NFC technologies for operation and monitoring within the proximity of the devices. Get real time notifications about the electrical installation: load levels, health status, warnings and alarms, protection settings...and more!

All you need is an EcoStruxure™ Power Device mobile application loaded either your Android or IOS platforms and a Bluefer wireless adapter (REL52850). Plug the adapter cable on the front of the PowerLogic P3, mount the unit with a magnet touch next to the relay and establish the wireless communications. Having done this then you can access to the main functions of the PowerLogic P3, utilize a cloud-based storage for events, alarms and share the device information with colleagues.

Free download  
EcoStruxure Power Device on:



**Mobile Device**  
for configuration and  
on-site monitoring

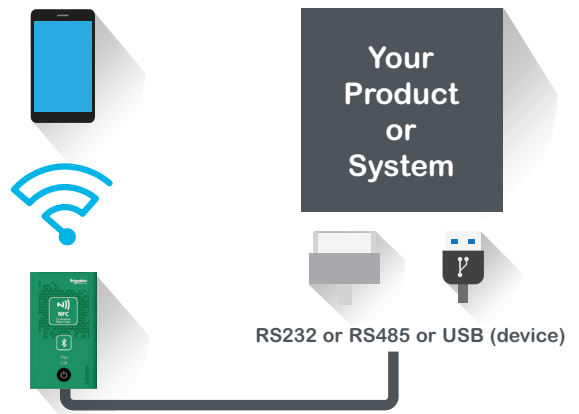

**BLUEFER**  
nomad wireless tool

RS232 or RS485 or USB (device)

Commercial reference	Host Protocols (Mobiles)			Target Protocols			Battery (Li-ION)
	NFC	Bluetooth (BLE)	WIFI	RS232	RS485	USB	
<b>BLUEFER: Nomad wireless adapter</b>							
REL52850	•	•		•	•	•	•

Notes

---

# Additional Modules and Accessories

# Additional Modules and Accessories

Connection Cables	94
Communication Modules	96
Temperature and Analogue Input and Output Modules	98
LPVT & LPCT Option	100
Arc Flash Sensors	102
Other Accessories	104

# Connection Cables

## Description

### Cables for PowerLogic™ P3 Standard

The cables can be used for connecting external option modules to the PowerLogic P3 Standard. The device is equipped with I/O communication model E or F, where RS232 interface is available.



#### REL52825 (VX082)

A remote port is available when a REL52825 cable is used. The cable contains a connector for the RS-232 interface of the PowerLogic P3 Standard and a D9-connector for the external option module.

Length	<b>2.5 m</b> (78.74 in)
--------	-------------------------



#### REL52827 (VX084)

The cable contains a connector for the RS-232 interface of the PowerLogic P3 Standard and a D9-connector for the REL52815 Profibus interface module. An extension port is available for the REL52827 in PowerLogic P3 Standard.

Length	<b>3.0 m</b> (118.11 in)
--------	--------------------------



#### REL52826 (VX083)

Remote and extension ports are available, in addition to IRIG-B clock synchronization, when the REL52826 cable is used. The REL52826 cable contains a connector for the RS-232 interface of the PowerLogic P3 Standard and a 3-piece D9-connector for the external option module and IRIG-B.

Length	<b>2.5 m</b> (78.74 in)
--------	-------------------------



# Connection Cables

## Description

### Cables for PowerLogic™ P3 Advanced

The cables can be used for connecting external option modules to the PowerLogic P3 Advanced. The device is equipped with I/O communication model B, C or D, where RS232 interface is available.



#### REL52823 (VX067)

Remote and extension ports are available when the REL52823 cable is used. The REL52823 cable contains a connector for the RS232 interface of PowerLogic P3 Advanced and 2-piece D9-connector for the external option modules.


Length	<b>3.0 m</b> (118.11 in)
--------	--------------------------



#### REL52838 (VX086)

Remote and extension ports are available in addition to IRIG-B clock synchronization when the REL52838 cable is used. The REL52838 cable contains a connector for the RS232 interface of PowerLogic P3 Advanced and 3-piece D9-connector for the external option modules and IRIG-B.

Length	<b>3.0 m</b> (118.11 in)
--------	--------------------------

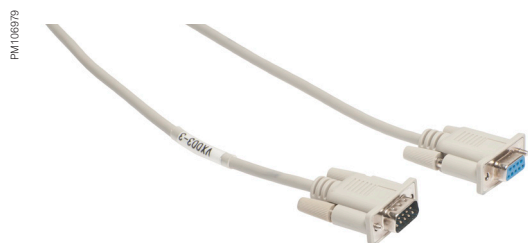

#### REL52824 (VX072)


The cable contains a connector for the RS232 interface of PowerLogic P3 Advanced and D9-connector for the REL52815 Profibus interface module. An extension port is available for the REL52824 in PowerLogic P3 Advanced.

Length	<b>3.0 m</b> (118.11 in)
--------	--------------------------

### Cables for all PowerLogic™ P3 models

#### Front face USB Cable - REL52822 (VX052-3)

The PowerLogic P3 protection relays have a USB-connector in the front panel. Use eSetup Easergy Pro setting software with USB cable to set the device.

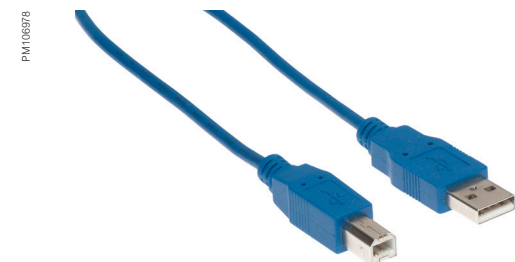

Length	<b>3.0 m</b> (118.11 in)
--------	--------------------------

# Communication Modules

## Network Interface Modules

PM106581



### RS232 to RS485 network - REL52820

The external RS485 interface REL52820 is used to connect PowerLogic P3 devices to the RS485 network. With the RS485 serial interface module it is possible to have following serial protocols in use.

#### Characteristics

Distance (maximum)	200 m (7,874.02 in)
Devices (maximum)	32
Type of fiber optic connector	PIN (3)
Type of RS232 connector	9-pin DSUB connector
RS485 type	2-wire
Serial protocols	Modbus, DNP3.0, IEC870-5-103 and SpaBus
Power supply	From RS232 port or external-12 Vdc

To connect the interface with:

PowerLogic P3 Standard devices, use REL52825 cable

PowerLogic P3 Advanced devices, use REL52823, REL52824 or REL52838 cable if needed

PM106586



### RS232 to fiber optic network - REL52816 to REL52819

An external fiber optic interface is used to connect PowerLogic P3 devices to a fiber optic loop or a fiber optic star network. The options include two different types of serial fiber optic modules.

Characteristics	REL52819	REL52816
Distance (maximum)	30 m (1,181 in)	1,000 m (39,370 in)
Type of fiber optic	Plastic-Plastic	Glass-Glass
FO diameter	1 mm	62.5/125 uM
Devices (maximum)	32	32
Type of fiber optic connector	HP Versalink Snap-in connector	ST
Interface	9-pin DSUB connector	
Serial protocols	Modbus, DNP3.0, IEC870-5-103 and SpaBus	
Power supply	From RS232 port or external-12 Vdc	

To connect the interface with:

PowerLogic P3 Standard devices, use REL52825 cable

PowerLogic P3 Advanced devices, use REL52823, REL52824 or REL52838 cable if needed

PN1006565



### Profibus network interface - REL52815

External Profibus interface REL52815 is used to connect PowerLogic P3 devices to the Profibus network.

#### Characteristics

Interface	9-pin DSUB connector (Female)
Transfer method	RS485, Half-duplex
Transfer cable	Twisted pair (1 pair and shield)
Electrical isolation	500 Vdc
Serial protocols	Profibus DP
Baud rate	9.6 kBaud...12 Mbaud
Power supply	
PowerLogic P3 Standard:	External-12 Vdc
PowerLogic P3 Advanced:	From RS232 port or external-12 Vdc

To connect the interface with:

PowerLogic P3 Standard devices, use REL52827 cable

PowerLogic P3 Advanced devices, use REL52824 cable

# Temperature and Analog Input/Output Modules

For PowerLogic™ P3

The temperature module is supplied ready for operation with:

- PowerLogic P3U20, P3U30 with RS485 communication port direct
- PowerLogic P3U20, P3U30, and P3X3x with RS232 communication port by REL52820 external RS485 interface
- PowerLogic P3U20, P3U30, and P3X3x with RS232 communication port by REL52816 to REL52819 external fiber optic interface

## Function




The temperature modules can be used to connect temperature sensors from the field to the PowerLogic P3 devices using a communication port RS485 by twist-pair or fiber optic.

The temperature measurement is utilized by the following protection functions in transformer and motor application:

- Thermal overload
- Temperature monitoring
- Customized logic or custom protection function

The modules REL52813 and REL52814 have analog input and output to use in the special control functions.

DM105628

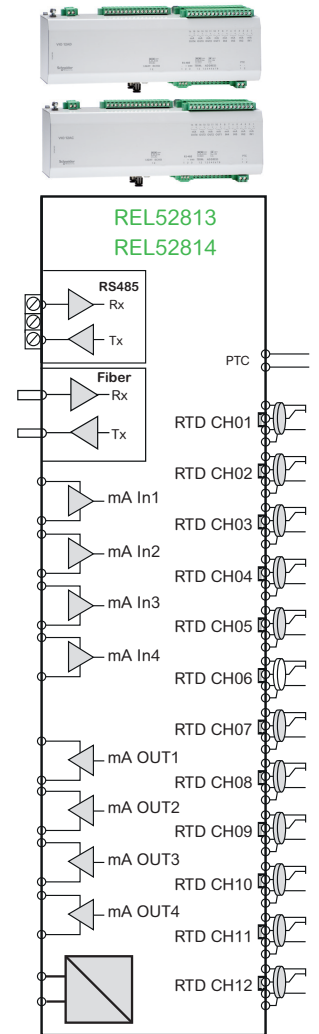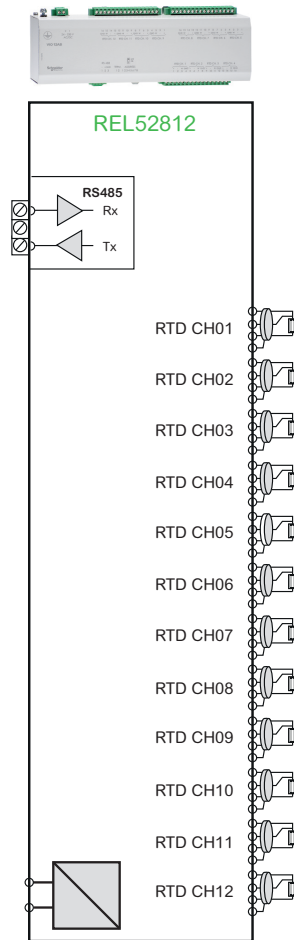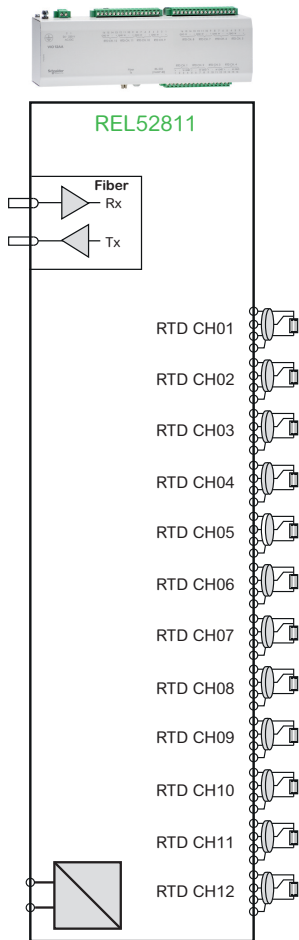

# Temperature and Analog Input/Output Modules

For PowerLogic™ P3

Temperature input modules – REL52811/REL52812/REL52813/REL52814				
Characteristics	REL52811	REL52812	REL52813	REL52814
Interface	Glass fiber (ST)	RS485 Twisted Pair	Glass fiber (ST) OR RS485, TP	
Distance (maximum)	2,000 m (78,740 in)	1,200 m* (47,244 in)	2 000 m/1 200 m*	
Quantity of Temperature sensors	12 channels, 3-wire		12 channels, 3-wire and 1 PTC channel 2-wire	
Supported RTD types	Pt100, Ni00, Ni120 and Cu10			
Measuring range	1...400 Ohm			
Measuring resolution	0.10 Ohm			
Measuring accuracy	±0.3 Ohm			
Sensor distance	50 Ohm (corresponds to 2 000 m at 0.75 mm <sup>2</sup> )			
Power Supply	24...230 Vac/dc 50/60 Hz		24 Vdc	48...230 Vac/dc 50/60 Hz
Operating Temperature	0 °C (32 °F)...55 °C (131 °F)			
Mounting Type	DIN Rail			
Degree of protection	IP20			

\* The value may decrease according to the conditions of use


Analog Input / Output modules–REL52811/REL52812/REL52813/REL52814				
Characteristics	REL52811	REL52812	REL52813	REL52814
Analog Input (mA)	0	0	4	4
Input Range	-	-	0...25 mA	0...25 mA
Input accuracy	-	-	±1%	±1%
Input resolution	-	-	6uA (12-bits)	6uA (12-bits)
Input impedance	-	-	100 Ohm	100 Ohm
Analog Output (mA)	0	0	4	4
Output range	-	-	0...25 mA	0...25 mA
Output accuracy	-	-	±1%	±1%
Output resolution	-	-	6uA (12-bits)	6uA (12-bits)
Galvanic isolation	-	-	1000 V	1000 V
Max. Load/output	-	-	750 Ohm	750 Ohm
PTC Input	-	-	1	1
Measuring accuracy	-	-	±10% (<10 kohm)	±10% (<10 kohm)

\* The value may decrease according to the conditions of use

# LPVT & LPCT Option

For PowerLogic™ P3 and Accessories

## LPCT/LPVT Option in PowerLogic™ P3

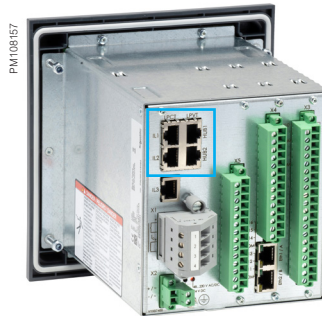

PowerLogic P3 Standard



PowerLogic P3 Advanced

### LPCT inputs

Nominal current	2.5 A...20 kA
Rated frequency	50 Hz or 60 Hz
LPCT rated nominal current	25, 50, 80, 100 A
LPCT rated primary current	10 A...5 kA
LPCT rated secondary current	22.5 mV
Current factor	0.25; 0.50; 1.00; 1.25; 1.33; 2.00; 2.50; 3.20; 4.00; 5.00; 6.30; 6.66; 10; 16; 20; 25; 31.5
Dynamic	45 x nominal current
Protection nominal current	51...1600 A
Input impedance	2 MOhms/500 pF
Thermal withstand	60 V

### LPVT inputs

Nominal voltage	50 V...500 kV
Rated frequency	50 Hz or 60 Hz
LPVT rated primary voltage	50 V...500 kV
LPVT rated secondary voltage	3.25 V/√3
Voltage factor	0.25–1.5
Rated voltage	3.25 V/√3
Extender rated voltage	10 MOhms/15 pF
Input impedance	0.25–1.5 rated voltage
Thermal withstand	25 V

# LPVT & LPCT Option

For PowerLogic™ P3 and Accessories

## LPVT Hub Connector

### EMS59573: LPVT hub connector

The LPVT hub connector is a simple passive device that combines three LPVT signals coming from 3 different connectors into one single RJ45 connections.

The output of the LPVT hub connector is directly connected to the LPVT input of the PowerLogic P3 protection relay.

This accessory is indispensable when connecting PowerLogic P3 Protection relays to LPVTs.

#### Characteristics

Input voltage	<10 V
Input voltage limits	<30 V
Network frequency	50/60 Hz
Electrical connection	output: RJ45 connector inputs: 3 x RJ45 connectors
Dimension (L x W x H)	95 x 40 x 40 mm (3.74 x 1.57 x 1.57 in)
Weight	0.25 kg (0.55 lb)
Mounting support	DIN Rail
Operating altitude	≤3000 m (1.86 miles)

## Voltage Adapter

### EMS59572: Voltage adapter<sup>(1)</sup>

The voltage transformer adapter is made with 4 resistor bridges used to interface conventional voltage transformers (VTs) with the PowerLogic P3 protection relay equipped for LPCT/LPVT sensors.

#### Characteristics

Input voltage	50...200 Vac (line-to-line)
Voltage max	600 V max permanent
Network frequency	50/60 Hz
Weight	0.15 kg (0.33 lb)
Mounting support	Symmetrical DIN Rail

<sup>(1)</sup> Contact us for availability

PM1106130



PM1106126



# Arc Flash Sensors


For PowerLogic™ P3 Advanced only

## Sensors Description



The sensor is used by an arc flash protection device (PowerLogic P3 Advanced) or system to detect the light coming from the arc flash incident.

The PowerLogic P3 Advanced arc sensor is activated by strong light. The sensor transforms the light information into the current signal, which is used by the protection device to indicate arc flash.


Arc flash sensors												
Commercial references / Characteristics	REL52801	REL52802	REL52803	REL52804	REL52805	REL52806	REL52839	REL52840	REL52807	REL52808	REL52809	REL52810
Type	Standard								Pipe			
VID	VA1DA-20	VA1DA-20S-HF	VA1DA-20S	VA1DA-6	VA1DA-6S-HF	VA1DA-6S	VA1DA-6W	VA1DA-20W	VA1EH-20	VA1EH-20S	VA1EH-6	VA1EH-6S
Weight	1,000 g 2.20 lb	1,300 g 2.87 lb	1,300 g 2.87 lb	300 g 0.66 lb	400 g 0.88 lb	400 g 0.88 lb			1,000 g 2.20 lb	1,300 g 2.87 lb	300 g 0.66 lb	400 g 0.88 lb
Cable length (m)	20	20	20	6	6	6	6	20	20	20	6	6
Shielded cable	-	●	●	-	●	●	●	●	-	●	-	●
Halogen free	-	●	-	-	●	-	-	-	-	-	-	-
Shield earthing		device end	device end		device end	device end	sensor end	sensor end		device end		device end
Environment	Pollution Degree 2											
Operation temperature	-25 °C (-13 °F)...+70 °C (+158 °F)											
Light spectrum sensitive area	400...1100 nm											
Detection time	1 ms											
Light sensitivity	8 000...10000 lux											
Loop supervision	Yes											

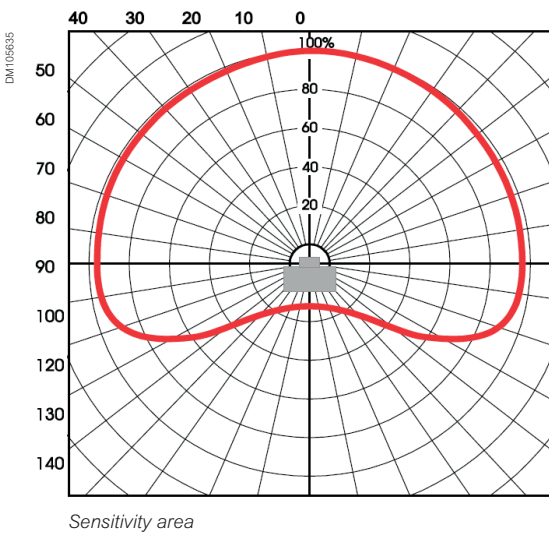

REL52801-52806 dimensions

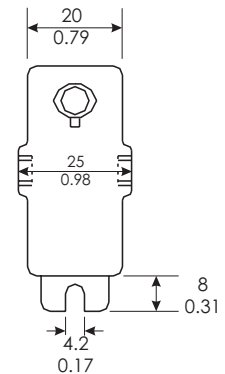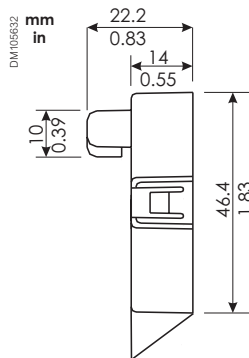

REL52807-52810 dimensions

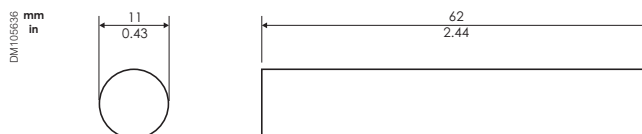

Arc Flash sensor: Pipe type




# Arc Flash Sensors


For PowerLogic™ P3 Advanced only

## Direct Mounting on Switchgear


Setting the light sensor in the switchgear requires either special supports type REL52828 (mounting plate for sensor Z-shape) or REL52829 (mounting plate for sensor L-shape), or it can be mounted in customer drilled holes.

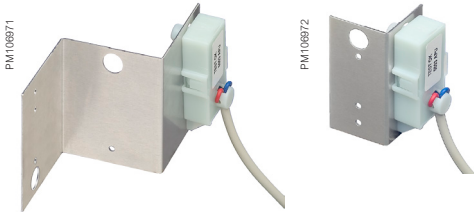

### Before

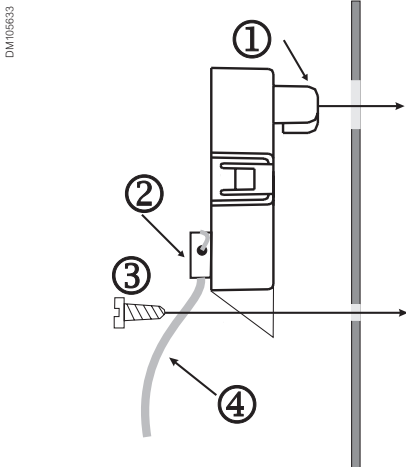


### After

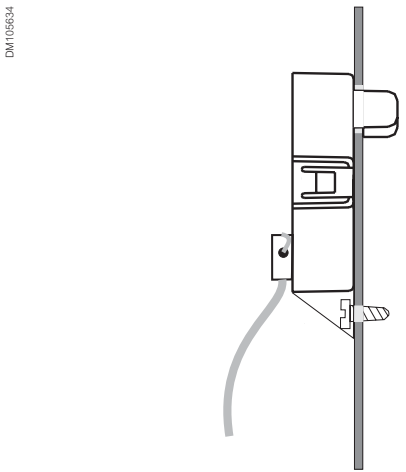


## Mounting Options

### REL52829 dimensions

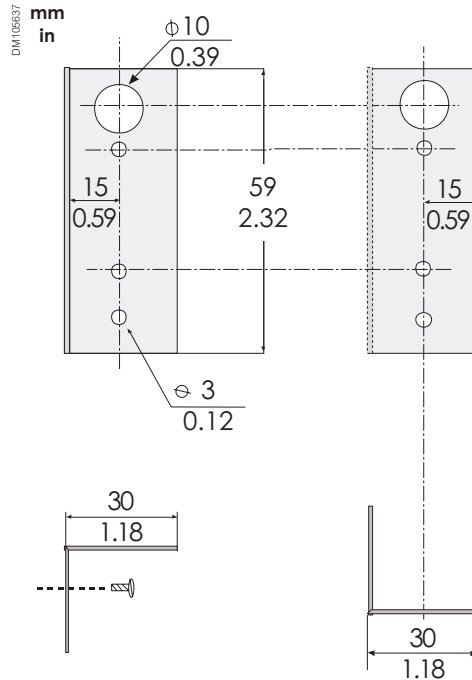

Mounting plate  
for sensor L-shape

### REL52828 dimensions

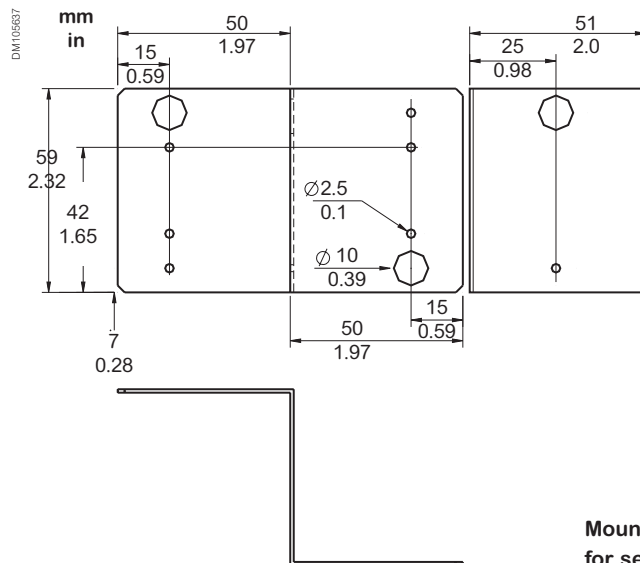

Mounting plate  
for sensor Z-shape

## Other Accessories

For PowerLogic™ P3

### Wall Mounted Adapter

#### REL52836: P3UWAF Wall mounted adapter

The P3UWAF wall assembly frame, REL52836, enables mounting P3Ux models on the wall. By removing one of the hinge bolts, the frame can be turned 90 degrees for easier access to connections.



P3UWAF Wall mounted adapter



P3UWAF Wall mounted adapter + PowerLogic™ P3Ux

#### REL52842: P3XPAF Wall mounted adapter

The P3XWAF wall assembly frame, REL52842, enables mounting P3x3x and V321 models on the wall. By removing one of the hinge bolts, the frame can be turned 90 degrees for easier access to connections.



P3XPAF Wall mounted adapter



P3XPAF Wall mounted adapter + PowerLogic™ P3x3x

## Other Accessories

For PowerLogic™ P3

### Arc Flash Cables

#### REL52839 and REL52840: Arc Flash cables

The VA1DA-6W (REL52839) and VA1DA-20W (REL52840) sensors have shield grounding termination at the sensor end.

PM100158




Arc Flash cable

### Panel Seal Cover

#### REL52833: P3UPSC Panel seal cover

The P3UPSC panel seal cover, REL52833, enables using a mechanical seal or lock to prevent unwanted operation of the device. With the seal cover, only the “User” user account can be used. The cover disables the front USB interface as well.

REL52833

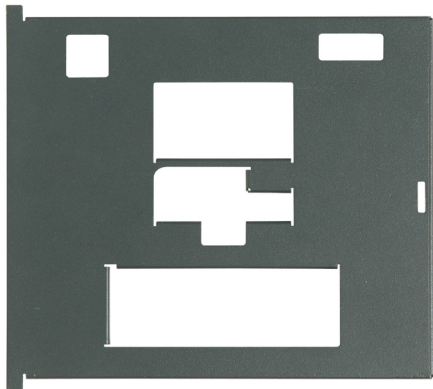

P3UPSC Panel seal cover

### Accessories Components Cover

#### REL52837: P3UPAV200 Adapter plate

#### REL52844: P3UPAVS40 Adapter plate

The REL52844 adapter plate is specifically designed for installing a P3Ux relay in the cut-out of Vamp 200 series relays.

Similarly, the REL52837 adapter plate can be used to install a P3U relay in the cut-out of Sepam 20/40 series. This adapter plate consists of adapter plate, rubber seal, support plates and nuts.

PB124827



Accessories Components Cover

# Schneider Electric Service

# Schneider Electric Service

---

Greater Peace of Mind Throughout your Installation Lifecycle	108
Product Warranty	109
Achieve Higher Sustainability with ECOFIT™ Solutions	110
Environmental Information with Green Premium™ Ecolabel	111

---


# Greater peace of Mind Throughout your Installation Lifecycle

## How can you cut costs and improve performance at the same time?

When it comes to your electrical distribution infrastructure, the answer is straightforward: get professional expertise.

### Life cycle services

DM109543

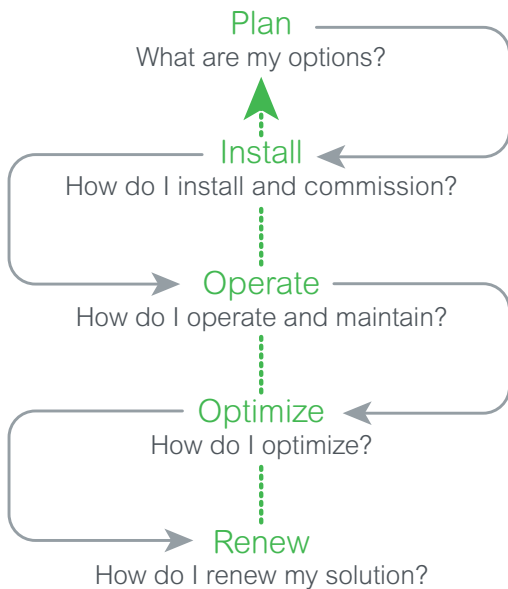

## When it comes to your electrical distribution installation, we can help you:

- Increase productivity, reliability and safety
- Mitigate risk and limit downtime
- Keep equipment up to date and extend lifespan
- Cut cost and increase savings
- Improve your return on investment

### CONTACT US!

<https://www.se.com/in/en/work/services/>

## Plan

Schneider Electric helps you plan the full design and execution of your solution, looking at how to make your process more dependable and optimize time:

- **Technical feasibility studies:** Design solution in your environment
- **Preliminary design:** Accelerate turnaround time to reach a final solution design.

## Install

Schneider Electric will help you to install more efficient, more reliable, and safer solutions based on your plans.

- **Project management:** Complete your projects on time and within budget
- **Commissioning:** Ensure your actual performance versus design, through on-site testing and commissioning, and tools and procedures.

## Operate

Schneider Electric helps you maximize your installation uptime and control your capital expenditures through its services offering.

- **Asset operation solutions:** Provide the information you need to increase safety, enhance installation performance, and optimize asset maintenance and investment
- **Advantage service plans:** Customize service plans that include preventive, predictive and corrective maintenance
- **On-site maintenance services:** Deliver extensive knowledge and experience in electrical distribution maintenance
- **Spare parts management:** Ensures spare parts availability and optimized maintenance budget of your spare parts
- **Technical training:** Builds necessary skills and competencies to properly and safely operate your installations.

## Optimize

Schneider Electric proposes recommendations for improved safety, availability, reliability and quality.

- **MP4 electrical assessment:** Define an improvement and risk management program.

## Renew

Schneider Electric's end-of-life solutions may extend the life of your system while providing upgrades. Under specific service agreements, our service team can take full responsibility for the end-of-life processing of old electrical equipment:

- **Retrofit:** Keep up to date and improve the performance of electrical installations
- **MV product end-of-life:** Recycle and recover outdated equipment with end-of-life services.

DM107178



## Product Warranty

Standard Warranty for this offer is 2 years. However, this warranty period may be feasible to be extended in certain geographies. Please check with your local Schneider Electric representative for extended warranty availability and specific conditions.

# Achieve Higher Sustainability with ECOFIT™ Solutions




Modernizing and upgrading your medium voltage switchgear doesn't need to mean your existing infrastructure is destructed.

Schneider Electric retrofit solutions, combined with proper switchgear maintenance helps you to improve the reliability of your installation while achieving higher sustainable performance with ECOFIT™-a Green Premium™ service.

## ECOFIT™ for your MV Switchboard

- Extend your switchgears lifetime
- Access asset and energy management with digitization
- Reduce your environmental impact
- Enhance your process dependability
- Optimize your maintenance service costs and limit your investment
- New ECOFIT™ spare parts availability.

### A true extended lifetime with ECOFIT™

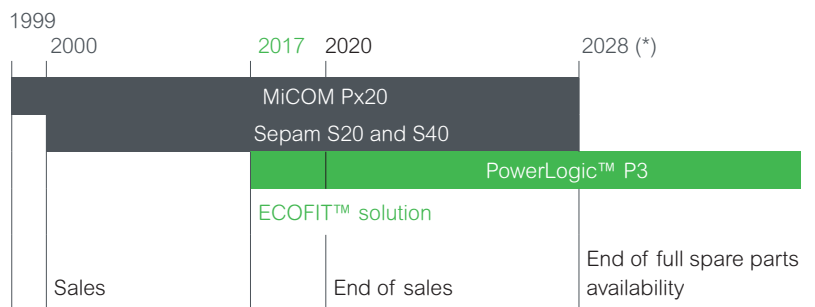


(\* Please consult Schneider electric

### ECOFIT™ offers:

	Sepam S20	Sepam S40	MiCOM Px20	PowerLogic™ P3
Case	Flush mounting	Flush mounting	Flush mounting	Flush mounting
Installation	Fix	Fix	Withdrawable case	All terminals pluggable in PowerLogic P3 Standard DI, DO and V terminals pluggable in PowerLogic P3 Advanced
Language	Multilanguage	Multilanguage	Multilanguage	Multilanguage
Communication	IEC 60870-5-103 DNP3 Modbus serial	IEC 61850 Station bus IEC 60870-5-103 DNP3 Modbus serial Modbus Ethernet	Modbus serial Kbus Courier IEC60870-5-103 DNP3	IEC 61850 Ed.1 & Ed.2 IEC 60870-5-103 & 101 IEC 60870-5-101 Ethernet DNP3 Ethernet and Serial Modbus Ethernet and Serial EtherNet/IP SPA, Profibus
Power supply	24...250 Vdc 48...240 Vac	24...250 Vdc 48...240 Vac	24...250 Vdc 48...240 Vac	24...57 Vdc 80...265 Vdc/ac
Control LED	11 LEDs	11 LEDs	8 LEDs	P3 Standard: 12 LEDs P3 Advanced: 18 LEDs
Cyber security	No	No	No	Numerical password, 32 digits
Arc-flash	No	No	No	P3 Advanced: 1, 2, 4, 5 or 6 sensors
Back up memory	No	No	No	No
Compatibility with	P3 Standard: S20/S24/T20/T24/B21/B22 /M20	P3 Standard / Advanced: S40/S41/S42/S43/S44/ T40/T42/M40/M41/G40	P3 Standard: P120/P121/P122/P123/ P921/P922/P923/P721/ P723/P920 P3 Standard / Advanced: P126/P127/P225/P521/ P220/P125	



# Environmental Information with Green Premium™ Ecolabel

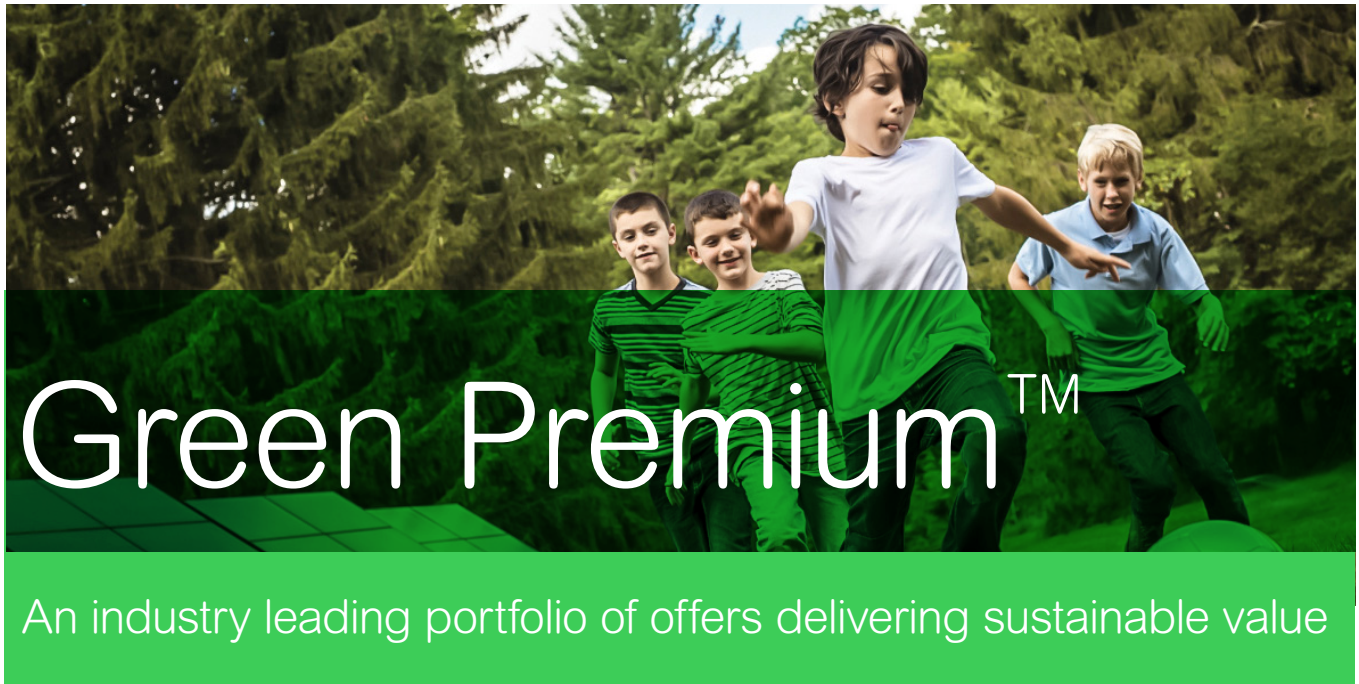

More than 75% of our product sales offer superior transparency on the material content, regulatory information and environmental impact of our products:

- RoHS compliance
- REACH substance information
- Industry leading # of PEP's\*
- Circularity instructions



Discover what we mean by green  
**Check your products!**

The Green Premium program stands for our commitment to deliver customer valued sustainable performance. It has been upgraded with recognized environmental claims and extended to cover all offers including Products, Services and Solutions.

#### CO<sub>2</sub> and P&L impact through... Resource Performance

Green Premium brings improved resource efficiency throughout an asset's lifecycle. This includes efficient use of energy and natural resources, along with the minimization of CO<sub>2</sub> emissions.

#### Cost of ownership optimization through... Circular Performance

We're helping our customers optimize the total cost of ownership of their assets. To do this, we provide IoT-enabled solutions, as well as upgrade, repair, retrofit, and remanufacture services.

#### Peace of mind through... Well-being Performance

Green Premium products are RoHS and REACH compliant. We're going beyond regulatory compliance with step-by-step substitution of certain materials and substances from our products.

#### Improved sales through... Differentiation

Green Premium delivers strong value propositions through third-party labels and services. By collaborating with third-party organizations we can support our customers in meeting their sustainability goals such as green building certifications.

\*PEP: Product Environmental Profile (i.e. Environmental Product Declaration)

# Ordering

# Ordering

---

<b>Fast Ordering Code</b>	<b>114</b>
<hr/>	
<b>PowerLogic™ P3 Standard</b>	<b>117</b>
PowerLogic™ P3U20 configuration	117
PowerLogic™ P3U30 configuration	118
<hr/>	
<b>PowerLogic™ P3 Advanced</b>	<b>119</b>
PowerLogic™ P3F30 configuration	119
PowerLogic™ P3L30 configuration	120
PowerLogic™ P3M30 configuration	121
PowerLogic™ P3M32 configuration	122
PowerLogic™ P3T32 configuration	123
PowerLogic™ P3G30 configuration	124
PowerLogic™ P3G32 configuration	125
<hr/>	
<b>Accessories</b>	<b>126</b>
<hr/>	
<b>Tools</b>	<b>128</b>
<hr/>	



## PowerLogic™ P3 Standard

Commercial Ref.	Product reference	Power Supply	Nominal DI threshold voltage	Voltage inputs	Current inputs	Nbr. Digital Input/Output	CT connector	Comm. Port
<a href="#">REL52001</a>	P3U30-5AAA3BCAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
<a href="#">REL52002</a>	P3U30-5AAA3BBAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RS485
<a href="#">REL52003</a>	P3U30-5AAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
<a href="#">REL52004</a>	P3U30-5AAA2BCAA	Power A 48...230 V	110 Vac/dc	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
<a href="#">REL52005</a>	P3U30-5AAA1BBAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RS485
<a href="#">REL52006</a>	P3U30-5ABA1BBAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RS485
<a href="#">REL52007</a>	P3U30-5AAA1BDAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x LC
<a href="#">REL52008</a>	P3U30-6AAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
<a href="#">REL52009</a>	P3U30-5ABA1BCAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
<a href="#">REL52010</a>	P3U30-5AAA2BDAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x LC
<a href="#">REL52011</a>	P3U20-5ABA1ACAA	Power B 24...48 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x RJ45
<a href="#">REL52012</a>	P3U30-5AAA2BBAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RS485
<a href="#">REL52013</a>	P3U20-5AAA1ACAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x RJ45
<a href="#">REL52014</a>	P3U30-5ABA1BDAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x LC
<a href="#">REL52015</a>	P3U20-6AAA2ACAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x RJ45
<a href="#">REL52016</a>	P3U30-6AAA2BBAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485
<a href="#">REL52017</a>	P3U30-6AAA3BCAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
<a href="#">REL52018</a>	P3U20-5AAA2ACAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x RJ45
<a href="#">REL52019</a>	P3U30-5AAA1BFAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	LC + RS232
<a href="#">REL52020</a>	P3U30-6ABA1BBAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485
<a href="#">REL52021</a>	P3U30-6AAA2BDAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x LC
<a href="#">REL52022</a>	P3U30-6AAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
<a href="#">REL52023</a>	P3U20-6ABA1ADAA	Power B 24...48 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x LC
<a href="#">REL52024</a>	P3U20-5ABA1ADAA	Power B 24...48 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x LC
<a href="#">REL52025</a>	P3U30-5BAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
<a href="#">REL52032</a>	P3U20-5AAA1ABAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	RS485
<a href="#">REL52033</a>	P3U20-5AAA1ADAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x LC
<a href="#">REL52034</a>	P3U20-6AAA1ABAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	RS485
<a href="#">REL52035</a>	P3U20-6AAA1ACAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x RJ45
<a href="#">REL52036</a>	P3U20-6AAA1ADAA	Power A 48...230 V	24 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x LC
<a href="#">REL52037</a>	P3U20-5AAA2BAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	RS485
<a href="#">REL52038</a>	P3U20-5AAA2DAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x LC
<a href="#">REL52039</a>	P3U20-6AAA2ABAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	RS485
<a href="#">REL52040</a>	P3U20-6AAA2ADAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x LC
<a href="#">REL52041</a>	P3U20-5AAA3ABAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	RS485
<a href="#">REL52042</a>	P3U20-5AAA3ACAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x RJ45
<a href="#">REL52043</a>	P3U20-5AAA3ADAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Clamp	2 x LC
<a href="#">REL52044</a>	P3U20-6AAA3ABAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	RS485
<a href="#">REL52045</a>	P3U20-6AAA3ACAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x RJ45
<a href="#">REL52046</a>	P3U20-6AAA3ADAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	10 DI/5 DO	Ring-lug	2 x LC
<a href="#">REL52047</a>	P3U30-6AAA1BBAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485
<a href="#">REL52048</a>	P3U30-6AAA1BDAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x LC
<a href="#">REL52049</a>	P3U30-5AAA3BDAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x LC
<a href="#">REL52050</a>	P3U30-6AAA3BBAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485
<a href="#">REL52051</a>	P3U30-6AAA3BDAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x LC
<a href="#">REL52073</a>	P3U30-7AAA1CDAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	2 x LC
<a href="#">REL52074</a>	P3U30-7AAA1CCAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	2 x RJ45
<a href="#">REL52075</a>	P3U30-7AAA2CCAA	Power A 48...230 V	110 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	2 x RJ45
<a href="#">REL52076</a>	P3U30-7AAA2CDAA	Power A 48...230 V	110 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	2 x LC
<a href="#">REL52077</a>	P3U30-7AAA3CCAA	Power A 48...230 V	220 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	2 x RJ45
<a href="#">REL52078</a>	P3U30-7AAA1CBAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, Io: Clamp	RS485
<a href="#">REL52080</a>	P3U30-6BAA1BBAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485



## PowerLogic™ P3 Standard

Commercial Ref.	Product reference	Power Supply	Nominal DI threshold voltage	Voltage inputs	Current inputs	Nbr. Digital Input/Output	CT connector	Comm. Port
REL52081	P3U30-6BAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52082	P3U30-6AAA2BEAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RJ45 + RS232
REL52083	P3U30-5BAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52084	P3U30-5BAA3BCAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52085	P3U30-5BAA3BBAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RS485
REL52086	P3U30-5AAA1BEAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RJ45 + RS232
REL52087	P3U30-5BAA2BEAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	RJ45 + RS232
REL52089	P3U30-5BAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52090	P3U30-5CAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52092	P3U30-5CAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52093	P3U30-6CAA2BCAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52094	P3U30-6CAA1BBAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	RS485
REL52095	P3U30-6CAA2BDAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x LC
REL52096	P3U30-5CAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	2 x RJ45
REL52097	P3U30-6CAA3BCAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52100	P3U30-5AAA2BFAA	Power A 48...230 V	110 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Clamp	LC + RS232
REL52201	P3U30-6ABA1BCAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52202	P3U30-6AAA5BCAA	Power A 48...230 V	DI1-2: 24 V, DI3-16: 220 V (dc/ac)	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52203	P3U20-6AAA2AHAA	Power A 48...230 V	110 Vdc/ac	1 VT	4 CT	8 DI / 11 DO	Ring-lug	2 x RJ45
REL52204	P3U20-6AAA3AHAA	Power A 48...230 V	220 Vdc/ac	1 VT	4 CT	8 DI / 11 DO	Ring-lug	2 x RJ45
REL52205	P3U20-6AAA5AHAA	Power A 48...230 V	DI1-2: 24 V, DI3-16: 220 V (dc/ac)	1 VT	4 CT	8 DI / 11 DO	Ring-lug	2 x RJ45
REL52206	P3U30-6AAA5BHAA	Power A 48...230 V	DI1-2: 24 V, DI3-16: 220 V (dc/ac)	4 VT	4 CT	14 DI / 11 DO	Ring-lug	2 x RJ45
REL52207	P3U30-6AAA3BHAA	Power A 48...230 V	220 Vdc/ac	4 VT	4 CT	14 DI / 11 DO	Ring-lug	2 x RJ45
REL52208	P3U30-6CAA1BCAA	Power A 48...230 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x RJ45
REL52209	P3U30-8CAA1CCAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, lo: Ring-lug	2 x RJ45
REL52210	P3U30-6ABA1BDAA	Power B 24...48 V	24 Vdc/ac	4 VT	4 CT	16 DI/8 DO	Ring-lug	2 x LC
REL52211	P3U30-7AAA1CCAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, lo: Clamp	2 x RJ45
REL52212	P3U30-7AAA1CEAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, lo: Clamp	RJ45 + RS232
REL52213	P3U30-7BAA1CCAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, lo: Clamp	2 x RJ45
REL52214	P3U30-7BAA1CEAA	Power A 48...230 V	24 Vdc/ac	4 LPVT	3 LPCT, 1CT	16 DI/8 DO	LPCT: RJ45, lo: Clamp	RJ45 + RS232

For more configuration or options, please use our web configurator or see:

Page 117 for PowerLogic™ P3U20

Page 118 for PowerLogic™ P3U30

[Go to web configurator](#)

## Fast Ordering Code

PowerLogic™ P3 Advanced



PowerLogic™ P3 Advanced

The PowerLogic P3 Advanced relay is a fully configurable product. Use the below links to go directly to concerned application pages.

Page 119 for PowerLogic™ P3F30

Page 122 for PowerLogic™ P3M32

Page 120 for PowerLogic™ P3L30

Page 123 for PowerLogic™ P3T32

Page 121 for PowerLogic™ P3M30

Page 124 for PowerLogic™ P3G30

Page 125 for PowerLogic™ P3G32

Alternatively configure the product using digital web configurator tool.

[Go to web configurator](#)

# PowerLogic™ P3 Standard

## PowerLogic™ P3U20 Configuration

(1) Always check the power supply range from the relay's serial number sticker

	<b>U20</b>	<b>Application</b>
		<b>U20</b> Feeder & Motor, 4xI, 1xU, 2DI, 5DO
X1		<b>Phase currents &amp; voltage input, X1</b>
		<b>5</b> 1 A/5 A & 1U (100/110 V), pluggable clamp connector
		<b>6</b> 1 A/5 A & 1U (100/110 V), pluggable ring lug connector
X1		<b>Earth-fault current input, X1</b>
		<b>A</b> 1 A/5 A
		<b>B</b> 0,2 A/1 A
		<b>C</b> 2 A/20 A CSH
X2		<b>Nominal Supply Voltage [V], X2</b>
		<b>A</b> Power A 48...230 V (range: 40...265 Vac/dc)
		<b>B</b> Power B 24...48 V (range: 18...60 Vdc) <sup>(1)</sup>
	<b>A</b>	<b>Future option</b>
		<b>A</b> None
		<b>Nominal Digital Input voltage (voltage withstand)</b>
		<b>1</b> 24 Vac/dc (255 Vac/dc)
		<b>2</b> 110 Vac/dc (255 Vac/dc)
		<b>3</b> 220 Vac/dc (255 Vac/dc)
		<b>4</b> 24 Vac/dc for DI -DI2, 110 Vac/dc for DI3-DI16 (255 Vac/dc)
		<b>5</b> 24 Vac/dc for DI -DI2, 220 Vac/dc for DI3-DI16 (255 Vac/dc)
X5	<b>A</b>	<b>Voltage measurements + I/O, X5</b>
		<b>A</b> None
X4		<b>I/O with comms, X4</b>
		<b>B</b> RS-485 + 8DI
		<b>C</b> 2 x RJ-45 + 8DI
		<b>D</b> 2 x LC + 8DI
		<b>E</b> RJ + 232 + 8DI with IRIG-B
		<b>F</b> LC + 232 + 8DI with IRIG-B
		<b>G</b> RS-485 + 6DI + 3DO
		<b>H</b> 2 x RJ-45 + 6DI + 3DO
		<b>I</b> 2 x LC + 6DI + 3DO
		<b>Product version</b>
		<b>A</b> Version 2.1, newest FW
		<b>Region</b>
		<b>A</b> English, IEC
		<b>B</b> English, ANSI
		<b>C</b> Chinese
		<b>R</b> Russian

1. Choose your option

2. Mark your choice in the box below

3. Check your **order code**::

PowerLogic P3 **U20**     **A**   **A**

Slot numbers                      X1      X1      X2                                      X5      X4

# PowerLogic™ P3 Standard

## PowerLogic™ P3U30 Configuration

(1) Always check the power supply range from the relay's serial number sticker

<input checked="" type="checkbox"/>	<b>U30</b>	<b>Application</b>	
		<b>U30</b>	Feeder & Motor, 4xI, 4xU, 2DI, 5DO
X1	<input type="checkbox"/>	<b>Phase currents &amp; voltage input, X1</b>	
		<b>5</b>	1 A/5 A & 1U (100/110 V), pluggable clamp connector X5 = B
		<b>6</b>	1 A/5 A & 1U (100/110 V), pluggable ring lug connector X5 = B
		<b>7</b>	3 LPCT & 4 LPVT, lo clamp connector X5 = C
		<b>8</b>	3 LPCT & 4 LPVT, lo ring-lug connector X5 = C
X1	<input type="checkbox"/>	<b>Earth-fault current input, X1</b>	
		<b>A</b>	1 A/5 A
		<b>B</b>	0,2 A/1 A
		<b>C</b>	2 A/20 A CSH
X2	<input type="checkbox"/>	<b>Nominal Supply Voltage [V], X2</b>	
		<b>A</b>	Power A 48...230 V (range: 40...265 Vac/dc)
		<b>B</b>	Power B 24...48 V (range: 18...57 Vdc) <sup>(1)</sup>
	<input checked="" type="checkbox"/>	<b>A</b>	<b>Future option</b>
		<b>A</b>	None
	<input type="checkbox"/>	<b>Nominal Digital Input voltage (voltage withstand)</b>	
		<b>1</b>	24 Vac/dc (255 Vac/dc)
		<b>2</b>	110 Vac/dc (255 Vac/dc)
		<b>3</b>	220 Vac/dc (255 Vac/dc)
		<b>4</b>	24 Vac/dc for DI -DI2, 110 Vac/dc for DI3-DI16 (255 Vac/dc)
		<b>5</b>	24 Vac/dc for DI1-DI2, 220 Vac/dc for DI3-DI16 (255 Vac/dc)
X5	<input type="checkbox"/>	<b>Voltage measurements + I/O, X5</b>	
		<b>B</b>	3U (100/110 V) + 6DI + 3DO X1 = 5 or 6
		<b>C</b>	6 DI + 3 DO X1 = 7 or 8
X4	<input type="checkbox"/>	<b>I/O with comms, X4</b>	
		<b>B</b>	RS-485 + 8DI
		<b>C</b>	2 x RJ-45 + 8DI
		<b>D</b>	2 x LC + 8DI
		<b>E</b>	RJ + 232 + 8DI with IRIG-B
		<b>F</b>	LC + 232 + 8DI with IRIG-B
		<b>G</b>	RS-485 + 6DI + 3DO X1 = 5 or 6
		<b>H</b>	2 x RJ-45 + 6DI + 3DO X1 = 5 or 6
		<b>I</b>	2 x LC + 6DI + 3DO X1 = 5 or 6
	<input type="checkbox"/>	<b>Product version</b>	
		<b>A</b>	Version 2.1, newest FW
	<input type="checkbox"/>	<b>Region</b>	
		<b>A</b>	English, IEC
		<b>B</b>	English, ANSI Slot X1 = 6
		<b>C</b>	Chinese
		<b>R</b>	Russian

1. Choose your option

2. Mark your choice in the box below

3. Check your **order code**:

PowerLogic P3  **U30**     **A**

Slot numbers X1 X1 X2 X5 X4



# PowerLogic™ P3 Advanced

## PowerLogic™ P3F30 Configuration

	<b>F30</b>	<b>Application</b>	
		<b>F30</b> Feeder protection relay	
1		<b>Nominal Supply Voltage [V]</b>	
		<b>C</b> Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF)	
		<b>D</b> Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)	
2		<b>I/O Card I</b>	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO) or 6	Slot 3 = A, G, H or I
		<b>B</b> 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4)	Slot 3 = A, G, H or I
		<b>C</b> F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4)	Slot 3 = A, G, H or I
3		<b>I/O Card II</b>	
		<b>A</b> None	Slot 4 = A
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO)	Slot 4 = A, G, H or I
		<b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC))	Slot 4 = A, H or I
		<b>I</b> 10DI (10 x DI)	Slot 4 = A or I
4		<b>I/O Card III</b>	
		<b>A</b> None	Slot 5 = A or D
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO)	Slot 5 = A, G or I
		<b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC))	Slot 5 = A, H or I
		<b>I</b> 10DI (10 x DI)	Slot 5 = A or I
5		<b>I/O Card IV</b>	
		<b>A</b> None	
		<b>D</b> 2IGBT (2 x IGBT High speed outputs), excludes I/O Card III, slot 4	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO)	
		<b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC))	
		<b>I</b> 10DI (10 x DI)	
6		<b>Option card I</b>	
		<b>A</b> None	
		<b>D</b> 4Arc (4 x Arc sensor)	
		<b>K</b> RS232, IRIG-B	
7	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
8		<b>Analog measurement card (See application)</b>	
		<b>E</b> 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U	Region = A, C or R
		<b>M</b> 3LPCT + 2Io(5/1A+1/0,2A) + 4LPVT	Region = A, C or R
		<b>N</b> 3L(5/1A) + Io1(5/1A) + Io2CSH(2/20A) + 4U	Region = A, C or R
		<b>P</b> 3LPCT + Io1(5/1A) + Io2CSH(2/20A) + 4LPVT	Region = A, C or R
		<b>1</b> 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U	
		<b>5</b> 3L(5/1A) + Io1(5A) + Io2CSH(2/20A) RL + 4U	Region = A, C or R
9		<b>Communication interface I</b>	
		<b>A</b> None	
		<b>B</b> RS232 (RS232, IRIG-B)	
		<b>C</b> RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs)	
		<b>D</b> RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs)	
		<b>E</b> 2xRS485 (2-wire)	
		<b>F</b> RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs)	
		<b>G</b> RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs)	
		<b>N</b> 2xRJ (Ethernet RJ 100 Mbs, RSTP, PRP)	
		<b>O</b> 2xLC (Ethernet LC 100 Mbs, RSTP, PRP)	
		<b>P</b> PP (Plastic / Plastic serial fibre)	
		<b>R</b> GG (Glass / Glass serial fibre)	
10	<b>A</b>	<b>Reserved</b>	
		<b>A</b> Reserved	
		<b>Display type</b>	
		<b>B</b> 128x128 (128 x 128 LCD matrix)	
		<b>C</b> 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>	
		<b>Nominal Digital Input voltage (voltage withstand)</b>	
		<b>A</b> 24 Vdc/ac, (255 Vac/dc)	
		<b>B</b> 110 Vdc/ac, (255 Vac/dc)	
		<b>C</b> 220 Vdc/ac, (255 Vac/dc)	
	<b>A</b>	<b>Product version</b>	
		<b>A</b> Version 2.1, newest FW	
	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
		<b>Region</b>	
		<b>A</b> English, IEC	
		<b>B</b> English, ANSI	Slot 8 = 1 or 2
		<b>C</b> Chinese	
		<b>R</b> Russia	

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option

2. Mark your choice in the box below

3. Check your order code:

PowerLogic P3 **F30**       -  **A**     -

Slot numbers                      1                      2                      3                      4                      5                      -                      6                      7                      8                      9                      10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3L30 Configuration

	<b>L30</b>	<b>Application</b>	
		<b>L30</b>	Feeder protection relay with Line differential protection
1		<b>Nominal Supply Voltage [V]</b>	
		<b>C</b>	Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF)
		<b>D</b>	Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)
2		<b>I/O Card I</b>	
		<b>G</b>	6DI+4DO (6 x DI, 4 x DO) Slot 3 = A, G, H or I
		<b>B</b>	3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I
		<b>C</b>	F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I
3		<b>I/O Card II</b>	
		<b>A</b>	None Slot 4 = A
		<b>G</b>	6DI+4DO (6 x DI, 4 x DO) Slot 4 = A, G, H or I
		<b>H</b>	6DI+4DO (6 x DI, 4 x DO(NC)) Slot 4 = A, H, or I
		<b>I</b>	10DI (10 x DI) Slot 4 = A or I
4		<b>I/O Card III</b>	
		<b>A</b>	None Slot 5 = A or D
		<b>G</b>	6DI+4DO (6 x DI, 4 x DO) Slot 5 = A, G, H or I
		<b>H</b>	6DI+4DO (6 x DI, 4 x DO(NC)) Slot 5 = A, H, or I
		<b>I</b>	10DI (10 x DI) Slot 5 = A or I
5		<b>I/O Card IV</b>	
		<b>A</b>	None
		<b>D</b>	2IGBT (2 x IGBT High speed outputs), excludes I/O Card III, slot 4 Slot 4 = A
		<b>G</b>	6DI+4DO (6 x DI, 4 x DO)
		<b>H</b>	6DI+4DO (6 x DI, 4 x DO(NC))
		<b>I</b>	10DI (10 x DI)
6		<b>Option card I</b>	
		<b>D</b>	4Arc (4 x Arc sensor)
		<b>S</b>	Line diff with integrated optical diff comms. card
		<b>T</b>	Line diff with RS232 for external diff comms. converter
7	<b>A</b>	<b>Future option</b>	
		<b>A</b>	None
8		<b>Analog measurement card (See application)</b>	
		<b>E</b>	3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Region = A, C or R
		<b>N</b>	3L(5/1A) + Io1(5/1A) + Io2CSH(2/20A) + 4U Region = A, C or R
		<b>1</b>	3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U
		<b>5</b>	3L(5/1A) + Io1(5A) + Io2CSH(2/20A) RL + 4U Region = A, C or R
9		<b>Communication interface I</b>	
		<b>A</b>	None
		<b>B</b>	RS232 (RS232, IRIG-B)
		<b>C</b>	RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs)
		<b>D</b>	RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs)
		<b>E</b>	2xRS485 (2-wire)
		<b>F</b>	RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs)
		<b>G</b>	RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs)
		<b>N</b>	2xRJ (Ethernet RJ 100 Mbs, RSTP)
		<b>O</b>	2xLC (Ethernet LC 100 Mbs, RSTP)
		<b>P</b>	PP (Plastic / Plastic serial fibre)
		<b>R</b>	GG (Glass / Glass serial fibre)
10	<b>A</b>	<b>Reserved</b>	
		<b>A</b>	Reserved
		<b>Display type</b>	
		<b>B</b>	128x128 (128 x 128 LCD matrix)
		<b>C</b>	128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>
		<b>Nominal Digital Input voltage (voltage withstand)</b>	
		<b>A</b>	24 Vdc/ac, (255 Vac/dc)
		<b>B</b>	110 Vdc/ac, (255 Vac/dc)
		<b>C</b>	220 Vdc/ac, (255 Vac/dc)
	<b>A</b>	<b>Product version</b>	
		<b>A</b>	Version 2.1, newest FW
	<b>A</b>	<b>Future option</b>	
		<b>A</b>	None
		<b>Region</b>	
		<b>A</b>	English, IEC
		<b>B</b>	English, ANSI Slot B = 1 or 2
		<b>C</b>	Chinese
		<b>R</b>	Russia

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option

2. Mark your choice in the box below

3. Check your order code:

PowerLogic™ P3 **L30**       -  **A**      -    **A**

Slot numbers                      1                      2                      3                      4                      5                      -                      6                      7                      8                      9                      10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3M30 Configuration

	<b>M30</b>	<b>Application</b> M30 Motor protection relay
1		<b>Nominal Supply Voltage [V]</b> C Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF) D Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)
2		<b>I/O Card I</b> G 6DI+4DO (6 x DI, 4 x DO) Slot 3 = A, G, H or I B 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I C F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I
3		<b>I/O Card II</b> A None Slot 4 = A G 6DI+4DO (6 x DI, 4 x DO) Slot 4 = A, G, H, or I H 6DI+4DO (6 x DI, 4 x DO(NC)) Slot 4 = A, H or I I 10DI (10 x DI) Slot 4 = A or I
4		<b>I/O Card III</b> A None Slot 5 = A or D G 6DI+4DO (6 x DI, 4 x DO) Slot 5 = A, G, H or I H 6DI+4DO (6 x DI, 4 x DO(NC)) Slot 5 = A, H or I I 10DI (10 x DI) Slot 5 = A or I
5		<b>I/O Card IV</b> A None Slot 4 = A D 2IGBT (2 x IGBT High speed outputs), excludes I/O Card III, slot 4 G 6DI+4DO (6 x DI, 4 x DO) H 6DI+4DO (6 x DI, 4 x DO(NC)) I 10DI (10 x DI)
6		<b>Option card I</b> A None D 4Arc (4 x Arc sensor) K RS232, IRIG-B
7	<b>A</b>	<b>Future option</b> A None
8		<b>Analog measurement card (See application)</b> E 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Region = A, C or R M 3LPCT + 2Io(5/1A+1/0,2A) + 4LPVT Region = A, C or R N 3L(5/1A) + Io1(5/1A) + Io2CSH(2/20A) + 4U Region = A, C or R P 3LPCT + Io1(5/1A) + Io2CSH(2/20A) + 4LPVT Region = A, C or R 1 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U 5 3L(5/1A) + Io1(5A) + Io2CSH(2/20A) RL + 4U Region = A, C or R
9		<b>Communication interface I</b> A None B RS232 (RS232, IRIG-B) C RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs) D RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs) E 2xRS485 (2-wire) F RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs) G RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs) N 2xRJ (Ethernet RJ 100 Mbs, RSTP) O 2xLC (Ethernet LC 100 Mbs, RSTP) P PP (Plastic / Plastic serial fibre) R GG (Glass / Glass serial fibre)
10	<b>A</b>	<b>Reserved</b> A Reserved
		<b>Display type</b> B 128x128 (128 x 128 LCD matrix) C 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>
		<b>Nominal Digital Input voltage (voltage withstand)</b> A 24 Vdc/ac, (255 Vac/dc) B 110 Vdc/ac, (255 Vac/dc) C 220 Vdc/ac, (255 Vac/dc)
	<b>A</b>	<b>Product version</b> A Version 2.1, newest FW
	<b>A</b>	<b>Future option</b> A None
		<b>Region</b> A English, IEC B English, ANSI Slot 8 = 1 or 2 C Chinese R Russia

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option
2. Mark your choice in the box below
3. Check your **order code**:

PowerLogic™ P3 **M30**      -  **A**      -    **A** **A**

Slot numbers                      1            2            3            4            5            -            6            7            8            9            10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3M32 Configuration

	<b>M32</b>	<b>Application</b>	
		<b>M32</b> Motor protection relay with differential protection	
1		<b>Nominal Supply Voltage [V]</b>	
		<b>C</b> Power C 110...230 V (80 .. 265 Vac/dc, 5 x DO heavy duty, A1, SF)	
		<b>D</b> Power D 24...48 V (18 .. 60 Vdc, 5 x DO heavy duty, A1, SF)	
2		<b>I/O Card I</b>	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO) Slot 3 = A, G, H or I	
		<b>B</b> 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I	
		<b>C</b> F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I	
3		<b>I/O Card II</b>	
		<b>A</b> None	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO)	
		<b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC))	
		<b>I</b> 10DI (10 x DI)	
4		<b>I/O Card III</b>	
		<b>T</b> 3xI (5/1A) + Io (5/1A) for motor differential protection Slot 8 = E or F	
		<b>1</b> 3xI (5/1A) ringlug + Io (5/1A) for motor differential protection Slot 8 = 1 or 2	
5	<b>A</b>	<b>I/O Card IV</b>	
		<b>A</b> None	
6		<b>Option card I</b>	
		<b>A</b> None	
		<b>D</b> 4Arc (4 x Arc sensor)	
		<b>K</b> RS232, IRIG-B	
7	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
8		<b>Analog measurement card (See application)</b>	
		<b>E</b> 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Slot 4 = T and Region = A or C or R	
		<b>1</b> 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U Slot 4 = 1	
9		<b>Communication interface I</b>	
		<b>A</b> None	
		<b>B</b> RS232 (RS232, IRIG-B)	
		<b>C</b> RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs)	
		<b>D</b> RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs)	
		<b>E</b> 2xRS485 (2-wire)	
		<b>F</b> RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs)	
		<b>G</b> RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs)	
		<b>N</b> 2xRJ (Ethernet RJ 100 Mbs, RSTP)	
		<b>O</b> 2xLC (Ethernet LC 100 Mbs, RSTP)	
		<b>P</b> PP (Plastic / Plastic serial fibre)	
		<b>R</b> GG (Glass / Glass serial fibre)	
10	<b>A</b>	<b>Reserved</b>	
		<b>A</b> Reserved	
		<b>Display type</b>	
		<b>B</b> 128x128 (128 x 128 LCD matrix)	
		<b>C</b> 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>	
		<b>Nominal Digital Input voltage (voltage withstand)</b>	
		<b>A</b> 24 Vdc/ac, (255 Vac/dc)	
		<b>B</b> 110 Vdc/ac, (255 Vac/dc)	
		<b>C</b> 220 Vdc/ac, (255 Vac/dc)	
	<b>A</b>	<b>Product version</b>	
		<b>A</b> Version 2.1, newest FW	
	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
		<b>Region</b>	
		<b>A</b> English, IEC	
		<b>B</b> English, ANSI Slot 4 = 1 and Slot 8 = 1 or 2	
		<b>C</b> Chinese	
		<b>R</b> Russia	

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option
2. Mark your choice in the box below
3. Check your **order code**:

PowerLogic™ P3 **M32**      **A** -  **A**     **A** -    **A** **A**

Slot numbers                      1            2            3            4            5            -            6            7            8            9            10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3T32 Configuration

	<b>T32</b>	<b>Application</b>	<b>T32</b> Transformer protection relay with differential protection
1		<b>Nominal Supply Voltage [V]</b>	<b>C</b> Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF) <b>D</b> Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)
2		<b>I/O Card I</b>	<b>G</b> 6DI+4DO (6 x DI, 4 x DO) <b>B</b> 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I <b>C</b> F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I
3		<b>I/O Card II</b>	<b>A</b> None <b>G</b> 6DI+4DO (6 x DI, 4 x DO) <b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC)) <b>I</b> 10DI (10 x DI)
4		<b>I/O Card III</b>	<b>T</b> 3xI (5/1A) + Io (5/1A) for transformer differential protection Slot 8 = E or F <b>1</b> 3xI (5/1A) ringlug + Io (5/1A) for transformer differential protection Slot 8 = 1 or 2
5	<b>A</b>	<b>I/O Card IV</b>	<b>A</b> None
6		<b>Option card I</b>	<b>A</b> None <b>D</b> 4Arc (4 x Arc sensor) <b>K</b> RS232, IRIG-B
7	<b>A</b>	<b>Future option</b>	<b>A</b> None
8		<b>Analog measurement card (See application)</b>	<b>E</b> 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Slot 4 = T and Region = A or C or R <b>1</b> 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U Slot 4 = 1
9		<b>Communication interface I</b>	<b>A</b> None <b>B</b> RS232 (RS232, IRIG-B) <b>C</b> RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs) <b>D</b> RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs) <b>E</b> 2xRS485 (2-wire) <b>F</b> RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs) <b>G</b> RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs) <b>N</b> 2xRJ (Ethernet RJ 100 Mbs, RSTP) <b>O</b> 2xLC (Ethernet LC 100 Mbs, RSTP) <b>P</b> PP (Plastic / Plastic serial fibre) <b>R</b> GG (Glass / Glass serial fibre)
10	<b>A</b>	<b>Reserved</b>	<b>A</b> Reserved
		<b>Display type</b>	<b>B</b> 128x128 (128 x 128 LCD matrix) <b>C</b> 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>
		<b>Nominal Digital Input voltage (voltage withstand)</b>	<b>A</b> 24 Vdc/ac, (255 Vac/dc) <b>B</b> 110 Vdc/ac, (255 Vac/dc) <b>C</b> 220 Vdc/ac, (255 Vac/dc)
	<b>A</b>	<b>Product version</b>	<b>A</b> Version 2.1, newest FW
	<b>A</b>	<b>Future option</b>	<b>A</b> None
		<b>Region</b>	<b>A</b> English, IEC <b>B</b> English, ANSI Slot 4 = 1 and Slot 8 = 1 or 2 <b>C</b> Chinese <b>R</b> Russia

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option
2. Mark your choice in the box below
3. Check your **order code**:

PowerLogic™ P3 **T32**       **A** -   **A**     **A** -    **A**

Slot numbers                      1            2            3            4            5            -            6            7            8            9            10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3G30 Configuration

	<b>G30</b>	<b>Application</b> G30 Generator protection
1		<b>Nominal Supply Voltage [V]</b> C Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF) D Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)
2		<b>I/O Card I</b> G 6DI+4DO (6 x DI, 4 x DO) Slot 3 = A, G, H or I B 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I C F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I
3		<b>I/O Card II</b> A None Slot 4 = A G 6DI+4DO (6 x DI, 4 x DO) Slot 4 = A, G, H or I H 6DI+4DO (6 x DI, 4 x DO(NC)) Slot 4 = A, H or I I 10DI (10 x DI) Slot 4 = A or I
4		<b>I/O Card III</b> A None Slot 5 = A or D G 6DI+4DO (6 x DI, 4 x DO) Slot 5 = A, G, H or I H 6DI+4DO (6 x DI, 4 x DO(NC)) Slot 5 = A, H or I I 10DI (10 x DI) Slot 5 = A or I
5		<b>I/O Card IV</b> A None D 2IGBT (2 x IGBT High speed outputs), excludes I/O Card III, slot 4 Slot 4 = A G 6DI+4DO (6 x DI, 4 x DO) H 6DI+4DO (6 x DI, 4 x DO(NC)) I 10DI (10 x DI)
6		<b>Option card I</b> A None D 4Arc (4 x Arc sensor) K RS232, IRIG-B
7	<b>A</b>	<b>Future option</b> A None
8		<b>Analog measurement card (See application)</b> E 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Region = A, C or R N 3L(5/1A) + Io1(5/1A) + Io2CSH(2/20A) + 4U Region = A, C or R 1 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U 5 3L(5/1A) + Io1(5A) + Io2CSH(2/20A) RL + 4U Region = A, C or R
9		<b>Communication interface I</b> A None B RS232 (RS232, IRIG-B) C RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs) D RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs) E 2xRS485 (2-wire) F RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs) G RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs) N 2xRJ (Ethernet RJ 100 Mbs, RSTP) O 2xLC (Ethernet LC 100 Mbs, RSTP) P PP (Plastic/Plastic serial fibre) R GG (Glass/Glass serial fibre)
10	<b>A</b>	<b>Reserved</b> A Reserved
		<b>Display type</b> B 128x128 (128 x 128 LCD matrix) C 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>
		<b>Nominal Digital Input voltage (voltage withstand)</b> A 24 Vdc/ac, (255 Vac/dc) B 110 Vdc/ac, (255 Vac/dc) C 220 Vdc/ac, (255 Vac/dc)
	<b>A</b>	<b>Product version</b> A Version 2.1, newest FW
	<b>A</b>	<b>Future option</b> A None
		<b>Region</b> A English, IEC B English, ANSI Slot 8 = 1 or 2 C Chinese R Russia

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option

2. Mark your choice in the box below

3. Check your **order code**:

PowerLogic™ P3 **G30**      -  **A**      -

Slot numbers                      1            2            3            4            5            -            6            7            8            9            10

# PowerLogic™ P3 Advanced

## PowerLogic™ P3G32 Configuration

	<b>G32</b>	<b>Application</b>	
		<b>G32</b> Generator protection with differential protection	
1		<b>Nominal Supply Voltage [V]</b>	
		<b>C</b> Power C 110...230 V (80...265 Vac/dc, 5 x DO heavy duty, A1, SF)	
		<b>D</b> Power D 24...48 V (18...60 Vdc, 5 x DO heavy duty, A1, SF)	
2		<b>I/O Card I</b>	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO) Slot 3 = A, G, H or I	
		<b>B</b> 3BIO+2Arc (3 x BI/BO, 2 x Arc point sensor, T2, T3, T4) Slot 3 = A, G, H or I	
		<b>C</b> F2BIO+1Arc (Fibre 2 x BI/BO, 1 x Arc loop sensor, T2, T3, T4) Slot 3 = A, G, H or I	
3		<b>I/O Card II</b>	
		<b>A</b> None	
		<b>G</b> 6DI+4DO (6 x DI, 4 x DO)	
		<b>H</b> 6DI+4DO (6 x DI, 4 x DO(NC))	
		<b>I</b> 10DI (10 x DI)	
4		<b>I/O Card III</b>	
		<b>T</b> 3xI (5/1A) + Io (5/1A) for generator differential protection Slot 8 = E or F	
		<b>1</b> 3xI (5/1A) ringlug + Io (5/1A) for generator differential protection Slot 8 = 1 or 2	
5	<b>A</b>	<b>I/O Card IV</b>	
		<b>A</b> None	
6		<b>Option card I</b>	
		<b>A</b> None	
		<b>D</b> 4Arc (4 x Arc sensor)	
		<b>K</b> RS232, IRIG-B	
7	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
8		<b>Analog measurement card (See application)</b>	
		<b>E</b> 3L(5/1A) + 2Io(5/1A+1/0,2A) + 4U Slot 4 = T and Region = A or C or R	
		<b>1</b> 3L(5/1A) + 2Io (5/1A+1/0,2A) ringlug + 4U Slot 4 = 1	
9		<b>Communication interface I</b>	
		<b>A</b> None	
		<b>B</b> RS232 (RS232, IRIG-B)	
		<b>C</b> RS232+RJ (RS232, IRIG-B + Ethernet RJ-45 100 Mbs)	
		<b>D</b> RS232+LC (RS232, IRIG-B + Ethernet LC 100 Mbs)	
		<b>E</b> 2xRS485 (2-wire)	
		<b>F</b> RS485+RJ (RS485 2-wire + Ethernet RJ-45 100 Mbs)	
		<b>G</b> RS485+LC (RS485 2-wire + Ethernet LC 100 Mbs)	
		<b>N</b> 2xRJ (Ethernet RJ 100 Mbs, RSTP)	
		<b>O</b> 2xLC (Ethernet LC 100 Mbs, RSTP)	
		<b>P</b> PP (Plastic / Plastic serial fibre)	
		<b>R</b> GG (Glass / Glass serial fibre)	
10	<b>A</b>	<b>Reserved</b>	
		<b>A</b> Reserved	
		<b>Display type</b>	
		<b>B</b> 128x128 (128 x 128 LCD matrix)	
		<b>C</b> 128x128Ext (128 x 128 LCD matrix, detachable) <sup>(1)</sup>	
		<b>Nominal Digital Input voltage (voltage withstand)</b>	
		<b>A</b> 24 Vdc/ac, (255 Vac/dc)	
		<b>B</b> 110 Vdc/ac, (255 Vac/dc)	
		<b>C</b> 220 Vdc/ac, (255 Vac/dc)	
	<b>A</b>	<b>Product version</b>	
		<b>A</b> Version 2.1, newest FW	
	<b>A</b>	<b>Future option</b>	
		<b>A</b> None	
		<b>Region</b>	
		<b>A</b> English, IEC	
		<b>B</b> English, ANSI Slot 4 = 1 and Slot 8 = 1 or 2	
		<b>C</b> Chinese	
		<b>R</b> Russia	

(1) By default cable length is 2 m. In case other length is needed order separately VX001-1, VX001-3 or VX001-5 for 1 m, 3 m and 5 m respectively.

1. Choose your option
2. Mark your choice in the box below
3. Check your **order code**:

PowerLogic™ P3 **G32**      **A** -  **A**    **A** -   **A** **A**

Slot numbers                      1            2            3            4            5            -            6            7            8            9            10

## Arc point sensors

Comm. Ref	Description	Used on	
<a href="#">REL52801</a>	VA1DA-20	Arc sensor, 20 m	
<a href="#">REL52802</a>	VA1DA-20S-HF	Arc sensor, 20 m, shielded, halogen free	
<a href="#">REL52803</a>	VA1DA-20S	Arc sensor, 20 m, shielded	
<a href="#">REL52804</a>	VA1DA-6	Arc sensor, 6 m connect cable	
<a href="#">REL52805</a>	VA1DA-6S-HF	Arc sensor, 6 m, halogen free	
<a href="#">REL52806</a>	VA1DA-6S	Arc sensor, 6 m, shielded	
<a href="#">REL52807</a>	VA1EH-20	Arc sensor, 20 m pipe sensor	P3F3x/P3M3x P3T3x/P3G3x
<a href="#">REL52808</a>	VA1EH-20S	Arc sensor, 20 m pipe sensor, shielded	
<a href="#">REL52809</a>	VA1EH-6	Arc sensor, 6 m pipe sensor	
<a href="#">REL52810</a>	VA1EH-6S	Arc sensor, 6 m pipe sensor, shielded	
<a href="#">REL52839</a>	VA1DA-6W	Arc sensor, 6 m, shielded at sensor end	
<a href="#">REL52840</a>	VA1DA-20W	Arc sensor, 20 m, shielded at sensor end	
<a href="#">REL52851</a>	VA2DV-3-SE	Arc sensor, 3 m, shielded, metal pipe	
<a href="#">REL52852</a>	VA2DV-6-SE	Arc sensor, 6 m, shielded, metal pipe	

## Arc fiber sensors

Comm. Ref	Description	Used on	
<a href="#">REL52842</a>	ARC SLM-1	Arc fiber sensor, 1 m	
<a href="#">REL52843</a>	ARC SLM-5	Arc fiber sensor, 5 m	
<a href="#">REL52844</a>	ARC SLM-10	Arc fiber sensor, 10 m	
<a href="#">REL52845</a>	ARC SLM-15	Arc fiber sensor, 15 m	
<a href="#">REL52846</a>	ARC SLM-20	Arc fiber sensor, 20 m	P3F3x/P3M3x P3T3x/P3G3x
<a href="#">REL52847</a>	ARC SLM-25	Arc fiber sensor, 25 m	
<a href="#">REL52848</a>	ARC SLM-30	Arc fiber sensor, 30 m	
<a href="#">REL52849</a>	ARC SLM-40	Arc fiber sensor, 40 m	
<a href="#">REL52853</a>	ARC SLM-50	Arc fiber sensor, 50 m	

## RTD Modules

Comm. Ref	Description	Used on	
<a href="#">REL52811</a>	VIO12AASE	RTD module, 12pcs RTD inputs, Optical Tx	
<a href="#">REL52812</a>	VIO12ABSE	RTD module, 12pcs RTD inputs, RS485	P3Ux0/P3F3x P3L3x/P3M3x P3T3x/P3G3x
<a href="#">REL52813</a>	VIO12ACSE	RTD module, 12pcs RTD inputs, mA in/out	
<a href="#">REL52814</a>	VIO12ADSE	RTD module, 12pcs RTD inputs, mA in/out	

## Communication Port

Comm. Ref	Description	Used on	
<a href="#">REL52815</a>	VPA3CGSE	Profibus interface module PM106585	P3Ux0/P3F3x P3L3x/P3M3x P3T3x/P3G3x
<a href="#">REL52820</a>	VSE002	RS485 module PM106581	

## Fiber optic modules

Reference	Description	Used on	
<a href="#">REL52816</a>	VSE001-GGSE	Fiber optic module (Glass - Glass) PM106586	
<a href="#">REL52817</a>	VSE001-GPSE	Fiber optic module (Glass - Plastic) PM106586	P3Ux0/P3F3x P3L3x/P3M3x P3T3x/P3G3x
<a href="#">REL52818</a>	VSE001-PGSE	Fiber optic module (Plastic - Glass) PM106586	
<a href="#">REL52819</a>	VSE001-PPSE	Fiber optic module (Plastic - Plastic) PM106586	



## Other accessories

Reference	Description	Used on
<a href="#">REL52822</a>	USB cable	USB programming cable (Easergy Pro)
<a href="#">REL52850</a>	BLUEFER	Bridge from Fieldbus to Wireless
<a href="#">REL52828</a>	VYX001	Mounting plate for arc sensor Z-shape
<a href="#">REL52829</a>	VYX002	Mounting plate for arc sensor L-shape
<a href="#">REL52831</a>	VYX301	VSE00x wall fastening module
<a href="#">REL52832</a>	VYX695	Raising frame, P3x, 45 mm
<a href="#">REL52823</a>	VX067	Split cable for COM 1-2 & COM 3-4 ports
<a href="#">REL52824</a>	VX072	Profibus cable
<a href="#">REL52838</a>	VX086	P3X (RS232) - COM 1-2 + 3-4 + IRIG B (3xD9)
<a href="#">REL52842</a>	P3XPAF	Wall mounted adapter
<a href="#">REL52834</a>	VYX860	Raising frame, P3U, 45 mm
<a href="#">REL52833</a>	P3UPSC	P3U panel seal cover
<a href="#">REL52825</a>	VX082	RS232 - VSE (1xD9) cable
<a href="#">REL52826</a>	VX083	RS232 - Remote/Ext. (3xD9) cable
<a href="#">REL52827</a>	VX084	RS232 - VPA 3CG cable (Profibus)
<a href="#">REL52836</a>	P3UWAF	Wall assembly frame
<a href="#">REL52837</a>	P3UPAV200	Adapter plate
<a href="#">REL52844</a>	P3UPAVS40	Adapter plate

## Additional Modules

Part No.	Qty.	Designation
<b>Sensors</b>		
<a href="#">59635</a>	<input type="checkbox"/>	Core balance CT, Ø=120 mm (CSH120)
<a href="#">59636</a>	<input type="checkbox"/>	Core balance CT, Ø=200 mm (CSH200)
<a href="#">59637</a>	<input type="checkbox"/>	Core balance CT, Ø=300 mm (CSH300)
<a href="#">EMS59572</a>	<input type="checkbox"/>	VT adapter
<a href="#">EMS59573</a>	<input type="checkbox"/>	LPVT hub connector
<a href="#">03813519N0</a>	<input type="checkbox"/>	1 phase LPCT TLP130 0,72 kV 130 mm diam 4m cable with intermediary connection
<a href="#">03818034N0</a>	<input type="checkbox"/>	1 phase LPCT TLP130/a 0,72 kV 130 mm diam 6.5 m cable
<a href="#">03811060N0</a>	<input type="checkbox"/>	1 phase LPCT TLP160 0,72 kV 160 mm diam 6.5 m cable
<a href="#">03811061N0</a>	<input type="checkbox"/>	1 phase LPCT TLP190 0,72 kV 190 mm diam 6.5 m cable
<a href="#">03816498N0</a>	<input type="checkbox"/>	1 phase LPVT 24 kV GIS type C
<a href="#">03816686N0</a>	<input type="checkbox"/>	1 phase LPVT 12 kV GIS type C
<a href="#">03816695N0</a>	<input type="checkbox"/>	1 phase LPVT 24 kV GIS type C
<a href="#">LPVT36GC</a>	<input type="checkbox"/>	1 phase LPVT 36 kV GIS type C
<a href="#">LPVT17GNKT</a>	<input type="checkbox"/>	1 phase LPVT 17,5 kV GIS type NKT
<a href="#">LPVT24GNKT</a>	<input type="checkbox"/>	1 phase LPVT 24 kV GIS type NKT
<a href="#">LPVT36GNKT</a>	<input type="checkbox"/>	1 phase LPVT 36 kV GIS type NKT
<a href="#">LPVT17GNE</a>	<input type="checkbox"/>	1 phase LPVT 17,5 kV GIS type NEXANS, short cone
<a href="#">LPVT24GNE</a>	<input type="checkbox"/>	1 phase LPVT 24 kV GIS type NEXANS, short cone
<a href="#">LPVT36GNE</a>	<input type="checkbox"/>	1 phase LPVT 36 kV GIS type NEXANS, short cone
<a href="#">LPVT17A</a>	<input type="checkbox"/>	1 phase LPVT 17,5kV AIS
<a href="#">LPVT17A</a>	<input type="checkbox"/>	1 phase LPVT 17,5kV AIS



# TOOLS

## se.com

This international web site allows you to access all the Schneider Electric solutions and product information via:

- Comprehensive descriptions
- Range datasheets
- A download area
- Product selectors


You can also access information dedicated to your business and contact your Schneider Electric country support.

## Web Selector

This site allows you to access the Schneider Electric products in just two clicks via a comprehensive range of datasheets, with direct links to:

- Complete libraries: technical documents, catalogs, FAQs, brochures
- Selection guides from the e-catalog
- Product discovery sites and their animations

You will also find illustrated overviews, news to which you can subscribe, and a list of country contacts

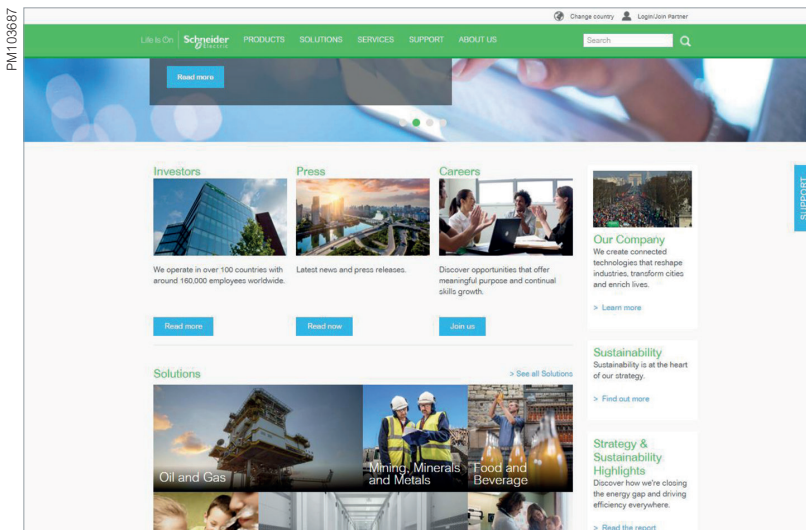

## Training

Training allows you to acquire the expertise (installation design, work with power on, etc.) to increase efficiency and improve customer service.

The training catalog includes beginner's courses in electrical distribution, knowledge of MV and LV switchgear, operation and maintenance of installations, and design of LV installations to give a few examples.

Notes

---



[www.se.com](http://www.se.com)

Schneider Electric Industries SAS  
35, Rue Joseph Monier  
CS 30323  
92506 Rueil Malmaison Cedex

RCS Nanterre 954 503 439  
Capital social 928 298 512 €  
[www.se.com](http://www.se.com)

November 2023  
PowerLogic™ P3  
**NRJCAT17764EN**

© 2023 - Schneider Electric. All rights reserved.  
All trademarks are owned by Schneider Electric  
Industries SAS or its affiliated companies.

As standards, specifications and designs develop from time to time, please  
ask for confirmation of the information given in this document.

Over 75 % of Schneider Electric products  
have been awarded the Green Premium ecolabel.

